

NOTE:
ALL ITEMS INSTALLED IN CEILING
PLENUM MUST BE PLENUM RATED.

LIGHT FIXTURE SCHEDULE

SYM	MANUFACTURER	CATALOG NUMBER	NO. LAMPS/TYPE	WATTS	VOLTS	MOUNTING	MARKS
A	COMMERCIAL ELECTRIC	CER105	75W PAR 30	75	120	RECESSED	8" RECESSED DOWNLIGHT
B	HAMPTON BAY	EC72108K	LED PAR 20	20	120	TRACK	INCADESCENT ADJUSTABLE TRACK. PROVIDE WITH TRACK AND ALL REQUIRED HARDWARE.
C	LITHONIA	2GT8432-A12120 1/4 GESB PWS1836 LP735	(3) 25W T8	75	120	RECESSED	2'X4' FLUORESCENT GRID TROFFER WITH PRISMATIC LENS
C-EM	LITHONIA	2GT8432-A12120 1/4 GESB PWS1836 LP735	(3) 25W T8	75	120	RECESSED	2'X4' FLUORESCENT GRID TROFFER WITH PRISMATIC LENS W/ 90 MIN. BATTERY PACK
D	ASPECTS	TW232R8	(2) 25W T8	50	120	SURFACE	1'X4' FLUORESCENT WRAPAROUND
E	PROGRESS LIGHTING	P7287-30EB	25W E25T8	25	120	SURFACE	STRIP FLUORESCENT
F	GENERAL ELECTRICAL SUPPLY	SKFHBP	150W CF	150	120	SURFACE	HIGH BAY FLUORESCENT
G	LITHONIA	OSWC 13F 120WH	(2) 32W T8	64	120	SURFACE	EXTERIOR WALL SCNCE
H	HAMPTON BAY	EC72108K	LED PAR 20	20	120	SURFACE	2'-0" LED ADJUSTABLE TRACK. PROVIDE WITH TRACK AND ALL REQUIRED HARDWARE
J	AFFORDABLE QUALITY LIGHTING	ADLXSV830-V	LED BR 30	11	120	SURFACE	GOOSENECK LIGHT
K	LITHONIA	OSWC 13F 120WH	COMPACT FLUOR	13	120	SURFACE	SCNCE
X	LITHONIA	EBB1R100 M6	LED'S W/FXTURE	5	120/277	SURFACE	EXIT SIGN WITH BATTERY BACK UP



- LUMINAIRE SCHEDULE NOTES:
- ALL FLUORESCENT LIGHTING SHALL BE PROVIDED WITH INTEGRAL DISCONNECTING MEANS.
 - COORDINATE THE MOUNTING LOCATION WITH THE OWNER'S CONSTRUCTION PROJECT MANAGER OR ARCHITECT.
 - PROVIDE ADDITIONAL BALLAST FOR INBOARD/OUTBOARD DUAL SWITCHING.
 - LED INBOARD SHATTERPROOF FIXTURES SHALL BE PROVIDED IN ALL FOOD PREPARATION AREAS.

GENERAL PLAN NOTES

- REFER TO GENERAL AND SPECIFICATION NOTES, FOR ALL REQUIREMENTS. ALL ROUGH-IN ARE TO BE INSPECTED BY K.E.C. CONTRACTOR BEFORE ANY WALL FINISHES ARE TO BE INSTALLED.
- ELECTRICAL CONTRACTOR TO COORDINATE RECEPTACLE MOUNTING HEIGHT, CONFIGURATION OF EQUIPMENT LOCATIONS AND REQUIREMENTS OF EQUIPMENTS WITH ARCHITECTURAL MILLWORK DRAWING PRIOR TO ROUGH-IN ELECTRICAL DEVICES.
- ALL WORK SHOWN SHALL COMPLY WITH ALL NATIONAL, STATE, AND LOCAL CODE ORDINANCES, ETC.
- ALL OUTLET COVERS TO BE ENGRAVED PER CORRESPONDING BREAKERS. ALL OUTLET COVERS TO STAINLESS STEEL.
- ELECTRICAL CONTRACTOR SHALL VERIFY AND PROVIDE ALL CONDUIT AND WIRE FOR CONNECTION TO ALL ELECTRICAL DEVICES, PER MANUFACTURER'S INSTALLATION INSTRUCTIONS.
- ALL OUTLETS WITHIN KITCHEN AREA AND PREP AREA SHALL BE PER NEC.
- COLOR OF RECEPTACLES AND COVER PLATES ARE TO COMPLY WITH SURROUNDING WALL (E.G. BROWN BROWN IN WOOD PANELING, ETC).
- NO EXPOSED CONDUITS ARE ALLOWED IN KITCHEN.
- ALL PVC CHASING TO HAVE CAPS AND BE STEPPED UP 4" A.F.F. MAXIMUM ANGLE TO HAVE 90° SWELLS.
- ALL RECEPTACLES IN "PUBLIC" AREAS ARE TO HAVE PLASTIC "CHILD GUARDS".
- EXPOSED CONDUIT IN THE SEATING AREA SHALL BE PAINTED TO MATCH THE SURROUNDING SURFACE FINISH. EXPOSED CONDUIT IS PERMITTED ONLY IF ABSOLUTELY NOT POSSIBLE TO CONCEAL THE CONDUIT. THE CONTRACTOR SHALL BRING CONDITIONS WHERE EXPOSED CONDUIT IS NECESSARY TO THE ATTENTION OF THE OWNER'S PROJECT MANAGER PRIOR TO INSTALLATION. EXPOSED CONDUIT THAT HAS NOT BEEN PRIOR APPROVED SHALL BE REMOVED AND RE-ROUTED AT THE CONTRACTOR'S EXPENSE.
- WHEN A CONDITION IN THE KITCHEN AREAS REQUIRES EXPOSED CONDUIT, THE CONDITION SHALL BE BROUGHT TO THE ATTENTION OF THE OWNER'S PROJECT MANAGER. ANY EXPOSED CONDUIT IN THE KITCHEN SHALL BE GRAY SEAL-TITE. EXPOSED CONDUIT THAT HAS NOT BEEN PRIOR APPROVED SHALL BE REMOVED AND RE-ROUTED AT THE CONTRACTOR'S EXPENSE.
- ALL 125 VOLT, 20 AMPERE OUTDOOR RECEPTACLES SHALL BE LISTED WEATHER RESISTANT TYPE, AND SHALL HAVE GFCI PROTECTION FOR PERSONNEL AND A WEATHER PROOF COVER.

KEYED NOTES

- CIRCUIT EXIT, EMERGENCY LIGHTING, EMERGENCY EGRESS LIGHTING AND NIGHT LIGHTS (NL) TO NEAREST LIGHTING CIRCUIT AHEAD OF ALL SWITCHING.
- WATTSTOPPER OR EQUAL, WALL MOUNT PASSIVE INFRARED OCCUPANCY SENSOR WITH SWITCH.
- PROVIDE DUAL LEVEL SWITCHING FOR LIGHTING. SWITCHING SHALL CONSIST OF THE INBOARD/OUTBOARD LAMPS OR EVERY OTHER FIXTURE FOR A 50% REDUCTION IN LIGHTING.
- CONTRACTOR SHALL PROVIDE ALL NECESSARY CONTACTORS AND RELAYS TO CIRCUIT EXHAUST FAN TO MOTION SENSOR FOR A COMPLETE OPERATIONAL SYSTEM.
- LIGHTING FIXTURES PROVIDED WITH WALK-IN COOLER.

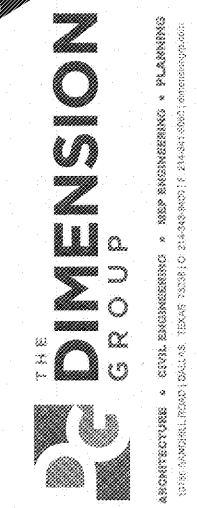

12/1/2017

ABACOIA TOWN CENTER
1209 MAIN STREET
UNIT 116
JUPITER, FLORIDA

DRAWN BY: R.T. CHECKED BY: A.H.

REVISIONS:

PROJECT NUMBER: 17-598

DATE: 10-24-2017

ELECTRICAL LIGHTING PLAN

E1.1