


Order Plans @ WWW.LDILLINE.COM

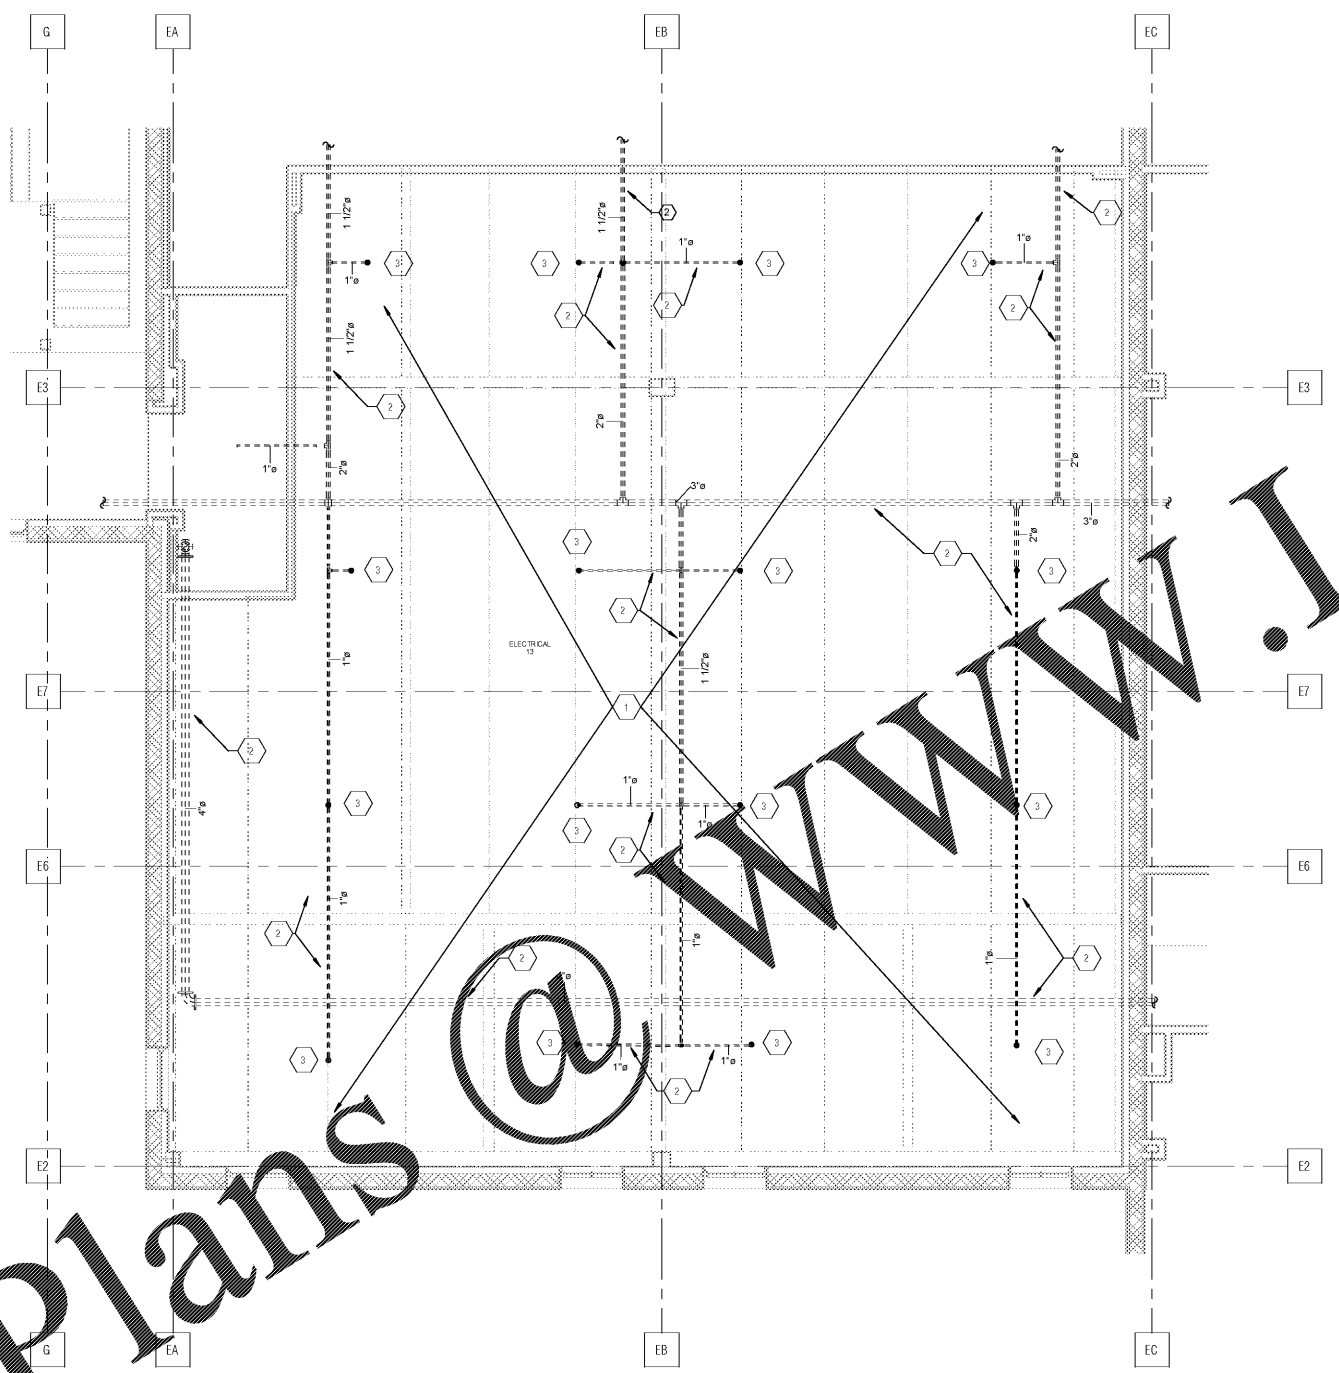

**GENERAL NOTES THIS SHEET:**  
 A. ALL PLUMBING ITEMS SHOWN DASHED ARE EXISTING.  
 B. ITEMS SHOWN HATCHED ARE TO BE REMOVED, UNLESS NOTED OTHERWISE.

**SPECIFIC NOTES THIS SHEET:**  
 1. EXISTING BUILDING IS PROTECTED WITH A FULLY AUTOMATIC SPRINKLER SYSTEM. CONTRACTOR TO MODIFY EXISTING SYSTEM AS REQUIRED TO ACCOMMODATE THE NEW PIPING AND FLOOR PLAN. CONTRACTOR SHALL COORDINATE OUTING ALL PIPING WITH ALL TRADES PRIOR TO SUBMISSION OF SHOP DRAWINGS TO THE MECHANICAL ENGINEER AND STAMPED FIRE MARSHAL. ALL PIPING SHALL BE ROUTED CONCEALED WHERE POSSIBLE AND AS PROPOSED SHALL BE PAINTED PER THE REQUIREMENTS OF THE ARCHITECT. CONTRACTOR SHALL PROVIDE SYSTEM THAT MEETS ALL REQUIREMENTS OF NFPA 101.13.14 AND 2015 IBC SPECIFICATIONS FOR REQUIREMENTS.  
 2. EXISTING SPRINKLER RISER AND BRANCH PIPING TO BE REMOVED.  
 3. EXISTING RIGHT SPRINKLER HEAD TO BE REMOVED.

1 | P1.0 | FLOOR PLAN - PLUMBING DEMOLITION  
 1/4" = 1'-0"

THE INFORMATION CONTAINED IN THIS DOCUMENT IS PROPRIETARY TO LUCIEN T. VIVIEN JR. & ASSOC., INC. THE DOCUMENT MAY NOT BE DISCLOSED, DUPLICATED, OR USED FOR ANY PURPOSE, IN WHOLE OR IN PART, WITHOUT THE PRIOR WRITTEN CONSENT OF LUCIEN T. VIVIEN JR. & ASSOC., INC.

THESE PLANS AND SPECIFICATIONS HAVE BEEN PREPARED BY OR UNDER MY CLOSE PERSONAL SUPERVISION AND, TO THE BEST OF MY KNOWLEDGE AND BELIEF, THEY COMPLY WITH ALL CITY REQUIREMENTS. WE ARE GENERALLY ADMINISTERING THE WORK.

LUCIEN T. VIVIEN JR. & ASSOCIATES  
 CONSULTING MEP ENGINEERS

3001 22<sup>ND</sup> STREET, METairie, LA 70002  
 Ph: 504.218.2400 | F: 504.218.2412 | www.ltv2010.com

NANO  
 ARCHITECTURE  
 0000 000 0000 0000 0000

REV	DATE	DESCRIPTION	BY
<b>SEWERAGE AND WATER BOARD OF NEW ORLEANS</b>			
<b>CONTRACT 8155</b>			
ELECTRICAL STORAGE ROOM OFFICE RENOVATION			
FLOOR PLAN - PLUMBING DEMOLITION			<b>P1.0</b>
DR	DEV		
INC	DEV		
CK	DEV		
AP	DEV		
SCALE: 1/4" = 1'-0"			<b>DWG. No. 12148-W60</b>
DATE: 15 NOVEMBER 2017			BY: BID DOCUMENTS

11/14/2017 10:58 AM