

**GENERAL NOTES THIS SHEET:**

A. ALL RACEWAY SYSTEMS LESS THAN 70 FEET SHALL BE 1/2" AND SHALL CONTAIN 2-#12 AWG AND 1-#12 GRD.; 70 FEET TO 120 FEET SHALL BE 3/4" AND SHALL CONTAIN 2-#10 AWG AND 1-#10 GRD.; 120 FEET TO 200 FEET SHALL BE 1" AND SHALL CONTAIN 2-#8 AWG AND 1-#8 GRD., UNLESS NOTED OTHERWISE.

B. HAT RACKS DO NOT INDICATE GROUND WIRE.

C. COORDINATE EXACT LOCATION OF ALL LIGHTING FIXTURES WITH ARCHITECTURAL DRAWINGS PRIOR TO INSTALLATION. CONNECT UNSWITCHED HOUSINGS TO EXIT SIGNS, EMERGENCY LIGHTS AND NIGHT LIGHTS IF APPLICABLE.

E. EMERGENCY LIGHTING FIXTURES SHALL NOT BE SWITCHED PER NFPA 101 AND ASHRAE 90.1.


F. SEE SHEET E4.0 FOR LIGHTING FIXTURE SCHEDULE AND ELECTRICAL LEGEND.

**SPECIFIC NOTES THIS SHEET:**

1 NEW PANELBOARD. SEE ELECTRICAL FEEDER DIAGRAM SHEET E4.0.

1 E2.0 FLOOR PLAN - LIGHTING  
1/4" = 1'-0"

Type Mark	Model	Description	Wattage	Lamp	Voltage
EXIT-1	LITHONIA: EDG-X-RMR-EL	EDGE LIT LED RED ON MIRROR FACE - MULLION / WALL MOUNT	5 W	LED	120V
F1	ABL-LITHONIA LIGHTING 2AVL2 40L MDR EZ1 LP835	AVANTE RECESSED 2'X2' LUMINAIRE WITH ROUND PERFORATED METAL DIFFUSER WITH ACRYLIC OVERLAY THREE LAMPS AND ALUMINUM STEPPED REFLECTOR	57 W	LED	120V
F1E	ABL-LITHONIA LIGHTING 2AVL2 40L MDR EZ1 LP835 EM	AVANTE RECESSED 2'X2' LUMINAIRE, EM BALLAST, WITH ROUND PERFORATED METAL DIFFUSER WITH ACRYLIC OVERLAY THREE LAMPS AND ALUMINUM STEPPED REFLECTOR	57 W	LED	120V
F2	ABL-LITHONIA LIGHTING ZL1N L48 5000LM FST MVOLT 35K 80CRI WH	4' LED STRIP; LENS	34 W	LED	120V

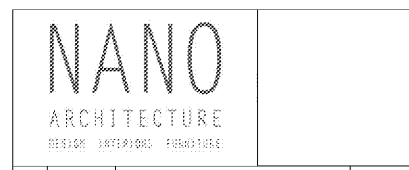

REV	DATE	DESCRIPTION	BY

SEWERAGE AND WATER BOARD OF NEW ORLEANS

**CONTRACT 8155**  
ELECTRICAL STORAGE ROOM OFFICE RENOVATION

FLOOR PLAN - LIGHTING **E2.0**

DWG. No. 12148-W-60  
DATE: 15 NOVEMBER 2017  
SCALE: 1/4" = 1'-0"  
BY: [Signature] DATE: [Signature]

THE INFORMATION CONTAINED IN THIS DOCUMENT IS PROPRIETARY TO LUCIEN T. VIVIEN, JR. & ASSOC., INC. THE DOCUMENT MAY NOT BE DISCLOSED, DUPLICATED, OR USED FOR ANY PURPOSE, IN WHOLE OR IN PART, WITHOUT THE PRIOR WRITTEN CONSENT OF LUCIEN T. VIVIEN, JR. & ASSOC., INC.

THESE PLANS AND SPECIFICATIONS HAVE BEEN PREPARED BY OR UNDER MY CLOSE PERSONAL SUPERVISION AND TO THE BEST OF MY KNOWLEDGE AND BELIEF THEY COMPLY WITH ALL CITY REQUIREMENTS. WE ARE GENERALLY ADMINISTERING THE WORK.

Order Plans @ WWW.LDMLINE.COM

11/15/2017 11:58:11 AM