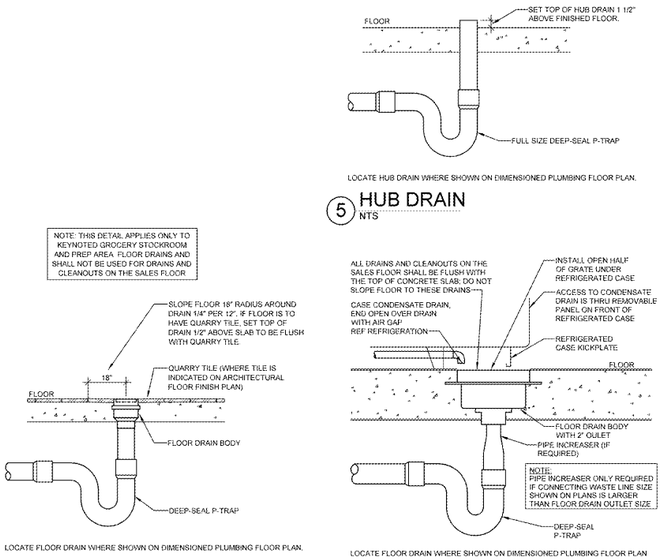

5 HUB DRAIN
NTS

4 OPEN FLOOR AREA DRAIN
NTS

3 REFRIGERATED CASE DRAIN
NTS

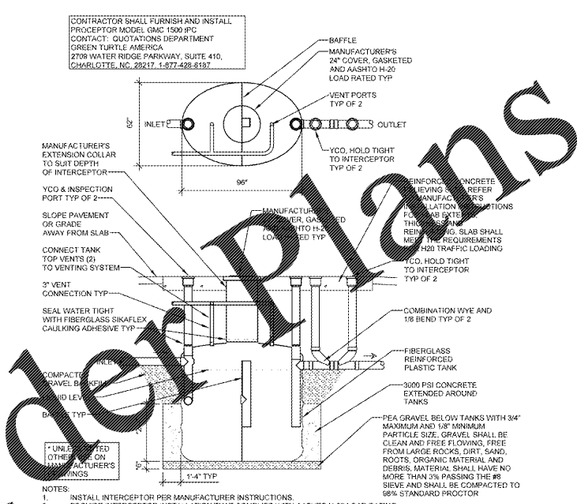

NOTES:
1. INSTALL INTERCEPTOR PER MANUFACTURER INSTRUCTIONS.
2. PROVIDE INTERCEPTOR INSTALLATION THAT COMPLIES WITH AASHTO H-20 LOAD RATING.
3. FROST LINE DEPTH TAKES PRECEDENCE OVER MINIMUM BURIAL DEPTH. CONTACT MANUFACTURER IF FROST LINE IS DEEPER THAN THE MAX DEPTH BEFORE INSTALLING. VERIFY THE INVERT WILL WORK AT THE CONNECTION TO CIVIL LINE WHILE MAINTAINING PROPER SLOPE.
4. PROVIDE SAMPLING PORT, REFER TO PLUMBING PLAN FOR LOCATION
5. REFER TO PLUMBING PLAN FOR PIPE SIZES.
6. NO SUBSTITUTIONS ALLOWED.
7. COORDINATE INSTALLATION DEPTH OF INTERCEPTOR WITH MANUFACTURER PRIOR TO ORDER TO VERIFY THE NEED FOR REINFORCEMENT OF TANK AND COLLAR WHEN UNIT INLET PIPE IS TO BE INSTALLED AT A DEPTH GREATER THAN 6 FT.

2 GREASE INTERCEPTOR - IPC
NTS

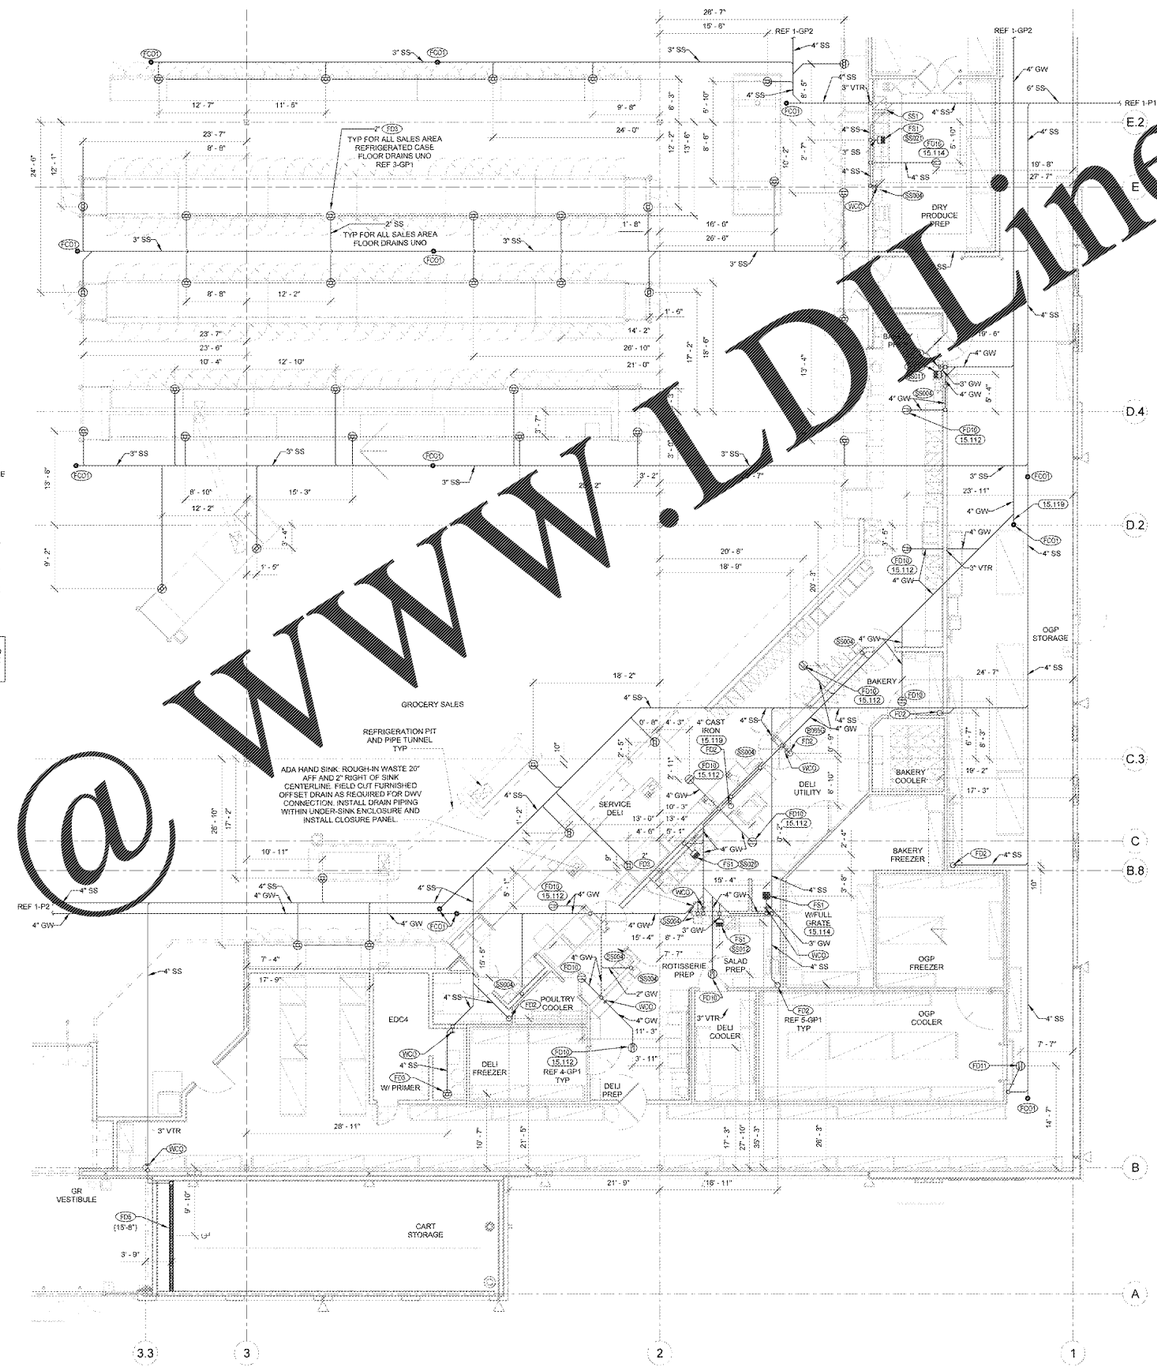

1 FRONT GROCERY DWV PLAN
1/8" = 1'-0"

GENERAL NOTES

1. REFER TO ARCHITECTURAL DRAWINGS FOR PIPING INSTALLATION AND SEALING REQUIREMENTS FOR DEVICES SHOWN ON COOLER/FREEZER PANELS. DO NOT INSTALL PIPING WITHIN COOLER/FREEZER PANELS.
2. PROVIDE BACKFLOW PREVENTION ON THREADED EQUIPMENT, HOSE BIBBS, AND ALL FAUCETS WITH THREADED SPOUTS. REFER TO PLUMBING FIXTURE SCHEDULE.
3. PROVIDE ESCUTCHEON PLATES FOR PLUMBING PENETRATIONS THROUGH GROCERY CEILINGS AND WALLS.
4. PROVIDE AIR-TIGHT SEAL AROUND PIPING PENETRATIONS THROUGH COOLER/FREEZER WALLS AND CEILINGS. FINISH WITH ESCUTCHEON PLATE.
5. SET TOP OF FLOOR DRAINS, FLOOR SINKS, TRENCH DRAINS, AND FLOOR CLEANOUTS FLUSH WITH FINISH FLOOR UNLESS NOTED OTHERWISE.
6. INSTALL CENTERLINE OF GROCERY AND DELI WALL PENETRATIONS AND WALL CLEANOUTS AT 12" AFF MINIMUM ABOVE TOP OF ARCHITECTURAL SANITARY COVE UNLESS NOTED OTHERWISE.
7. ALL FLOOR DRAIN OUTLETS SHALL BE SAME SIZE AS CONNECTING WASTE LINE UNLESS NOTED OTHERWISE. USE COMBINATION DRAIN/WASTE AND VENT SYSTEM.

KEYNOTES

15.112 SET TOP OF DRAIN ELEVATION AT 99.97'. SLOPE FLOOR TO DRAIN PER OPEN FLOOR AREA DRAIN DETAIL.

15.114 SET TOP OF DRAIN ELEVATION AT 99.88'. COORDINATE LOCATION WITH FLOOR SLOPE. REFER TO ARCHITECTURAL DRAWINGS.

15.119 PROVIDE CAST IRON PIPE AND FITTINGS DOWNSTREAM OF HUB DRAIN TO POINT INDICATED BY KEYNOTE. BRANCH PIPING AND PIPING MATERIAL DOWNSTREAM OF POINT INDICATED BY KEYNOTE SHALL BE PER SPECIFICATIONS.

RETAIL DESIGN COLLABORATIVE
[illegible] Street
[illegible] 72802
[illegible]

STIPULATION FOR REVISED DRAWINGS

THIS DRAWING HAS BEEN PREPARED BY RETAIL DESIGN COLLABORATIVE, INC. ("RDC") IN CONNECTION WITH RDC'S PROFESSIONAL SERVICES TO WALMART STORES, INC. ("WALMART") PURSUANT TO WALMART'S SUPPLIER PORTAL AND ANY AGREEMENT BETWEEN RDC AND WALMART (COLLECTIVELY, "AGREEMENT"). THIS DRAWING IS PROVIDED FOR USE BY WALMART AND ITS AUTHORIZED CONTRACTORS, SUPPLIERS, AND VENDORS (COLLECTIVELY, "AUTHORIZED PARTIES") TO PRODUCE SUCH PRODUCTS, PROTOTYPES, OR PROJECTS AS MAY BE REQUIRED PURSUANT TO THE AGREEMENT.

CONSULTANTS

Daniel P. Kimball P.E.
SUITE 1205
[illegible] AT CHAMBERS, MCCLAIN-STITZ
ROGERS, AR 72756 DESIGNED BY: JOS

Walmart
LEESBURG, VIRGINIA
STORE NO: 1504
JOB NUMBER: 11080-05
100 SQ.-QL

ISSUE BLOCK
11/30/17 OTB

CHECKED BY:	DPK
DRAWN BY:	JOS
FILE NAME:	GP1
PROTO CYCLE:	04/28/17
DOCUMENT DATE:	09/13/17

BID SET
NOT FOR
CONSTRUCTION

FRONT
GROCERY
DWV PLAN

SHEET
GP1

Order Plans @ www.LDLine.com