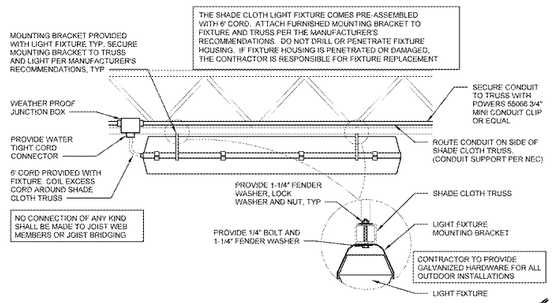

4 SHADE CLOTH LIGHTING
NTS 11.27.09 EL08

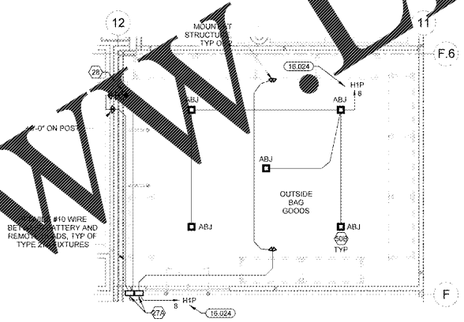

3 BAG GOODS LIGHTING PLAN
1/8" = 1'-0"

2 GARDEN CENTER POWER PLAN
1/8" = 1'-0"

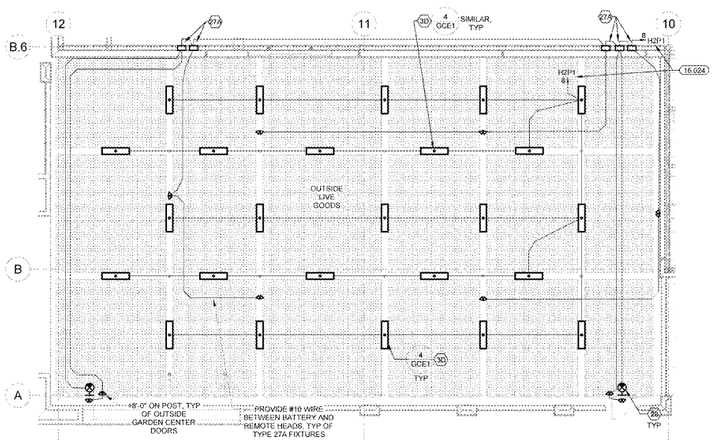

1 GARDEN CENTER LIGHTING PLAN
1/8" = 1'-0"

POWER DROP SCHEDULE

05.25.01 ES01

NO	DESCRIPTION
PD1	MOUNT RECEPTACLE(S) ON TOP OF DISPLAY UNIT(S)
PD2	MOUNT RECEPTACLE(S) ON BASE OF DISPLAY UNIT(S)
PD3	PROVIDE DIRECT CONNECTION TO EQUIPMENT
PD4	MOUNT RECEPTACLE AT BAR JOIST AND INSTALL FURNISHED CORD REEL

POWER DROP NOTES

1. APPROXIMATELY 45 DAYS PRIOR TO POSSESSION DATE, A REVISION OF THIS PLAN BASED ON THE FINAL MERCHANDISE LAYOUT WILL BE ISSUED TO SHOW FINAL LOCATIONS FOR THE POWER DROPS. IF MERCHANDISE PLAN DOES NOT CHANGE, THIS PLAN WILL BE REISSUED. PROVIDE CIRCUITRY TO DISPLAY RACKS AS THEY ARE SET. IN ADDITION, THE FOLLOWING POWER DROP NOTES APPLY:
   A. THERE SHALL BE NO ADDITIONAL CHARGE FOR DROP RELOCATIONS WITHIN POWER DROP ZONES DEFINED ON DRAWING.
   B. POWER DROPS FED FROM TRACK BUSWAY. INSTALL FURNISHED PLUG-IN UNIT AT A POINT ON RACK NEAREST POWER DROP(S).
   C. AT CLOSE OF PROJECT THE GENERAL CONTRACTOR AND CONSTRUCTION MANAGER WILL REVIEW ADDITIONAL OR DELETED POWER DROPS WITHIN EACH ZONE TO VERIFY ANY ADDITIONAL CHARGES OR CREDITS THAT APPLY DUE TO CHANGES.
   D. ADDING OR SUBTRACTING A POWER DROP TO ANY ZONE WILL RESULT IN A CHARGE OR CREDIT ACCORDING TO SPECIAL CONDITIONS.
2. PROVIDE JUNCTION BOX AND CIRCUITRY TO NEAREST JOIST ABOVE LOCATION SHOWN ON DRAWING. EXTEND CONDUIT AND CIRCUITRY FROM JUNCTION BOX TO ENDCAP OF DISPLAY RACK (AWAY FROM ACTION ALLEY).
3. PROVIDE CONDUIT AND RECEPTACLE(S) AT DISPLAY RACK SHELVING PER POWER DROP SCHEDULE UNLESS NOTED OTHERWISE ON DRAWING. VERIFY EXACT HEIGHT AND LOCATION OF RECEPTACLE(S) WITH STORE PLANNING SET-UP SUPERVISOR PRIOR TO INSTALLATION.

KEYNOTES

16.020	PROVIDE PORCELAIN KEYLESS FIXTURE AND 100W A-19 ROUGH SERVICE LAMP.
16.024	CONNECT CIRCUIT TO DUAL TAP CIRCUIT BREAKER INDICATED. CONNECT CIRCUIT CONTAINING NIGHT/EMERGENCY LIGHTING TO UNSWITCHED TERMINATION OF DUAL TAP CIRCUIT BREAKER.
16.225	ELECTRONIC ARTICLE SURVEILLANCE SYSTEM: MOUNT JUNCTION BOX AT TRUSS, EXTEND CIRCUIT AND TERMINATE TO RECEPTACLE IN EAS ENCLOSURE UPON INSTALLATION OF EAS SYSTEM. PROVIDE 6'-0" OF LIQUID-TIGHT FLEXIBLE METAL CONDUIT (WITH PULL WIRE) FROM EAS ENCLOSURE TO ADJACENT EAS PEDESTAL. PROVIDE 3/4" CONDUIT (WITH PULL WIRE) FROM ENCLOSURE, ROUTED UP TO TRUSS, OVER AND DOWN GATEPOST OPPOSITE FROM ENCLOSURE. WITH OVERALL LENGTH OF EACH CONDUIT NOT TO EXCEED 56'-0". PROVIDE 6'-0" OF LIQUID-TIGHT FLEXIBLE METAL CONDUIT AT EACH END OF CONDUIT. PROVIDE A 3/4" CONDUIT (WITH PULL WIRE) FROM ENCLOSURE TO SEASONAL SHOP ACCESSIBLE CEILING SPACE.
16.228	INSTALL RECEPTACLE IN PROVIDED DATA ENCLOSURE. COORDINATE LOCATION OF RECEPTACLE WITH ISD CABLE VENDOR. FINAL LOCATION TO BE DETERMINED BY CABLE AND TELECOM SERVICES.
16.230	PROVIDE NEMA 3R 12"x12"x6" HINGED, LOCKABLE, GASKETED JUNCTION BOX (HOFFMANN # A-1212CHNF OR EQUAL) MOUNTED 24" AFF. PROVIDE TWO SIMPLEX TWISTLOCK RECEPTACLES AND VOICE/DATA JUNCTION BOX INSIDE ENCLOSURE. PROVIDE FEED THRU GFI DEVICE (LEVITON #6499-I) AHEAD OF EACH RECEPTACLE.
16.232	AUTOMATIC DOOR OPERATOR: VERIFY LOCATION WITH MANUFACTURER'S RECOMMENDATIONS PRIOR TO INSTALLATION. ALL CONDUIT AND WIRING SHALL BE CONCEALED AT MAIN ENTRANCE DOORS.
16.243	INSTALL MANUFACTURER FURNISHED JUNCTION BOX ABOVE DOOR HEADER FOR SEGURITY CABLING. PROVIDE 1" CONDUIT (WITH PULL WIRE) FROM JUNCTION BOX TO STRUCTURE, TERMINATE AT BAR JOIST WITH BUSHING. COORDINATE INSTALLATION WITH MANUFACTURER'S REQUIREMENTS.
16.431	PORTABLE CHECKOUTS: PROVIDE NEMA 3R JUNCTION BOX ON BOTTOM OF TRUSS. INSTALL FURNISHED WEATHERPROOF PIG TAIL CONNECTORS.
16.650	CONDUIT SLEEVE: PROVIDE 1-1/2" CONDUIT SLEEVE WITH BUSHINGS ABOVE BAR JOIST (UNLESS NOTED OTHERWISE).
16.658	CONDUIT SLEEVE: PROVIDE 2" CONDUIT (WITH PULL WIRE) FROM BAR JOIST TO PROVIDED DATA ENCLOSURE AND TERMINATE WITH COUPLER AND THREADED BUSHINGS. COORDINATE FINAL LOCATION WITH CABLE AND TELECOM SERVICES PRIOR TO INSTALLATION.

RETAIL DESIGN COLLABORATIVE
[illegible] Drive #210
[illegible] 70
(303) 449-[illegible]
[illegible]collaborative.com

STIPULATION FOR REUSE

THESE DRAWINGS WERE SPECIFICALLY PREPARED FOR THE USE OF THE OWNER NAMED HEREON AND THE SITE LISTED THEREIN. THEY ARE NOT SUITABLE FOR USE BY ANY OTHER OWNER OR ON ANY OTHER SITE. ANY REUSE OF THESE DRAWINGS, WHETHER IN WHOLE OR IN PART, WITHOUT THE EXPRESS WRITTEN CONSENT OF RETAIL DESIGN COLLABORATIVE, LTD. IS PROHIBITED AND WILL BE AT THE USER'S SOLE RISK AND WITHOUT LIABILITY TO RETAIL DESIGN COLLABORATIVE, LTD. ©RDC 2009.

CONSULTANTS

Randall C. Hanna P.E.
[illegible] Suite 1000 [illegible] 303-247-0373
[illegible] Rd. [illegible] 303-247-0374
ROCKING, AR 72756 DESIGNED BY: GAR

Walmart
LEESBURG, VIRGINIA
STORE NO: 1904
11/30/17 PROTO
JOB NUMBER: 189 SQ/LOC

ISSUE BLOCK
11/30/17 OTB

CHECKED BY: SAG
DRAWN BY: GAR
FILE NAME: GCE1
PROTO CYCLE: 04/28/17
DOCUMENT DATE: 09/13/17

BID SET
NOT FOR CONSTRUCTION

GARDEN CENTER ELECTRICAL PLANS AND DETAILS

SHEET:
GCE1

Order Plans @ WWW.LDILine.com