


DESIGN LOADS	
1. BUILDING CODE	2012 VIRGINIA UNIFORM STATEWIDE BUILDING CODE (2012 IBC)
A. BUILDING CODE	
2. GRAVITY LOADS	
A. REFER TO MANUFACTURER'S RATED LOADS.	
3. LATERAL LOADS	
A. SEISMIC LOADS	
1. 5% DAMPED SPECTRAL RESPONSE COEFF (S _{RS})	0.132 g
2. 1 SEC PERIOD SPECTRAL RESPONSE COEFF (S _{1T})	0.083 g
3. SEISMIC DESIGN CATEGORY	B
4. SEISMIC SITE CLASS	D
5. NON-BUILDING STRUCTURAL SYSTEM AND SEISMIC RESISTING SYSTEM	STEEL STORAGE RACKS
6. RESPONSE MODIFICATION FACTOR (R)	4.0
7. OVERSTRENGTH FACTOR (O _s)	2.0
8. IMPORTANCE FACTOR (I _e)	
9. SALES FLOOR & GARDEN CENTER AREAS STORAGE AREA	1.5 (PUBLIC ACCESS AREA)
10. ANALYSIS PROCEDURE	EQUIVALENT LATERAL FORCE
11. DESIGN BASE SHEAR (PER RM 2.6.2)	0.050W (PUBLIC ACCESS AREA)
12. SALES FLOOR & GARDEN CENTER FIXTURES STORAGE AREA RACKS	0.039W (NO PUBLIC ACCESS)
B. WIND LOADS (PER ASCE 7-10)	
1. BASIC WIND SPEED (3 SECOND GUST)	120 MPH
2. RISK CATEGORY	III
3. EXPOSURE CATEGORY	B

GENERAL NOTES	
1.0 GENERAL	
1.1 ALL FIXTURES SHALL BE DESIGNED TO MEET ALL BUILDING CODE REQUIREMENTS INCLUDING SECTION 2209.1 OF THE 2012 IBC.	
1.2 JOHNSTON BURKHOLDER ASSOCIATES HAS DESIGNED THE BASE ANCHORAGE, MEMBERS AND CONNECTIONS FOR THE FIXTURES SHOWN ON THIS INSTALLATION DRAWING TO RESIST DESIGN WIND/SEISMIC LATERAL FORCES FOR THE BUILDING CODES NOTED IN THE "DESIGN LOADS" TABLE ON THIS SHEET. INSTALLATION OF THE FIXTURES SHALL MEET THE LAYOUT SHOWN ON THE FIXTURE LAYOUT PLAN, PROVIDED BY OWNER.	
2.0 SLAB AND FOUNDATION	
2.1 SLAB ON GRADE TO HAVE A MINIMUM OF 3,500 PSI COMPRESSIVE STRENGTH.	
2.2 THE SLAB ON GRADE TO BE A MINIMUM OF 4 INCHES THICK (5 1/2 INCHES THICK MINIMUM AT THE EXTERIOR GARDEN CENTER AND STORAGE AREAS). UNREINFORCED AND PLACED OVER A MINIMUM OF 4 INCHES OF DRAINAGE FILL.	
2.3 THE SLAB ON GRADE IS DESIGNED TO BEAR ON A NET SOIL BEARING CAPACITY OF 1500 PSF MINIMUM.	
3.0 MATERIAL FOR RACKS AND ANCHORAGE	
3.1 ALL ANCHORS TO THE SLAB SHALL BE AS NOTED ON THESE PLANS.	
3.2 OWNER IS TO PROVIDE MAINTENANCE PER RM 1.4.1.	
3.3 RACK INSTALLER SHALL OBTAIN OUT-OF-PLUMB INSTALLATION TOLERANCE FROM FIXTURE SUPPLIER PRIOR TO INSTALLATION PER RM SECTION 1.4.1.1.	
3.4 NO FIELD WELDING IS PERMITTED. ALL WELDING SHALL BE PERFORMED BY CERTIFIED WELDERS, IN AN APPROVED SHOP. USE E70X WELD RODS OR EQUAL TO TENSILE STRENGTH OF BASE METAL OF WELDMENTS. PER AWS D1.1 OR D1.3.	
3.5 PROVIDE 6" AT 120" TALL RACKS AND 4 1/2" AT RACKS LESS THAN 120" (OR EQUAL TO 5% OF THE UPRIGHT FRAME HEIGHT) MINIMUM CLEARANCE BETWEEN OTHER RACK FIXTURES OR ADJACENT BUILDING ELEMENTS PER ASCE 7-10, SECTION 15.5.3.3.	

SPECIAL INSPECTIONS REQUIRED	
SPECIAL INSPECTION AS REQUIRED BY SECTION 1704 OF THE 2012 INTERNATIONAL BUILDING CODE OR BY THE ENGINEER OF RECORD:	
PERIODIC SPECIAL INSPECTIONS:	
1. POST INSTALLED ANCHORS - USED FOR THE ANCHORAGE OF EXTERIOR GARDEN CENTER RACK FIXTURES PER SECTION 1706.3, TABLE 1706.3(A) AND 1706.11.7 OF THE 2012 INTERNATIONAL BUILDING CODE FOR EACH CONCRETE EXPANSION ANCHOR LISTED IN THE "ANCHOR BOLT DETAIL" ON SHEET FXS2.	
NOTES: 1. SPECIAL INSPECTIONS NOTED ABOVE SHALL BE PROVIDED BY, BUT NOT LIMITED TO, THE OWNER'S CONSTRUCTION TESTING LABORATORY (CTL). REFERENCE SPECIFICATIONS FOR DETAILS.	

ANCHORAGE BILL OF MATERIALS		
USAGE	MATERIAL TYPE	COUNT
ANCHOR	DEWALT SCREW BOLT - 1/2" DIAMETER x 3" (#9) (M1411380)	515
ANCHOR	DEWALT SCREW BOLT - 3/8" DIAMETER x 1 1/2" (#9) (M1411230)	815
ANCHOR	HEX W/KNUT BOLT 1/2" (S5304) - 5/8" DIAMETER x 6 1/2" (#00387630)	245
STRAP	ANCHOR STRAPS (GONDOLA)	464
WALL ANCHOR	CMU - 3/8" DIA x 5' ITW RED HEAD LARGE DIAMETER TAPCON (MLDT3850)	104
WALL ANCHOR	MTL STUD WALLS - 1/4" DIA x 6" LAG SCREWS	101
NOTES: 1. ANCHOR BOLTS AND STRAPS AS NOTED ARE FURNISHED BY AND INSTALLED BY THE GENERAL CONTRACTOR (GC). 2. ANCHOR STRAP SUPPLIER CONTACT INFORMATION: LOZIER: JOSH GOEDKEN, jgoedken@lozier.biz, (402) 457-8379 MADIX: CHERI BAGLEY, cbagley@madix.com, (256) 839-0364		

SHELVING FIXTURE & ANCHORAGE SCHEDULE			
FIXTURE MARK	FIXTURE DESCRIPTION	FIXTURE HEIGHT	ANCHORAGE DETAIL
9-3RX	PHARMACY FULL T-FRAME	54"	1A-FXS2
15S	HALF GONDOLA	64"	1B-FXS2
18-3RX	PHARMACY FULL T-FRAME	84"	1B-FXS2
18R	HALF GONDOLA	45"	1A-FXS2
18S	HALF GONDOLA	54"	1A-FXS2
18W	HALF GONDOLA	78"	1A-FXS2
18W	HALF GONDOLA	64"	1A-FXS2
18X	HALF GONDOLA	90"	1A-FXS2
24T	HALF GONDOLA	45"	1A-FXS2
24V	HALF GONDOLA	78"	1A-FXS2
24K	HALF GONDOLA	90"	1A-FXS2
24XSD	SUPER DUTY HALF GONDOLA	90"	1D-FXS2
24YV	HALF GONDOLA	120"	1A-FXS2
2478 EC	END CAP	78"	1C-FXS2
2490 EC	END CAP	90"	1C-FXS2
3648 EC	END CAP	48"	1C-FXS2
3678 EC	END CAP	78"	1C-FXS2
4878 EC	END CAP	78"	1C-FXS2

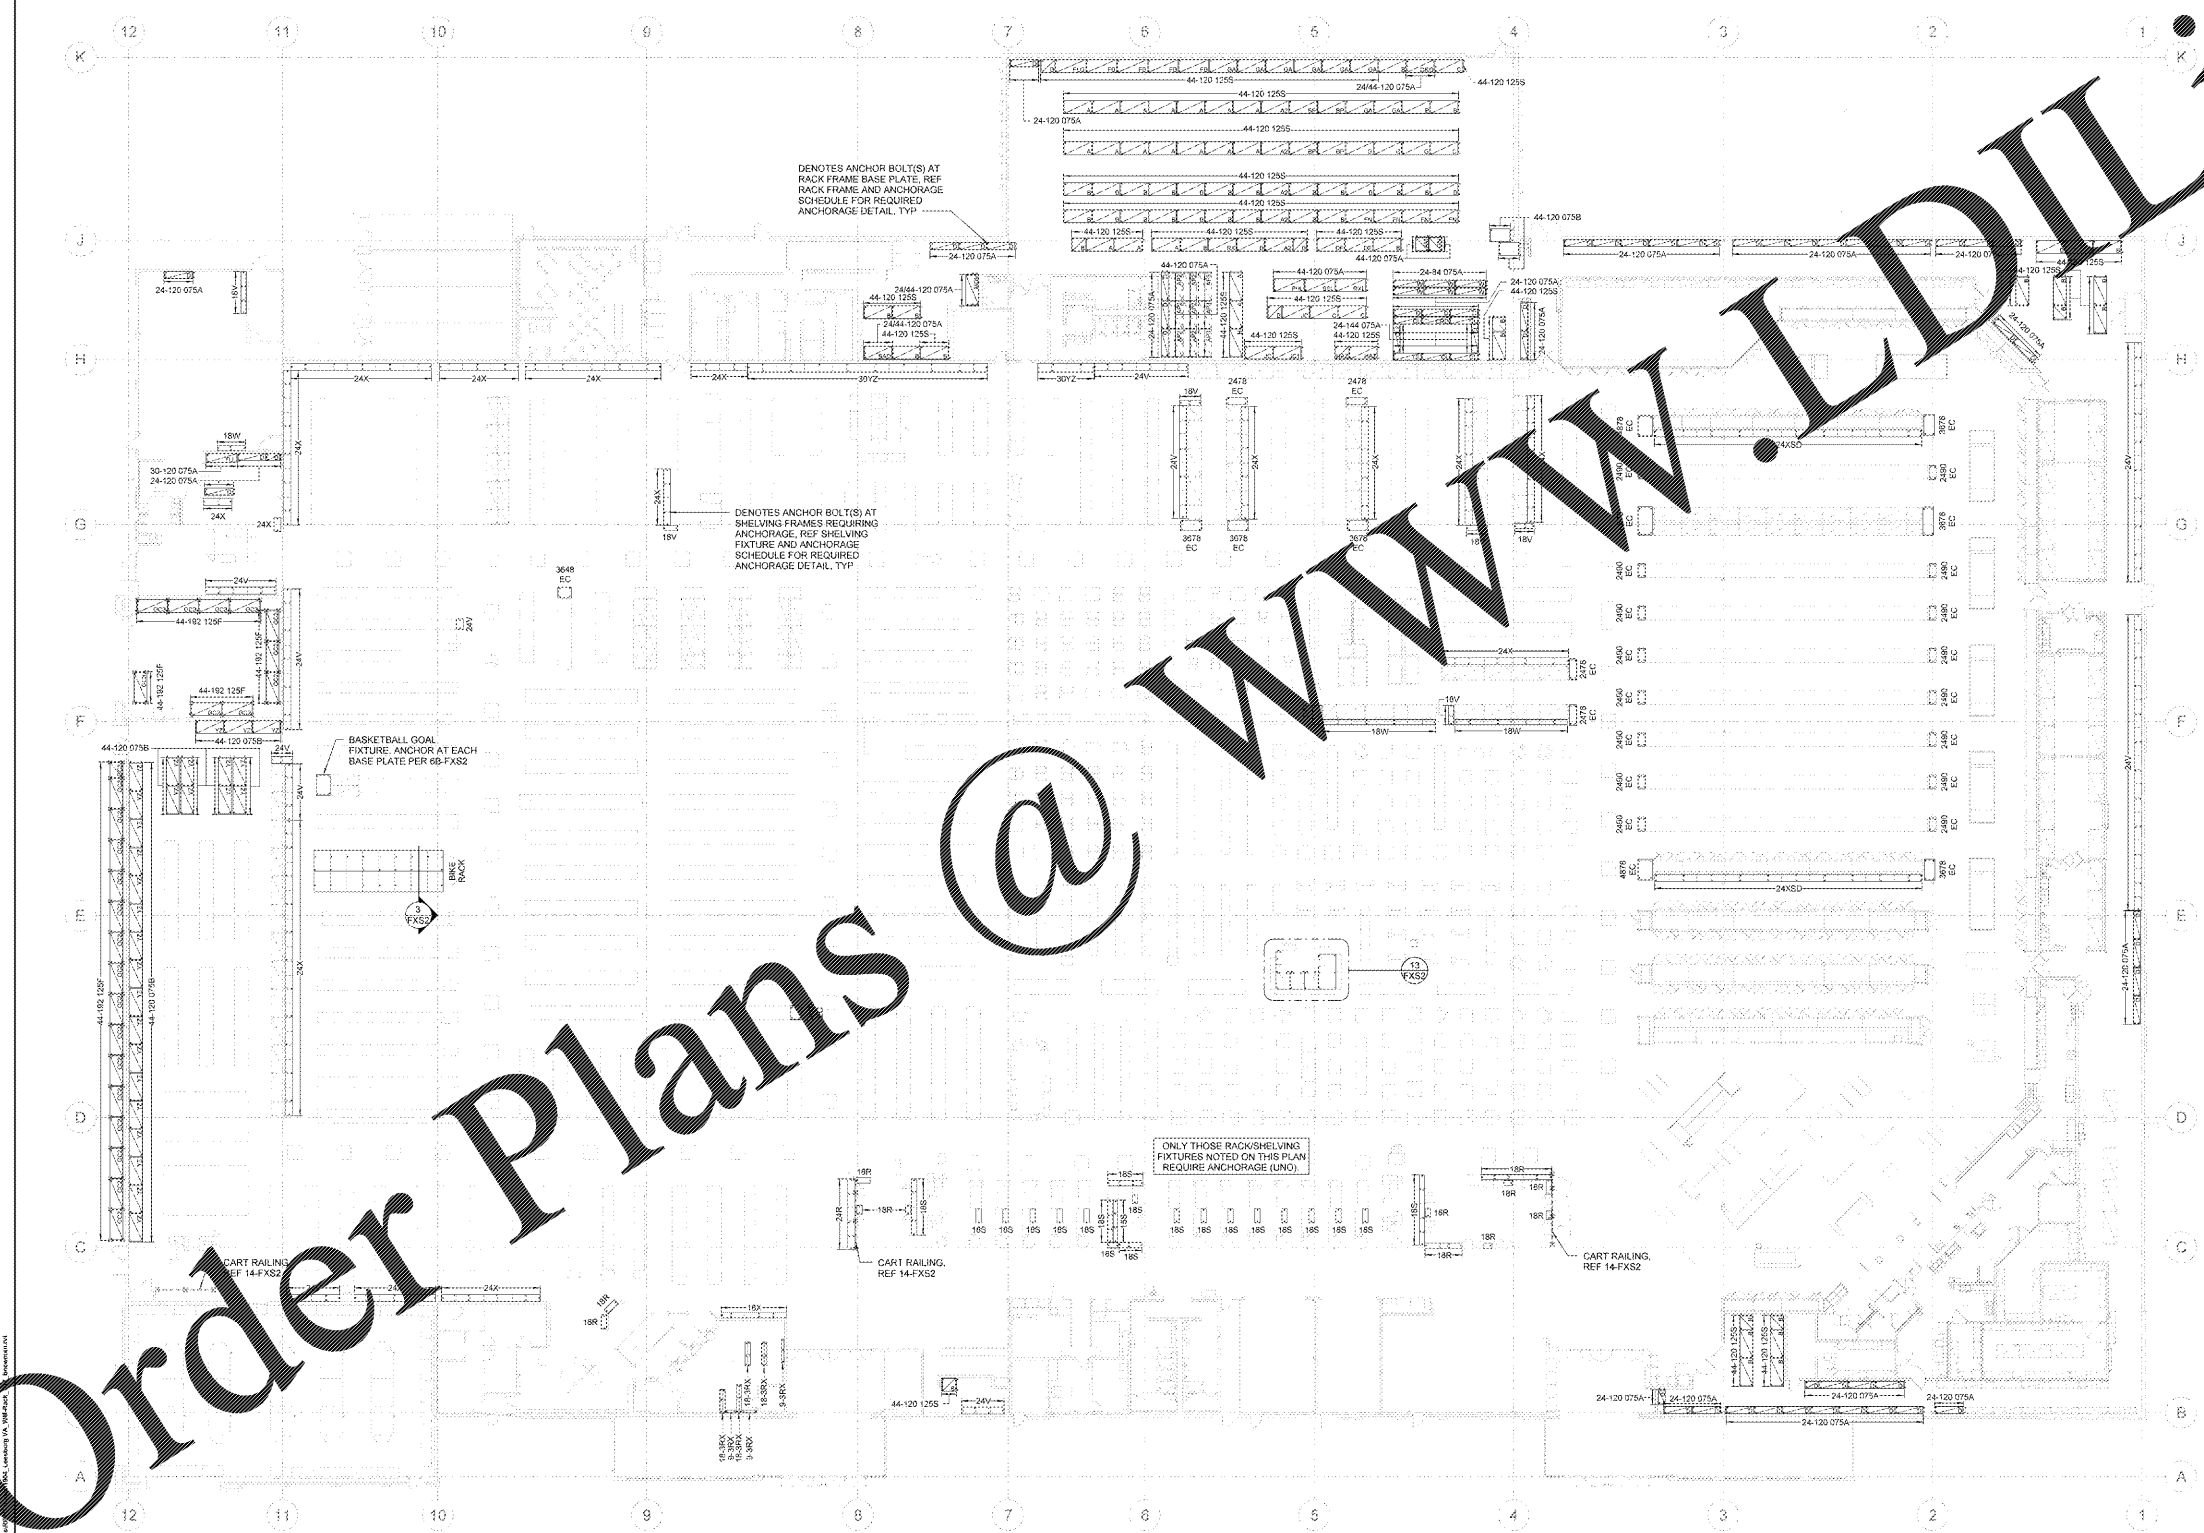


Order Plans @

1 RACK AND SHELVING FIXTURE ANCHOR PLAN
1" = 20'-0"

RACK FIXTURE SCHEDULE				
FIXTURE MARK	FIXTURE DESCRIPTION	TOP SHELF HEIGHT	FRAME MARK	MAX SHELF LOAD (LBS)
A2	STORAGE RACK	120"	FRAME: 44-120 125S	5000
AM	LOCKABLE STORAGE RACK	120"	FRAME: 44-120 075A	2500
AP2	MOBILE STORAGE RACK	120"	FRAME: 44-120 075A	2500
AP3	MOBILE STORAGE RACK	120"	FRAME: 44-120 125S	2500
B	STORAGE RACK	120"	FRAME: 44-120 125S	5000
BAD	DESK STORAGE RACK	120"	DESK: 2444-120 075A	1200
BP	STORAGE RACK	120"	FRAME: 44-120 125S	5000
C	STORAGE RACK	120"	FRAME: 44-120 125S	5000
CL	STORAGE RACK	120"	FRAME: 24-144 075A	1200
CL2	STORAGE RACK	120"	FRAME: 24-144 075A	1200
CRD	STORAGE RACK	120"	FRAME: 24-144 075A	1200
D	STORAGE RACK	120"	FRAME: 44-120 075A	1200
DF	STORAGE RACK	120"	FRAME: 44-120 125S	5000
DRD	DESK STORAGE RACK	120"	DESK: 2444-120 075A	1200
FB	STORAGE RACK	120"	FRAME: 44-120 125S	1200
FLG	STORAGE RACK	120"	FRAME: 44-120 125S	1200
FN	STORAGE RACK	120"	FRAME: 44-120 125S	2500
G	STORAGE RACK	120"	FRAME: 44-120 125S	5000
GA	STORAGE RACK	120"	FRAME: 44-120 125S	5000
GC2	GARDEN CENTER RACK	144"	GC FRAME: 44-192 125F	5000
GC3	GARDEN CENTER RACK	144"	GC FRAME: 44-192 125F	5000
GN	LOCKABLE STORAGE RACK	120"	FRAME: 44-120 075A	2500
HAZ	STORAGE RACK	120"	FRAME: 44-120 125S	1200
JC	STORAGE RACK	120"	FRAME: 44-120 125S	2500
JC1	STORAGE RACK	120"	FRAME: 44-120 125S	2500
M09	DESK STORAGE RACK	120"	DESK: 2444-120 075A	1200
PH	LOCKABLE STORAGE RACK	120"	FRAME: 44-120 075A	2500
RK	STORAGE RACK	120"	FRAME: 44-120 125S	2500
RXL	LOCKABLE STORAGE RACK	120"	FRAME: 44-120 075A	2500
SBL	LOCKABLE STORAGE RACK	120"	FRAME: 44-120 075A	2500
TLL	LOCKABLE STORAGE RACK	120"	FRAME: 30-120 075A	1200
W	STORAGE RACK	84"	FRAME: 24-84 075A	1200
Y2	SALES FLOOR RACK	120"	FRAME: 44-120 075B	1200

RACK FRAME & ANCHORAGE SCHEDULE		
FRAME MARK	ANCHOR DETAIL	FRAME COUNT
24-84 075A	2-FXS2 & 6A-FXS2	8
24-120 075A	2-FXS2 & 6A-FXS2	71
24-144 075A	2-FXS2 & 6A-FXS2	13
2444-120 075A	2-FXS2 & 6A-FXS2	6
30-120 075A	2-FXS2 & 6A-FXS2	2
44-120 075A	2-FXS2 & 6A-FXS2	20
44-120 075B	2-FXS2 & 6A-FXS2	26
44-120 125S	2-FXS2 & 6A-FXS2	134
44-192 125F	2-FXS2 & 11-FXS2	31

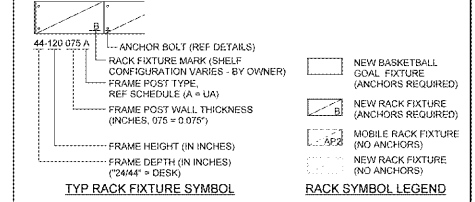

STIPULATION FOR THE USE OF THIS DRAWING: THIS DRAWING IS THE PROPERTY OF JOHNSTON BURKHOLDER ASSOCIATES, INC. (JBA). IT IS TO BE USED ONLY FOR THE PROJECT AND SITE SPECIFICALLY IDENTIFIED HEREON. IT IS NOT TO BE REPRODUCED, COPIED, OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF JBA.



Walmart
LEESBURG, VIRGINIA
STORE NO. 1904-05
JOB NUMBER: 1905026
ISSUE BLOCK
DTB 11/30/17

CHECKED BY:	DGH
DRAWN BY:	BVN
PROTO CYCLE:	0428/17
DOCUMENT DATE:	08/13/17
JBA PROJECT NO:	96601904R

BID SET
NOT FOR
CONSTRUCTION

RACK
ANCHORAGE
PLAN AND
NOTES

SHEET:
FXS1