
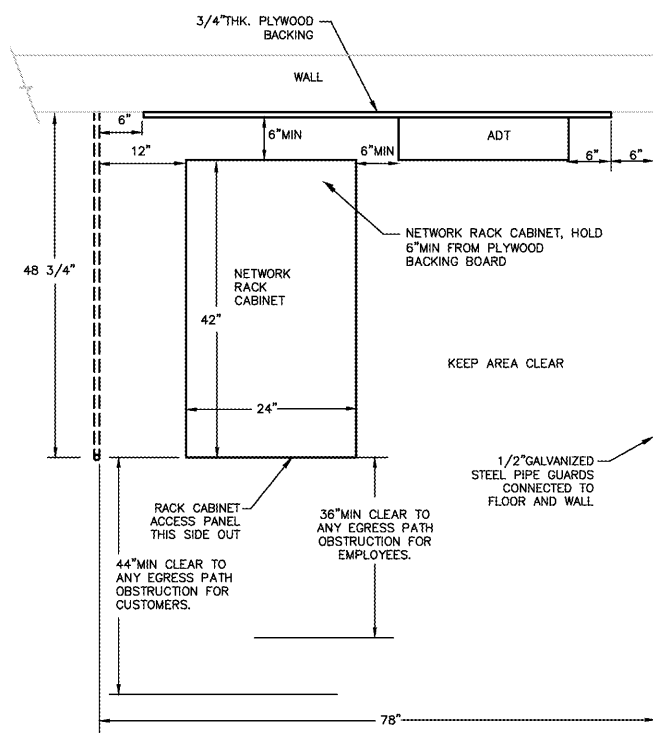


MANAGER'S DESK CODED NOTES

- 100 INSTALL (3) SINGLE GANG JUNCTION BOXES AND RUN 3/4" CONDUIT EACH WITH PULL WIRE BACK TO NETWORK BOARD LOCATION. PROVIDE LABEL FOR EACH BOX: (1) PHONE, (1) PRINTER, (1) WORKSTATION.
- 101 2'x2' CCTV BACKBOARD.
- 102 NOT USED.
- 103 DUPLEX CONVENIENCE RECEPTACLE FOR GENERAL USE POWER. LABEL "CONVENIENCE" AND CIRCUIT AS INDICATED.
- 104 CONVENIENCE RECEPTACLE FOR GENERAL USE POWER. INSTALL IN 4" SQ X 2-1/8" DEEP BOX WITH TWO GANG 1/2" PLASTER RING COVER. LABEL "CONVENIENCE" AND CIRCUIT AS INDICATED.
- 200 ISOLATED GROUND RECEPTACLES FOR CCTV EQUIPMENT. INSTALL IN 4" SQ X 2-1/8" DEEP BOX WITH TWO GANG 1/2" PLASTER RING COVER. LABEL "CCTV" AND CIRCUIT AS INDICATED ON POWER PLAN AND PANEL SCHEDULE.
- 201 4-PLEX DATA JACK. INSTALL 4-11/16" SQ X 2-1/8" DEEP BOX WITH SINGLE GANG 1/2" PLASTER RING COVER. EXTEND CONDUIT FROM NETWORK RACK TO CPU CABINET.
- 202 NUTONE BUZZER UNIT AND TRANSFORMER ON WALL.
- 203 12" X 12" X 6" J-BOX TO RECEIVE CONDUIT FROM SURVEILLANCE CAMERAS.
- 204 (1) 2" CONDUIT LINE RUN TO A RECESSED J-BOX 6"X6"X4"D. LOCATED ABOVE WORK SURFACE. PROVIDE PULL WIRE BETWEEN J-BOXES.
- 205 RECEPTACLE FOR CAMERA EQUIPMENT ABOVE MANAGERS ROOM. LOCATE 4"X4"X2-1/8" DEEP BOX WITH 1/2" PLASTER RING COVER ABOVE OR JUST OUTSIDE THE MANAGERS ROOM USING STOCK ROOM AREA AROUND 12' AFF. LABEL "CCTV" AND CIRCUIT TO SINGLE DEDICATED CIRCUIT AS INDICATED.
- 206 NOT USED.
- 207 INSTALL DUPLEX RECEPTACLE FOR SOUND SYSTEM. NEXT TO THE DUPLEX RECEPTACLE. INSTALL (1) SINGLE GANG AND (1) 2-GANG J-BOX WITH 3/4" CONDUIT RIPPED 6" ABOVE CEILING FOR WIRES. REFER TO POWER PLAN AND SOUND SYSTEM DETAIL FOR ADDITIONAL INFORMATION.
- 208 J-BOX VOLUME CONTROL. REFER TO POWER PLAN AND SOUND SYSTEM DETAIL FOR ADDITIONAL INFORMATION.
- 209 RUN CONDUIT FROM ADT PANEL TO 2"X4" X 1-1/2" D J-BOX WITH SINGLE GANG MUD RING NEAR SAFE FOR HOLD UP BUTTON.
- 210 QUADRAPLEX RECEPTACLES FOR BATTERY CHARGERS.
- 211 2" X 4" J-BOX FOR THERMOSTAT FOR HVAC EQUIPMENT. INSTALL J-BOX IN THE HORIZONTAL POSITION. ENSURE APPROXIMATELY 10" HORIZONTAL BETWEEN J-BOXES CENTER TO CENTER. INSTALL 1/2" CONDUIT WITH BUSHINGS AND PULLWIRE TO ABOVE CEILING FOR CONTROL WIRING. COORDINATE LOCATION WITH G.C. PRIOR TO ROUGH-IN. VERIFY EXACT QUANTITY AND REQUIREMENTS WITH MECHANICAL DRAWINGS PRIOR TO ROUGH-IN.
- 212 2"X4" J-BOX FOR SENSOR AND TWIST TIMER FOR HVAC EQUIPMENT. INSTALL 1/2" CONDUIT WITH BUSHINGS AND PULLWIRE TO ABOVE CEILING FOR CONTROL WIRING. COORDINATE LOCATION WITH G.C. PRIOR TO ROUGH-IN. VERIFY EXACT QUANTITY AND REQUIREMENTS WITH MECHANICAL DRAWINGS PRIOR TO ROUGH-IN.
- 213 2"X4" J-BOX FOR MOTION SENSOR. COORDINATE LOCATION WITH G.C. PRIOR TO ROUGH-IN. VERIFY EXACT REQUIREMENTS PRIOR TO ROUGH-IN.

MANAGER'S DESK GENERAL NOTES

1. REFER TO CONDUIT RISER DIAGRAM FOR EMPTY CONDUIT SIZES.
2. FINAL CONNECTIONS, HUBS AND WIRING FOR POS AND TELEPHONE SYSTEM ARE PROVIDED AND INSTALLED BY SPENCER ENGINEERING AND ADT TECHNOLOGY, RESPECTIVELY.
3. FINAL CONNECTIONS AND WIRING FOR MUSIC SYSTEM ARE PROVIDED AND INSTALLED BY PLAY NETWORK.
4. ALL J-BOXES TO BE RECESSED UNLESS NOTED OTHERWISE.
5. ALL COVERS FOR JUNCTION BOXES AND RECEPTACLE ABOVE THE WORK SHALL BE FLUSH WITH THE CORK FINISH. PROVIDE EXTENSION RINGS AS REQUIRED.
6. REFER TO ARCHITECTURAL ELEVATIONS FOR MOUNTING HEIGHTS.
7. REFER TO ARCH PLANS FOR DIMENSIONS OF ALL COMPONENTS.

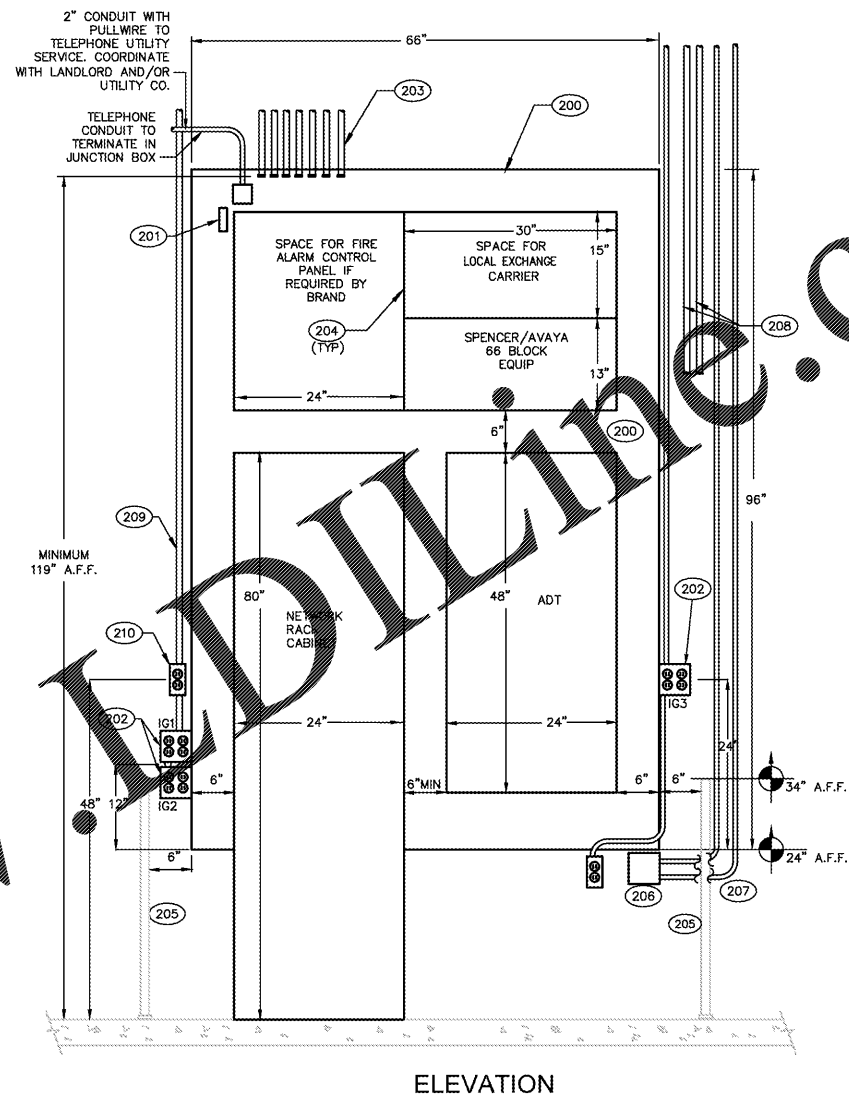

NETWORK RACK DETAIL NOTES:

- 200 3/4" THICK PLYWOOD TELEPHONE BOARD. SIZE AS INDICATED.
- 201 PHONE SYSTEM GROUND. DEDICATED ISOLATED #12 AWG SOLID COPPER GROUNDING WIRE OF LENGTH NOT TO EXCEED 35 FEET TO A "GE POWERMARK GOLD" EQUIPMENT GROUND BUS BAR CATALOG NUMBER TGK12 OR EQUAL. IF WIRE EXCEEDS 35 FEET, PROVIDE #10 AWG SOLID COPPER GROUNDING WIRE WITH REDUCING CLIP AT BUS BAR.
- 202 DEDICATED QUADRAPLEX RECEPTACLE CIRCUITED WITH AN ISOLATED GROUND. REFER TO POWER PLAN FOR CIRCUIT NUMBER.
- 203 CONDUIT WITH PULL WIRE. REFER TO CONDUIT RISER DIAGRAM FOR QUANTITIES AND SIZES. TERMINATE CONDUIT NO LOWER THAN 119" A.F.F. TO ALLOW PROPER MOUNTING HEIGHT OF NETWORK RACK.
- 204 IDENTIFY BOUNDARY LINES AND SPACE USE WITH PAINT OR PERMANENT MARKER AS INDICATED.
- 205 1/2" THREADED GALVANIZED STEEL PIPE CONNECTED TO FLOOR AND WALL MOUNTED ESCUTCHEONS. SEE ARCHITECTURAL PLANS.
- 206 4" X 4" X 1/2" JUNCTION BOX FOR MUSIC.
- 207 (2) 3/4" CONDUITS FOR SPEAKER WIRE AND ADDITIONAL MUSIC EQUIPMENT.
- 208 (2) 3/4" CONDUIT TO ADT DEVICES.
- 209 3/4" CONDUIT FOR DEDICATED AND ISOLATED GROUND RECEPTACLE LOCATED ON BACK BOARD. INSTALL PER N.E.C. REQUIREMENTS.
- 210 NEMA 5-20R DUPLEX RECEPTACLE FOR OWNER FURNISHED UPS FOR FLOOR MOUNTED IT CABINET DIMENSIONS 42" DEEP X 80" HIGH X 24" WIDE.

REMODEL STORE

OLD NAVY

CAPAC, INC.
 STORE DEVELOPMENT
 FOLSOM STREET
 SAN FRANCISCO, CA 94105

REPS. I.D.: 00000131847

STORE NUMBER: 5724

STORE LOCATION:
BUCKHEAD STATION
 1 BUCKHEAD LOOP NE
 ATLANTA, GA 30326

DESIGN TYPE: P3
 GENERATION: 18012
 PROTOTYPE DATE: 08/31/17
 OPENING: 2018

CONSULTANT INFO:

M-Engineering
 750 Brookside Blvd.
 Westerville, Ohio 43081
 phone: 614-899-4039
 fax: 614-899-2222
 www.mengineering.us.com

PROFESSIONAL STAMP:

ARCHITECT INFO:

brr

ARCHITECT OF RECORD:
 BOYD W. BAU
 6700 ANTIPOCH PLAZA
 SUITE 300
 MEMPHIS, TN 38124
 www.brrarch.com
 TEL: 913-263-9095
 FAX: 913-262-9044

ISSUE TYPE:

BID/PERMIT 01/05/18

REVISIONS:

DRAWN BY: AMH
 A/E JOB NUMBER: 65013029/1742070

TITLE SHEET:
ELECTRICAL DETAILS

SHEET NUMBER:
E9-4