

KEYED NOTES

- SECONDARY CONDUITS FROM UTILITY TRANSFORMER BUILDING SERVICE ENTRANCE. VERIFY EXACT REQUIREMENTS WITH LOCAL UTILITY COMPANY PRIOR TO INSTALLATION.
- METER ON BUILDING EXTERIOR PER LOCAL UTILITY COMPANY REQUIREMENTS.
- SEE POLE BASE DETAIL ON CIVIL SITE PLAN SHEET FOR ADDITIONAL INFORMATION.
- ONE 4" UNDERGROUND PVC CONDUIT WITH PULL STRING PER TELEPHONE UTILITY COMPANY'S SPECIFICATIONS AND REQUIREMENTS FOR TELEPHONE SERVICE. COORDINATE EXACT ROUTING AND STUB-UP LOCATION WITH THE TELEPHONE UTILITY COMPANY AND CLEARLY MARK STUB-UP LOCATION. STUB-UP LOCATIONS INDICATED ARE BASED ON INFORMATION THAT WAS AVAILABLE DURING DESIGN. SUBMIT A LINEAL FOOT UNIT PRICE WITH THE BID FOR ADDITIONAL CONDUIT, OF EACH SIZE AND TYPE INDICATED, IN THE EVENT THE LOCAL UTILITY COMPANY DIRECTED STUB-UP LOCATION DIFFERS FROM WHAT IS INDICATED.
- VERIFY EXACT LOCATION WITH OWNER PER MONUMENT SIGN. PROVIDE WEATHERPROOF JUNCTION BOX AND 20A TOGGLE SWITCH 18" FROM MAINTENANCE DISCONNECT SWITCH FOR 18" I.D. SIGN.
- GFCI TYPE WEATHERPROOF RECEPTACLE MOUNTED ON MAIN SIGN SUPPORT +14" AFG. THIS RECEPTACLE SHALL NOT BE SWITCHED (BYPASS THE CONTACTOR AND SIGN'S DISCONNECT SWITCH).
- CONNECTION TO AIR/VAC. COORDINATE ALL ELECTRICAL REQUIREMENTS WITH EQUIPMENT INSTALLER.
REFER TO DETAILS ON FUELING PLANS FOR PANEL "F" CONDUIT ROUTING FUELING PANEL EQUIPMENT, CONDUIT, AND WIRE TO BE PROVIDED AND INSTALLED BY ELEVEN.
- ELECTRICAL CONTRACTOR TO COORDINATE ALL FUEL REQUIREMENTS WITH FUEL G.C. THE ELECTRICAL CONTRACTOR WILL PROVIDE ALL NECESSARY CONDUITS, SEAL-OFFS, TROUGHS, AND RACEWAYS FROM THE ELECTRICAL ROOM OR PANEL AREA TO THE EXTERIOR OF THE BUILDING, BUT NOT TO EXCEED 10 FEET FROM THE EXTERIOR BUILDING EDGE. ALL OTHER EQUIPMENT, WIRE, LABOR FOR THE COMPLETION OF THE FUEL SYSTEM TO BE PROVIDED BY THE FUELING G.C.
- ALL ITEMS ASSOCIATED WITH THE FUELING CANOPY ARE PART OF A SEPARATE PERMIT AND SHOWN FOR INFORMATION ONLY. REFER TO FUELING SHEETS FOR FUELING CANOPY SPECIFICATIONS.
- RECEPTACLE FOR IRRIGATION CONTROL. COORDINATE EXACT LOCATION WITH EQUIPMENT INSTALLER.
- CONNECTION TO LIFT STATION CONTROL PANEL. COORDINATE ALL ELECTRICAL REQUIREMENTS WITH EQUIPMENT INSTALLER PRIOR TO ROUGH-IN.

SEAL:

NO.	DATE	REVISIONS
1	05.21.17	PEER REVIEW COMMENTS
		REMARKS



BID SET
JANUARY 8, 2018


7-ELEVEN
STORE #32810

5544 RONALD REAGAN PARKWAY
DAVENPORT, FL
33896

PROJECT NO: 2016.0305
DATE: MAY 31, 2017

E0.1
ELECTRICAL SITE PLAN


CHECKED: SN DRAWN: VLD

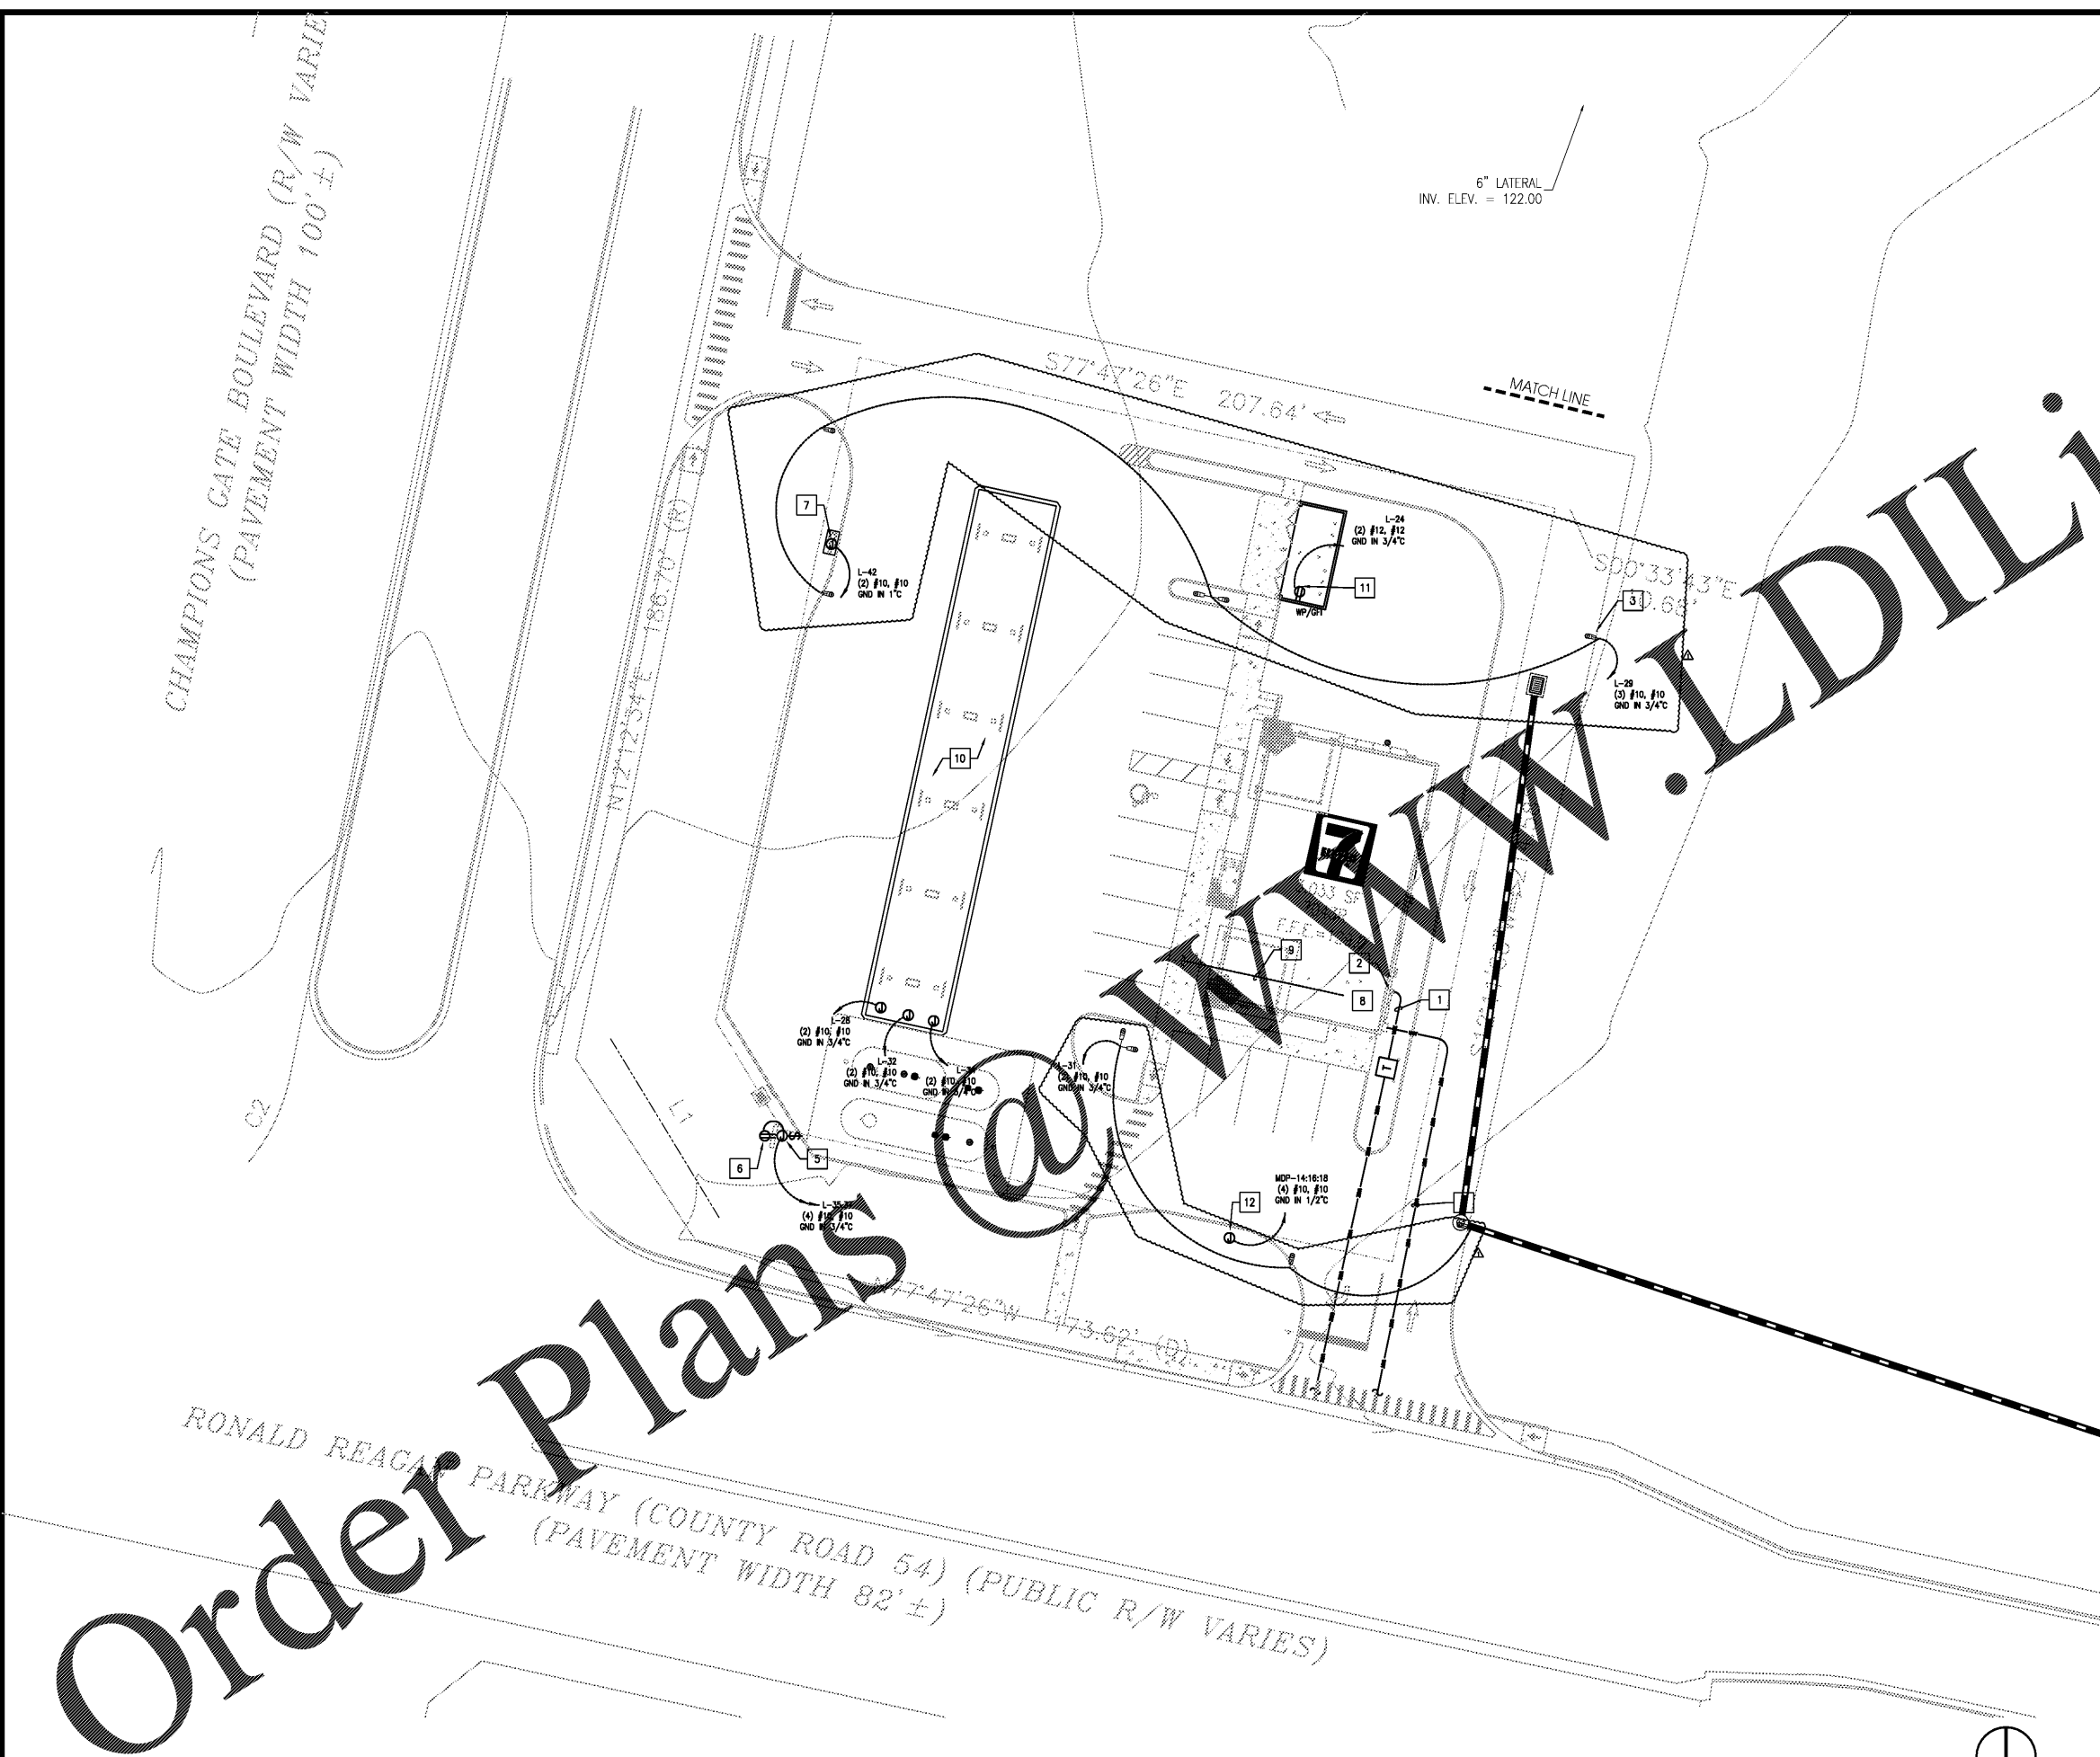

Order Plans

ELECTRICAL SITE PLAN

1" = 20'



CHAMPIONS GATE BOULEVARD (R/W VARIES)
(PAVEMENT WIDTH 100' ±)

RONALD REAGAN PARKWAY (COUNTY ROAD 54) (PUBLIC R/W VARIES)
(PAVEMENT WIDTH 82' ±)

6" LATERAL
INV. ELEV. = 122.00

MATCH LINE

S77°47'26"E 207.64'

N12°12'34"E 186.70' (N)

S00°33'43"E 37.68'

N77°47'26"W 173.62' (S)

MDP-141618
(4) #10, #10
GND IN 1/2"

L-28
(2) #10, #10
GND IN 3/4"

L-32
(2) #10, #10
GND IN 3/4"

L-37
(4) #10, #10
GND IN 3/4"

L-31
(2) #10, #10
GND IN 3/4"

L-24
(2) #12, #12
GND IN 3/4"

L-42
(2) #10, #10
GND IN 1"

L-29
(2) #10, #10
GND IN 3/4"