


This information is intended to be used as a guide only. It is not intended to be used as a substitute for professional engineering or architectural services. The user hereby represents and warrants that he/she will be responsible for the proper interpretation and use of the information contained herein.

Order Plans

WWW.LDLINE.COM

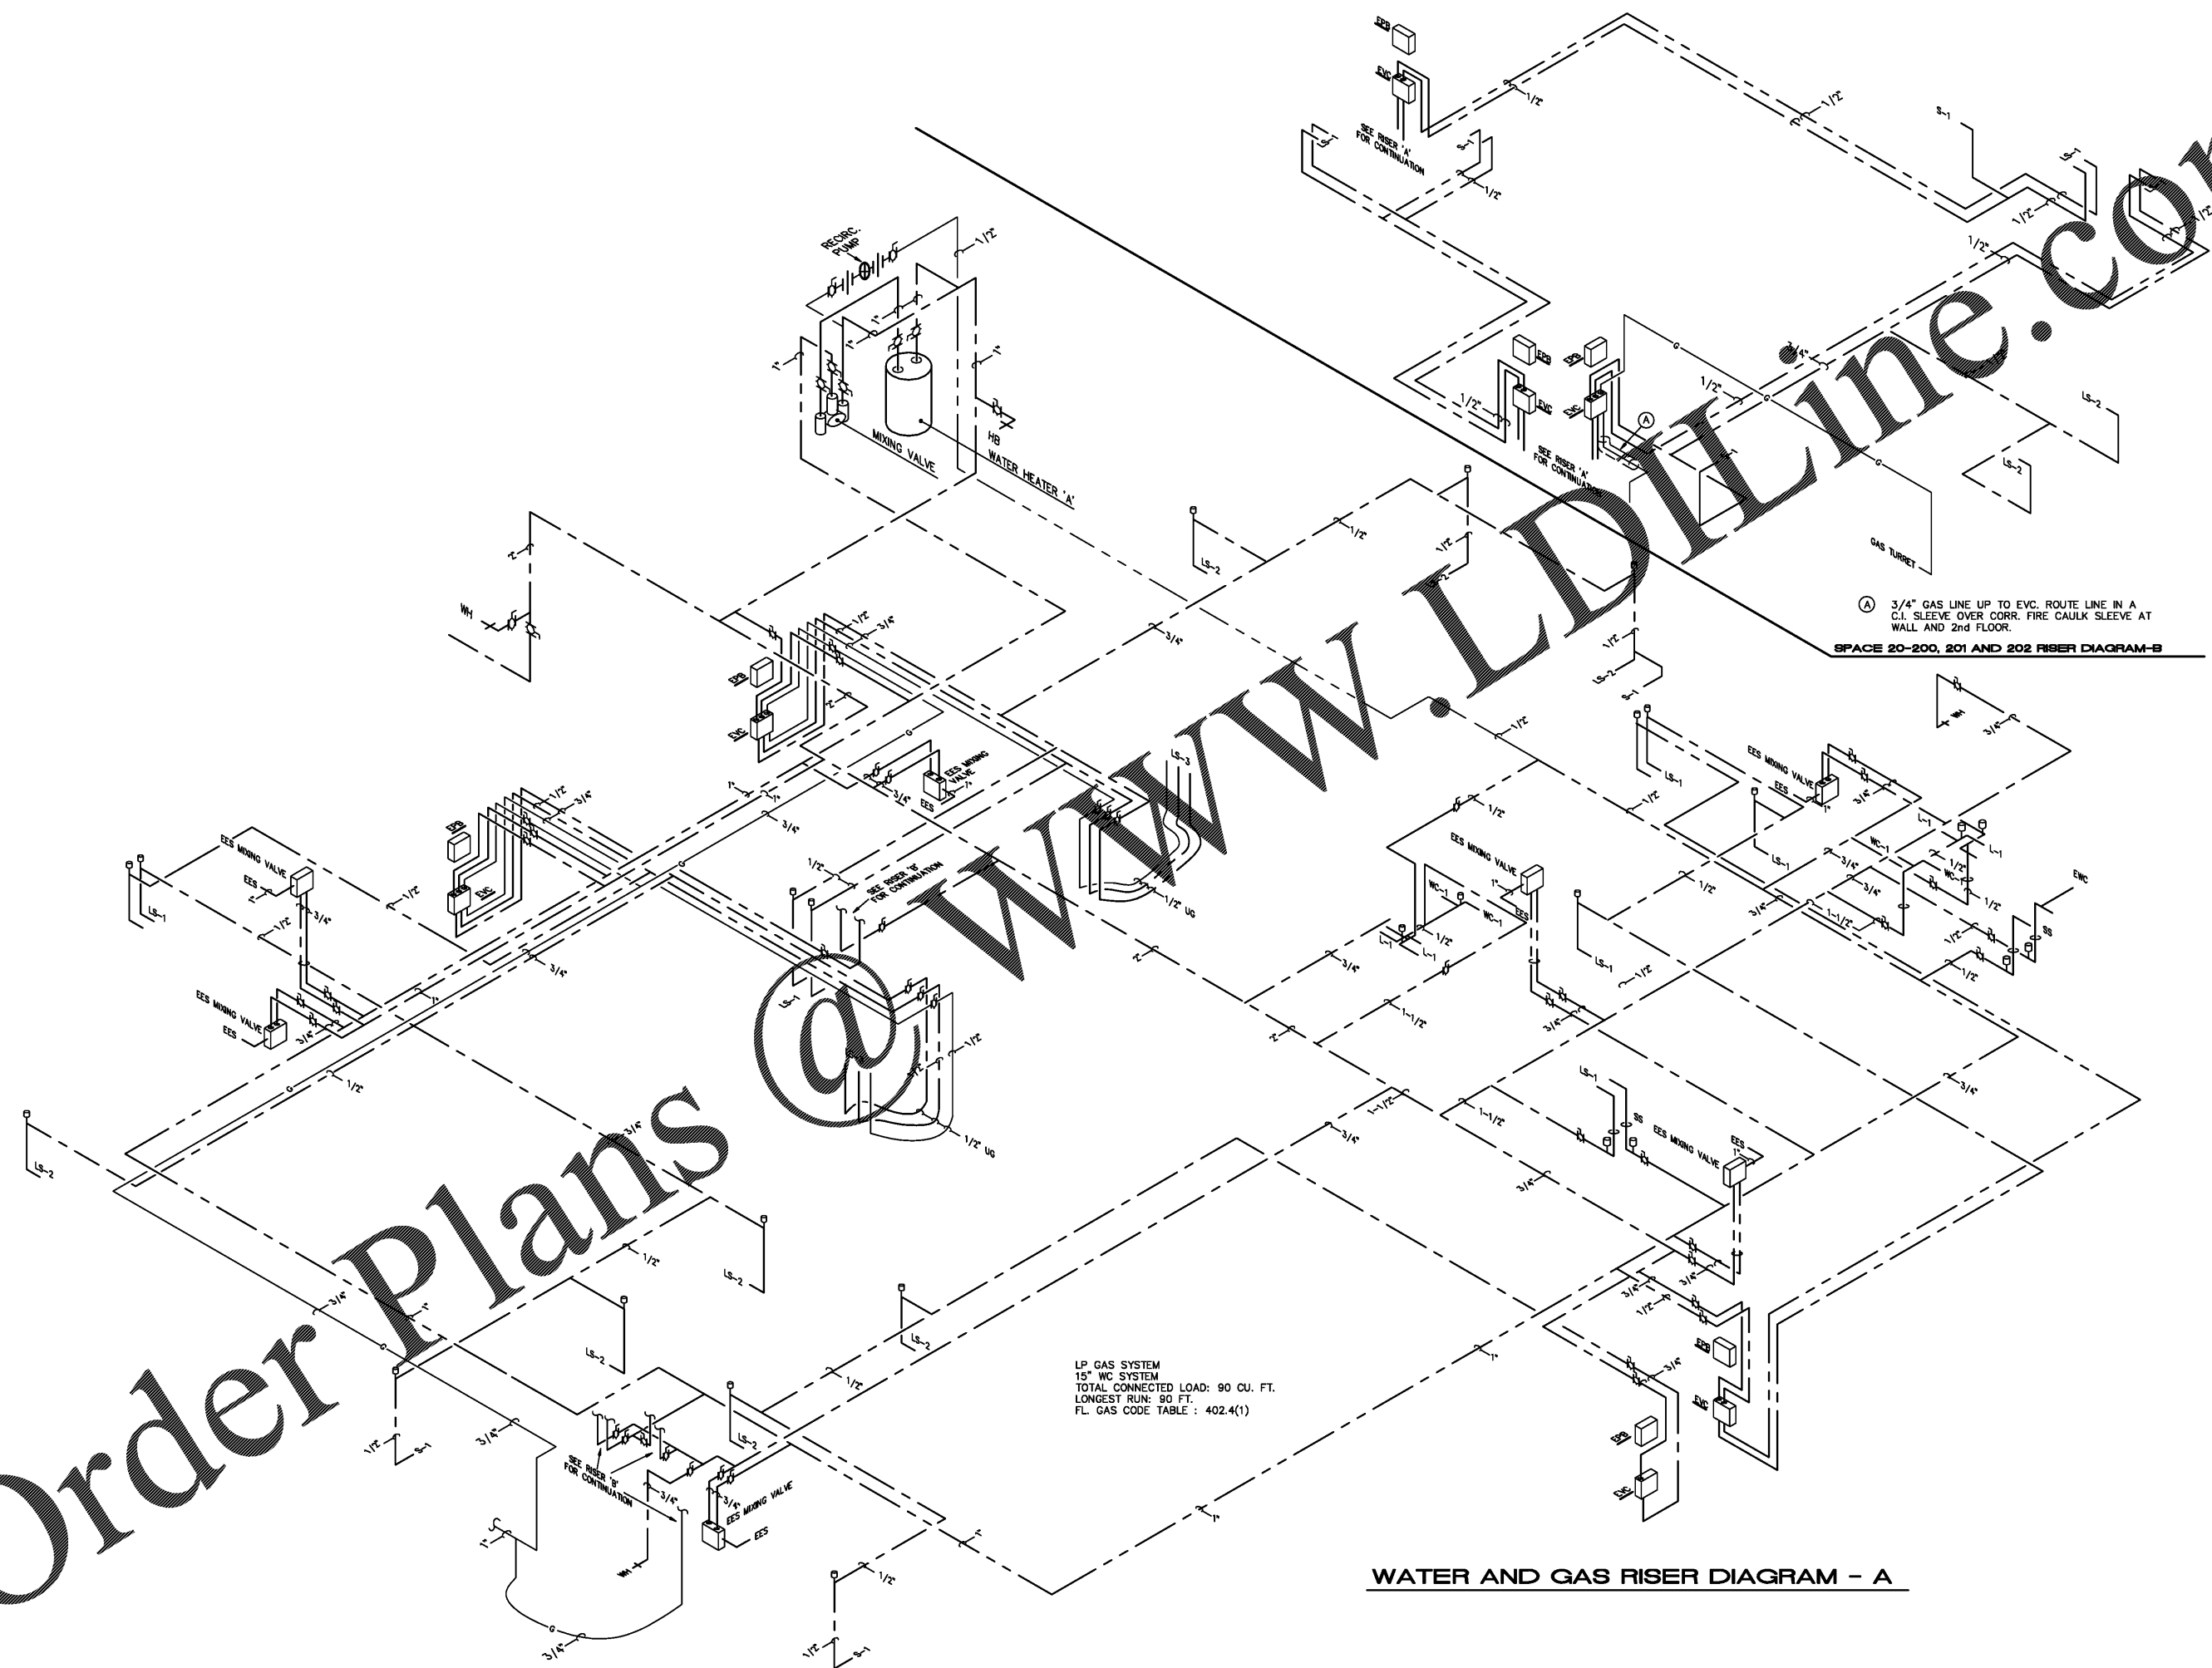

LP GAS SYSTEM
 15" WC SYSTEM
 TOTAL CONNECTED LOAD: 90 CU. FT.
 LONGEST RUN: 90 FT.
 FL. GAS CODE TABLE : 402.4(1)

WATER AND GAS RISER DIAGRAM - A

HARVARD • JOLLY
ARCHITECTURE
 2047 VISTA PARKWAY, SUITE 100 | WEST PALM BEACH, FL 33411 | www.harvardjolly.com | AAC000119

JLD
 JOHNSON, LEVINSON
 RAGAN, DAVILA, INC.
 1450 Centrepark Boulevard, Suite 350
 West Palm Beach, Florida 33401
 (561) 689-2333 (561) 689-2332 Fax
 www.jld.com
 Certification Number 6059
 Michael P. Landrum, P.E. 30594
 Charles C. Chubberson, P.E. 31936

STEM BUILDING
THE BENJAMIN SCHOOL - LOWER MIDDLE SCHOOL
 11000 Ellison Wilson Road, North Palm Beach, FL 33408
 CONSTRUCTION DOCUMENTS

Comm. No: 16117.00
 Job No: 117030
 Date: 10-23-17
 Drawn: GSQ

Revisions		
No.	Date	Note

TO THE BEST OF MY KNOWLEDGE, THE PLANS AND SPECIFICATIONS COMPLY WITH THE MINIMUM BUILDING CODES.

© 2017 HARVARD JOLLY, INC.

JLD Project #117030