



This information is provided for informational purposes only. It is not intended to be used as a substitute for professional engineering or architectural services. The user assumes all responsibility for the accuracy and completeness of the information provided herein. The user shall be responsible for verifying the accuracy and completeness of the information provided herein. The user shall be responsible for verifying the accuracy and completeness of the information provided herein.

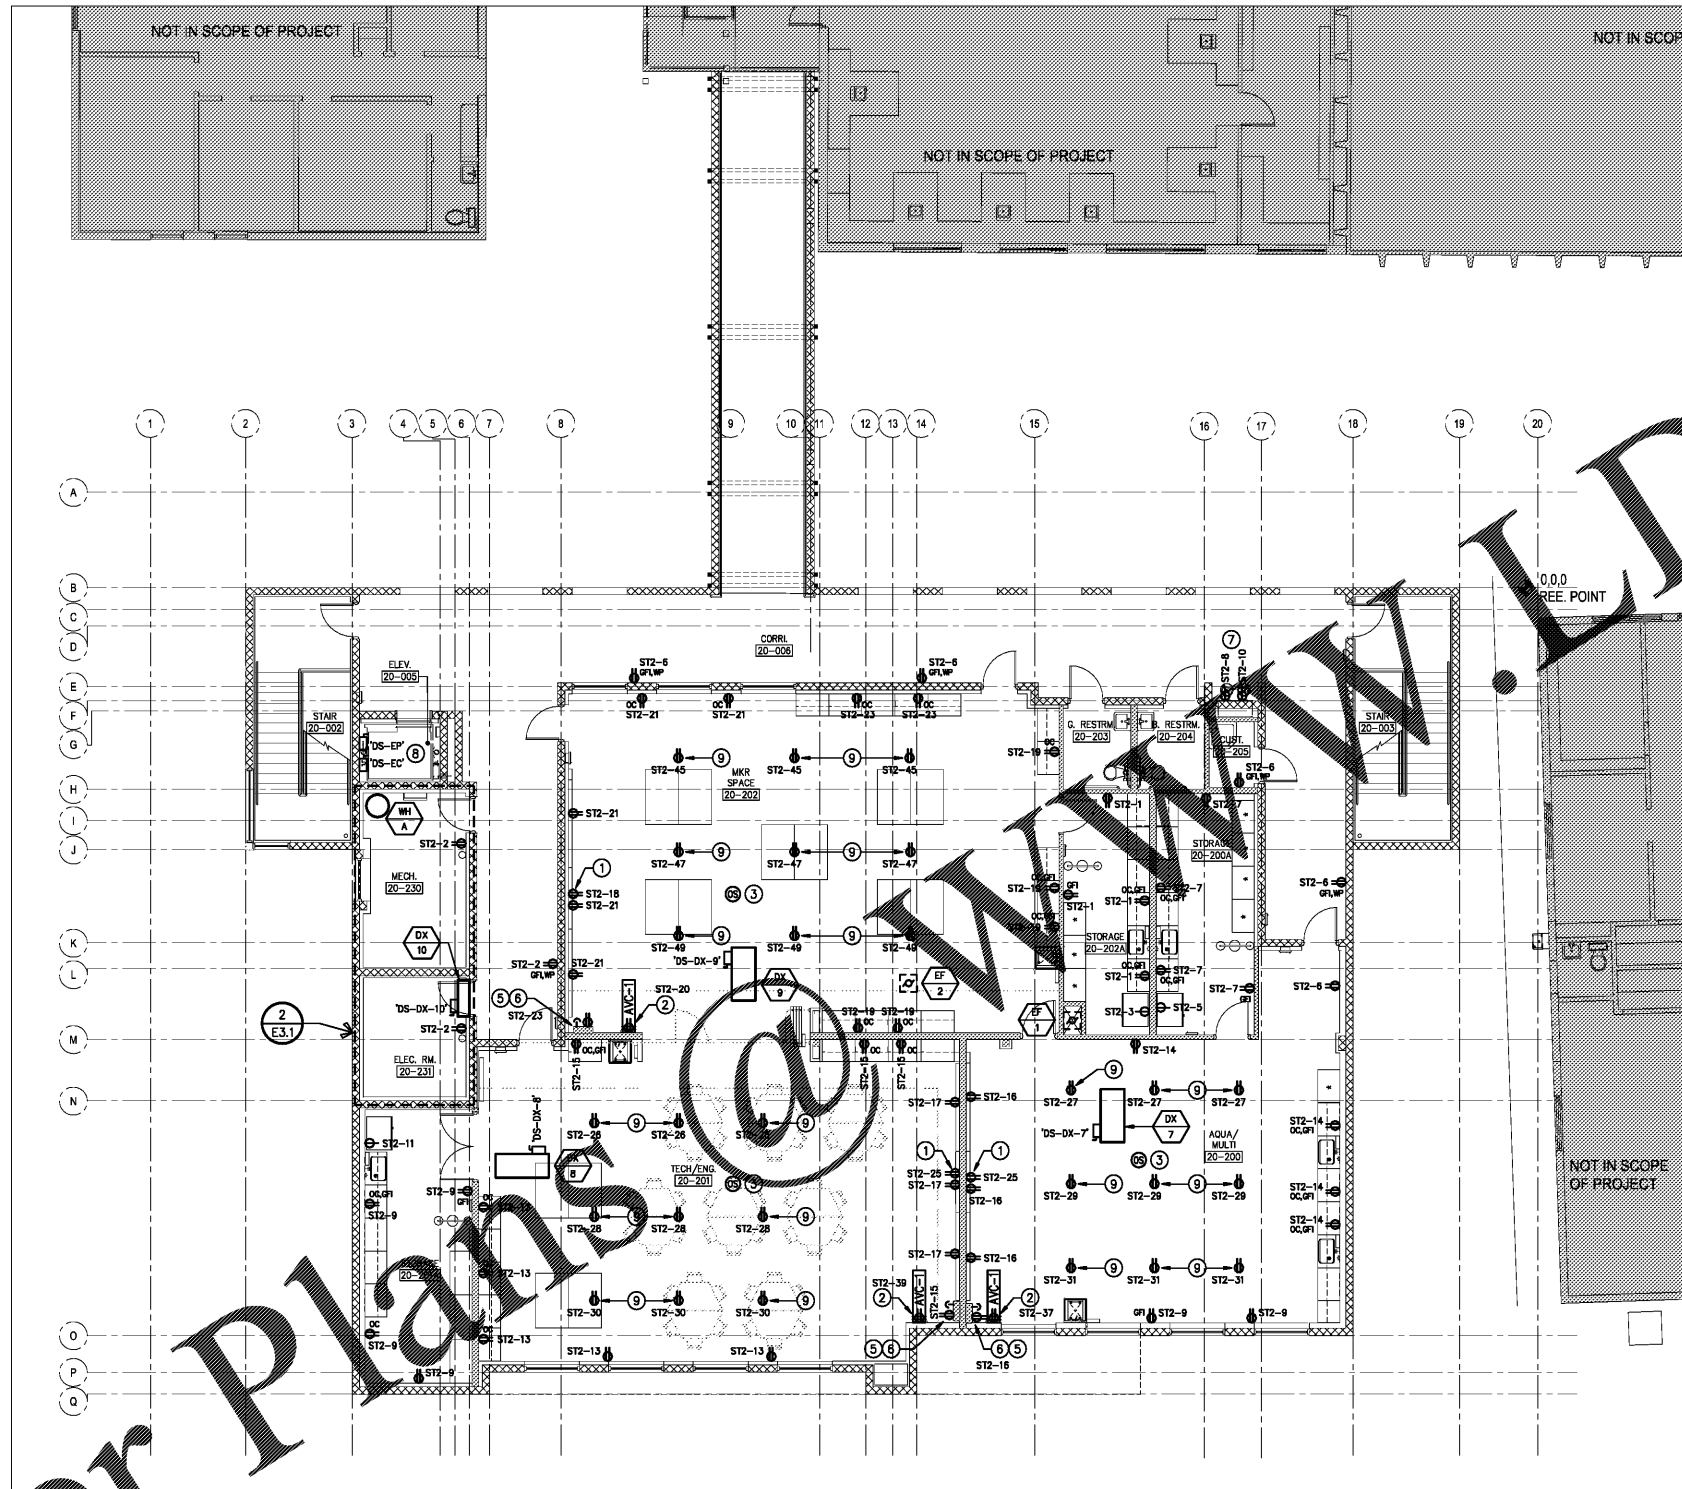

1 SECOND FLOOR POWER PLAN
 E2.5
 SCALE: 1/8" = 1'-0"

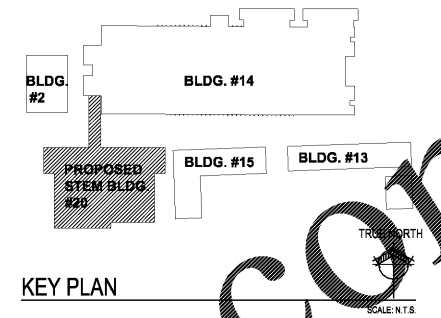

Order Plans @ JLDI Line.com

- PLAN NOTES:**
- COORDINATE LOCATION OF OUTLET IN CENTER OF SHORT THROW PROJECTOR ON THE WALL. VERIFY HEIGHT AND LOCATION WITH ARCHITECT PRIOR TO ROUGH-IN.
 - SEE DETAIL FOR POWER OUTLETS CONTAINED WITHIN TEACHER STATION, AND SIMILAR SPACES. CONTRACTOR SHALL VERIFY THE EXACT LOCATION OF ALL CASEWORK PRIOR TO ROUGH-IN OF ALL OUTLETS.
 - PROVIDE AND INSTALL OCCUPANCY SENSOR SUCH THAT, PER ASHRAE 90.1-2010, AT LEAST 50% OF RECEP. IN A SPACE ARE TURNED OFF WITHIN 30 MINUTES OF ALL OCCUPANTS VACATING SPACE.
 - CONNECT PREFABRICATED FURNITURE TO CIRCUIT INDICATED. COORDINATE ELECTRICAL REQUIREMENTS AND OUTLET MOUNTING LOCATION WITH MANUFACTURER PRIOR TO ROUGH-IN.
 - ISMET GAS, WATER, ETC VALVE/SOLENOID ENCLOSURE. RUN 3/4" WITH CONTROL WIRING TO RESPECTIVE UTILITY CONTROLLER. LOCATE BELOW OR ADJACENT TO CONTROL PANEL.
 - ISMET UTILITY CONTROLLER (CONTROL PNL.) WITH PUSHBUTTON FOR SHUTDOWN OF GAS, WATER, POWER, ETC VIA FIRE ALARM SHUTDOWN RELAY OR PUSHBUTTON. REFERENCE MANUFACTURERS WIRING DETAILS FOR FIRE ALARM SYSTEM INTERFACE VIA NORMALLY OPEN FIRE ALARM RELAY. SEE 'P' SERIES SHEETS FOR ADDITIONAL INFORMATION. CONNECT ALL RECEPTACLES IN SPACE THROUGH CONTACTOR. SEE 'CONTACTOR SCHEDULE'.
 - ELEC. WATER COOLER (EWC), CONNECT TO CIRCUIT INDICATED. LOCATE RECEPTACLE(S) WITHIN EWC ENCLOSURE.
 - ELEVATOR CONTROLS, FIELD COORDINATE EXACT LOCATION WITH ELEVATOR MANUFACTURER.
 - PROVIDE AND INSTALL AN INDUSTRIAL QUALITY, CEILING MOUNTED PULL DOWN/RETRACTABLE DROP CORD 'SO' TYPE WITH 2#12, 1#12G TO A 20A/120V/1PH RECEPTACLE. PROVIDE CORD GRIP CONNECTORS AT EACH END, WITH STRAIN-RELIEF AT CEILING CONNECTION. RECEPTACLE SHALL BE AT 6'-0" AFF. EXACT LOCATION TO BE COORDINATED WITH OWNER, SEE DETAIL.

HARVARD • JOLLY ARCHITECTURE
 2047 VISTA PARKWAY, SUITE 100 | WEST PALM BEACH, FL 33411
 561-478-4427 | www.harvardjolly.com | AAC000119

JLD
 JOHNSON, LEVINSON, RAGAN, DAVILA, INC.
 1450 Centrepark Boulevard, Suite 350
 West Palm Beach, Florida 33401
 (561) 689-2303 (561) 689-2302 Fax
 www.jld.com
 Certification Number 60399
 Michael P. Landrum, P.E. 30594
 Charles C. Chalkers, P.E. 31936

STEM BUILDING
 THE BENJAMIN SCHOOL - LOWER MIDDLE SCHOOL
 11000 Ellison Wilson Road, North Palm Beach, FL 33408
 CONSTRUCTION DOCUMENTS

Correl. No: 16117.00
 Job No: 117030
 Date: 10-23-17

Revisions		
No.	Date	Note

TO THE BEST OF MY KNOWLEDGE, THE PLANS AND SPECIFICATIONS COMPLY WITH THE MINIMUM BUILDING CODES.

© 2017 HARVARD JOLLY, INC.

JLD Project #117030

E2.5