

### IRRIGATION LEGEND

SYMBOL	SPECIFICATION
⊠	HUNTER I-CORE-1200-PL IRRIGATION CONTROLLER (SEE GENERAL IRRIGATION NOTES FOR INSTRUCTIONS)
⊕	HUNTER RAIN-CLIK - RAIN SENSOR
⊞	WATER SOURCE: 1" RECLAIMED WATER METER
⊞	ISOLATION GATE VALVE - LINE SIZE
⊞	HUNTER ICV (Reclaimed Water) 24 VOLT REMOTE CONTROL VALVE (SEE IRRIGATION ZONE TAG FOR VALVE SIZE)
⊞	1.0" RAINBIRD XCZ-101-COM PESB-PRS-D VALVE WITH (2) RAINBIRD 150 MESH BASKET FILTERS(QKCHK-150M)
▲	POINT OF CONNECTION - PVC TO DRIP TUBING
-----	MAINLINE: 2" SCHEDULE 40 PVC (PURPLE PIPE)
-----	LATERAL LINE: MINIMUM 160 PSI PVC (MINIMUM PIPE SIZE TO BE 3/4") (PURPLE PIPE)
-----	RAIN BIRD #XFD-P-09-12 IN-LINE PRESSURE COMPENSATING DRIP TUBING (1.5 GPM/100' TUBING)
-----	SLEEVING: SCHEDULE 40 PVC (TWO NOMINAL SIZES LARGER THAN PIPE TO BE SLEEVED)
STATION NUMBER	GALLONS PER MINUTE IRRIGATION ZONE TAG
XXV	VALVE SIZE

6" POP-UP SPRAY HEADS WITH PLASTIC RISER		6" POP-UP ROTOR HEADS WITH STAINLESS STEEL RISER	
SYMBOL	MODEL #	SYMBOL	MODEL #
●	Hunter PROS-06-CV-R 8F - 0.97 GPM	◆	Hunter I-20-06-SS-R-3RS-2.0SR 2.0 Short Radius Nozzle 2.00 GPM
●	Hunter PROS-06-CV-R 8H - 0.47 GPM	◆	Hunter I-20-06-SS-R-ARS-1.0SR 1.0 Short Radius Nozzle 1.00 GPM
●	Hunter PROS-06-CV-R 8Q - 0.24 GPM	◆	Hunter I-20-06-SS-R-ARS-0.5SR 0.5 Short Radius Nozzle 0.50 GPM
●	Hunter PROS-06-CV-R 10F - 1.59 GPM	◆	Hunter I-20-06-SS-R-ARS-3.0 3.0 Short Radius Nozzle 3.0 GPM
●	Hunter PROS-06-CV-R 10H - 0.88 GPM	◆	Hunter I-20-06-SS-R-ARS-1.5 1.5 Short Radius Nozzle 1.5 GPM
●	Hunter PROS-06-CV-R 10Q - 0.42 GPM	◆	Hunter I-20-06-SS-R-ARS-0.75 0.75 Short Radius Nozzle 0.75 GPM
▲	Hunter PROS-06-CV-R 12F - 2.70 GPM	●	Hunter I-20-06-SS-R-3RS-8.0 8.0 Nozzle 8.50 GPM
▲	Hunter PROS-06-CV-R 12H - 1.30 GPM	●	Hunter I-20-06-SS-R-ARS-4.0 4.0 Nozzle 4.25 GPM
▲	Hunter PROS-06-CV-R 12Q - 0.67 GPM	●	Hunter I-20-06-SS-R-ARS-3.0 3.0 Nozzle 3.20 GPM
●	Hunter PROS-06-CV-R 15F - 3.75 GPM	●	Hunter I-20-06-SS-R-ARS-1.5 1.5 Nozzle 1.65 GPM
●	Hunter PROS-06-CV-R ES-530 0.65 GPM		
●	Hunter PROS-06-CV-R SS-530 0.80 GPM		
●	Hunter PROS-06-CV-R CS-916 1.72 GPM		
●	Hunter PROS-101-CV-R Bubbler - 1.0 GPM		



SPRAY ZONES TO BE OPERATED AT 30 PSI

ROTOR ZONES TO BE OPERATED AT 50 PSI

- ### GENERAL IRRIGATION NOTES
- The Contractor shall provide a fully functional irrigation system as shown on the Plans. Irrigation heads shall provide 100% coverage of the area to be irrigated.
  - The source of water for the irrigation system shall be: 1" RECLAIMED WATER METER
  - The Contractor shall field verify the capability of the water source to deliver a minimum pressure (50 PSI) and volume (37 GPM) to operate the irrigation systems as designed. In the event of discrepancies contact the Landscape Architect prior to installation.
  - All questions concerning the Plans, Details or Specifications shall be directed to the Landscape Architect, (727) 343-1809.
  - All necessary permits (including Right of Way Use Permit) are to be provided by the installing contractor for work shown on the Plans.
  - All components of the proposed irrigation system shall meet the federal, state and local codes, regulations and ordinances concerning irrigation construction.
  - In an effort to create graphic clarity, irrigation mainline, lateral line, valves and other components of the irrigation system may be shown in paved areas or inside buildings on the Plans. These components are to be installed in appropriate landscape areas to carry out the intent of the Plans.
  - The Contractor shall be responsible for verification and protection of all underground and overhead utilities.
  - The Contractor shall review the Landscape Plans prior to installing the irrigation system. Coordinate installation locations of pipes, valves and other equipment with the installation locations of trees and shrubs.
  - As-Built drawings are to be provided by the Contractor. Drawings shall be on Owner furnished base plans in hand copy or electronic versions. Contractor shall note all deviations from the Irrigation Plans as noted in Section 32.0423 of the Specifications.
  - Mainline is to be installed with a minimum of 18" depth of cover, and lateral lines are to be installed with a minimum of 12" depth of cover.
  - Sleeving is to be provided by the Contractor (unless otherwise specifically stated in the Specifications or Bid Documents).
  - The Contractor shall provide operating maintenance instructions and operation manuals to the Owner prior to acceptance of the project.
  - Owner shall provide 110 Volt power to the controller location. Electrical connection from power source to control clock is to be provided by the Contractor (unless otherwise specifically stated in the Specifications or Bid Documents). Contractor shall coordinate installation location of control clock with Owner or Owner's Representative.
  - When the irrigation system Source is a proposed well, the well and pump locations shall be coordinated with the Owner or Owner's Representative prior to installation. The Owner shall provide power to the pump location. Contractor shall coordinate voltage and phase of available power with the local electrical utility and the Owner prior to ordering of the pump. Contractor shall coordinate pump ordering lead time with the irrigation and landscape work schedules to ensure timely supply of water to the project site.
  - Contractor shall install an inline 120VAC-15A lightning surge protector between the power source and the controller. Ground each controller to a 5/8" x 8' copper clad ground rod with AWG #6 bare solid copper wire. A proper ground shall have 10 ohms or less resistance to earth. Use of multiple ground rods may be necessary to achieve the desired resistance reading.
  - Contractor shall label location and head type for each zone in the irrigation system on the inside of the controller door. Suggested zone run time shall be indicated. All zone valves shall have permanent (plastic or metal) tags attached to the valve corresponding to the number of the zone on the controller.
  - Control Clocks shall be programmed to include a watering schedule that provides 1" of water per week during the months April to November and provides 1" of water every two weeks during the months December to March. The zone run time shall be sequenced for the local watering restrictions as Program 'A' operation 'B' shall be set as the water establishment period watering schedule in cooperation with the Landscape Contractor.
  - The rain shut-off device shall be installed to meet local codes. Contractor shall locate device so that obstructions do not alter the accurate monitoring of rainfall at the project site. All wiring to the device shall be enclosed in 1/2" PVC electrical conduit.
  - 12" pop-up spray (or rotor) heads shall be installed in all groundcover beds and masses of shrubs not exceeding 22 inches height.
  - 6" pop-up spray heads shall be installed in all turf areas. Rotor heads in turf areas to be 6" pop-ups with the exception of Hunter PGP Series (4").
  - All Hunter PGP and PGP Rotor and Spray heads shall have heavy walled PVC IPS flex pipe for the connection between lateral line and each head. Provide adequate slack for minor head adjustment. All Hunter I-20 Rotor heads shall have rigid PVC swing joints. See Details for Shrub Riser and 12" pop-up head applications.
  - The Contractor shall adjust all heads to provide optimum coverage and minimize overthrow onto paved surfaces. Adjustable nozzles shall be used in areas where fixed spray patterns will result in overthrow onto paved surfaces. Adjust pressure regulating valves to prevent misting from heads.
  - Valve boxes shall be sized to accommodate installation and maintenance of zone valve(s). The valve box shall have a 3" deep layer of 1/2" diameter gravel as a sump installed 2" below the bottom of the valve. Valve boxes shall be installed so that the top of the box is no more than 1.5 inch above finish grade and set parallel to the surrounding grade.
  - All 24 Volt control wiring shall be UL Listed, single strand, Type UF 600 Volt control cable. Common wires to be white, AWG #12 or larger wire. Hot wires to be red, AWG #14 or larger wire. Spare wires to be any color wire except green, red or white, AWG #14 or larger wire.
  - All splices to the 24 Volt control wiring shall be made with King Technology (King 6) silicone filled safety connectors.
  - Shrub risers shall only be installed in hedges or mass plantings abutting vertical walls or objects and not extend more than 6" above the height of the shrubs. In no case shall risers be installed directly adjacent to curbs, sidewalks or other vehicular access ways. If risers are to be used in hedges abutting parking areas without concrete wheel stops, they must be placed a minimum of 30 inches away from the edge of pavement to protect the riser from damage by vehicular overhang. All risers are to be painted black.
  - Mainline piping shall have thrust blocks sized and placed in accordance with the pipe manufacturer's recommendations. Thrust blocks shall be installed at all changes in direction, reduction in pipe size, and end caps on the Mainline.
  - Irrigation Systems designed with Reclaimed Water as the Source shall include purple marking caps for all valve boxes, valves, quick couplers, hose bits and spray or rotor heads. Rainbird PESBR-PRS-D zone valves with self cleaning scrubber shall be used on all systems connected to Reclaimed Water.

Order Plans

WWW.WOODLINE.COM

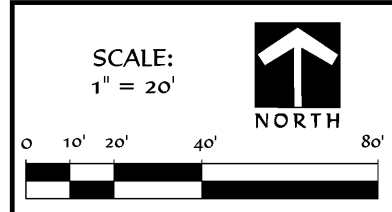

REVISIONS:	
1.	10/23/17 DRC COMMENTS
2.	12/27/17 CITY REVIEW COMMENTS
3.	
4.	

DRAWN BY: JAZ  
DATE: 8/18/17  
**17040**  
IRRIGATION HEAD LAYOUT  
**LS3**  
BID SET - 1/03/18

**7-ELEVEN STORE**  
STORE # 38227  
DYER BLVD. & CARROLL ST.  
KISSIMMEE, FLORIDA

**HEARTWOOD & BARK**  
LANDSCAPE ARCHITECTURE - URBAN DESIGN  
200 2nd St. S., #433 St. Petersburg, FL 33701  
(727) 343-1809 Web: www.heartwoodandbark.com  
License Number: LC26000325