


E

D

C

B

A

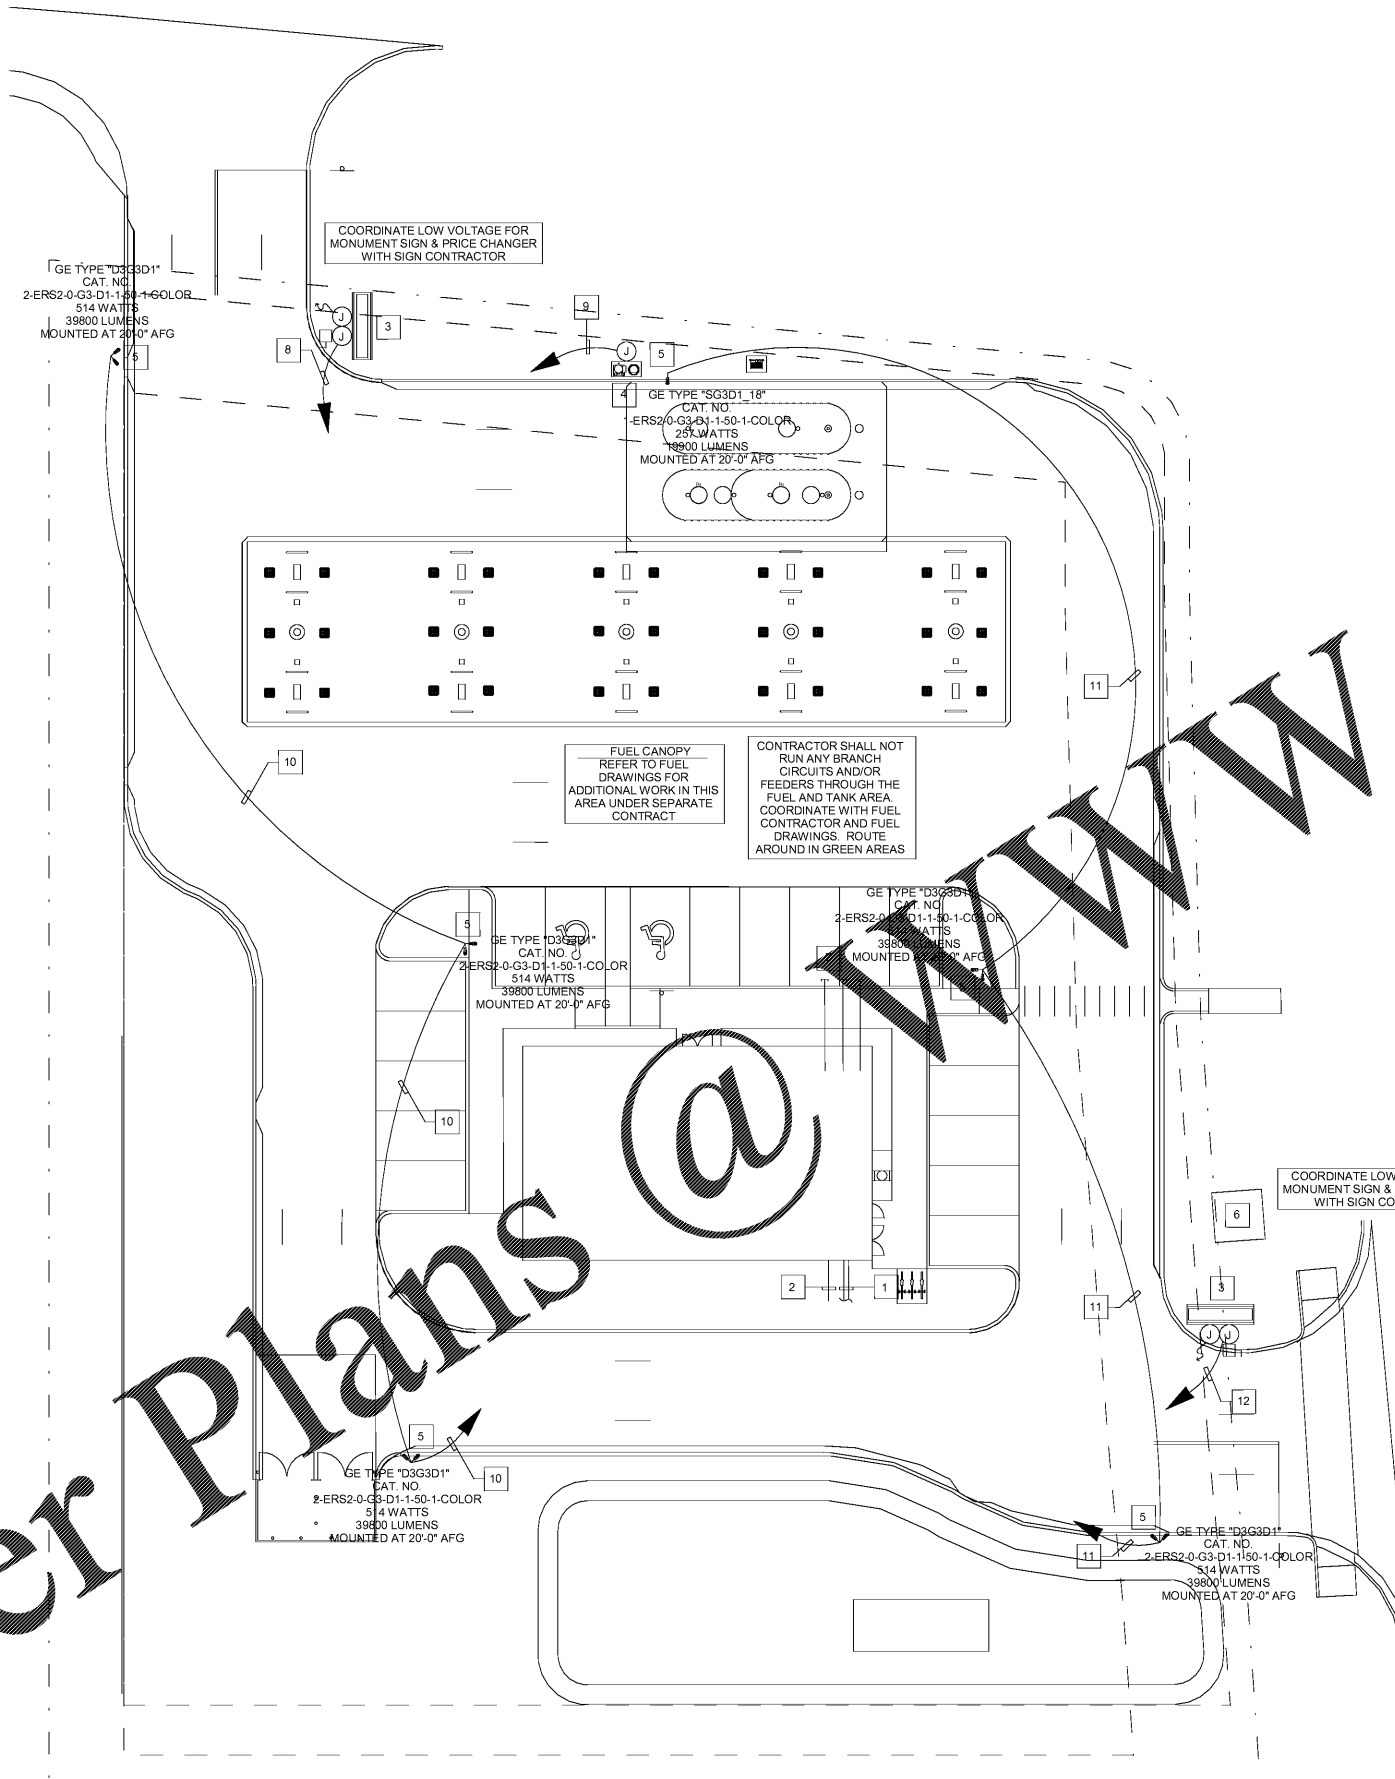

- NOTES:**
- CONTRACTOR SHALL VERIFY ALL CLASSIFIED AREAS PRIOR TO COMMENCEMENT OF WORK. INSTALLATION SHALL COMPLY WITH NEC (500, 501, 514).
 - ALL CONDUITS SHALL BE BURIED A MINIMUM OF TWENTY FOUR INCHES BELOW FINISHED GRADE TO TOP OF CONDUIT.
 - PROVIDE MINIMUM OF ONE INCH SPACING BETWEEN ALL POWER CONDUITS AND MINIMUM OF 6 INCH SPACING BETWEEN POWER AND DATA CONDUITS.
 - ELECTRICAL CONTRACTOR TO COORDINATE ALL REQUIREMENTS WITH FUEL CONTRACTOR. THE ELECTRICAL CONTRACTOR SHALL PROVIDE ALL NECESSARY CONDUITS, SEAL-OFFS, TROUGHES, AND RACEWAYS FROM THE ELECTRICAL ROOM OR PANEL AREA TO THE EXTERIOR OF THE BUILDING, BUT NOT TO EXCEED 10 FEET FROM THE EXTERIOR BUILDING EDGE. ALL OTHER EQUIPMENT, WIRE, LABOR FOR THE COMPLETION OF THE FUEL SYSTEM TO BE PROVIDED BY THE FUELING CONTRACTOR.
 - ALL ITEMS ASSOCIATED WITH THE FUELING CANOPY ARE PART OF A SEPARATE PERMIT AND SHOWN FOR INFORMATIONAL PURPOSES ONLY. REFER TO FUELING SHEETS FOR FUELING CANOPY SPECIFICATIONS.
 - ALL EXTERIOR DISCONNECTS SHALL BE WEATHER PROOF NEMA 3R TYPE

KEYNOTES - SITE PLAN

1	INCOMING UNDER GROUND SERVICE, REFER TO "ONE-LINE DIAGRAM" ON DRAWING SET 1.1 FOR ADDITIONAL INFORMATION.
2	INCOMING UNDER GROUND TELEPHONE SERVICE CONDUIT, COORDINATE WITH SERVING TELEPHONE COMPANY.
3	MONUMENT SIGN MAINTENANCE OUTLET AND NEMA 3R DISCONNECT SWITCH PROVIDED BY SIGN CONTRACTOR
4	AIR AND VACUUM MACHINE
5	SEE LIGHTING FIXTURES AND POLES. REFER TO E0.2, CIVIL AND STRUCTURAL DRAWINGS FOR SPECIFICATIONS, BASES AND MOUNTING DETAILS. SHOWN HERE FOR ELECTRICAL CONNECTIONS ONLY.
6	PAD MOUNTED SERVICE TRANSFORMER, COORDINATE WITH LOCAL UTILITY COMPANY AND MAKE ALL CONNECTIONS IN ACCORDANCE WITH THEIR REQUIREMENTS.
7	CIRCUITS FROM PANEL BOARD "L" - CIRCUITS 28, 32 & 34 EACH 2 #10 + #10 GND. IN A 1" CONDUIT STUBBED OUT OF BUILDING AND CONTINUED BY "FUEL CONTRACTOR"
8	L-37, L-39, 1"C. W (4)#10, (1)#10G (1) 3/4"C FOR LOW VOLTAGE
9	L-40, 1"C. W (2)#10, (1)#10G
10	L-22, 1"C. W (2)#10, (1)#10G
11	L-33, 1"C. W (2)#10, (1)#10G
12	L-7, L-9, 1"C. W (4)#10, (1)#10G (1) 3/4"C FOR LOW VOLTAGE

1 SITE POWER PLAN
E0.1 N.T.S.



THE CONTRACTOR SHALL DETERMINE THE EXACT LOCATION OF ALL EXISTING UTILITIES BEFORE COMMENCING WORK, AND AGREES TO BE FULLY RESPONSIBLE FOR ANY AND ALL DAMAGES WHICH MIGHT BE OCCASIONED BY THE CONTRACTOR'S FAILURE TO EXACTLY LOCATE AND PRESERVE ANY AND ALL UNDERGROUND UTILITIES.

bates
106 N 37TH STREET, SUITE C
ROGERS, ARKANSAS 72756
WWW.BATESARCHITECTS.COM
TEL: 479.633.1111

Florida Certified Authority #12366
Copyright © 2017 Bates Architects, Inc. All rights reserved. This drawing is the property of Bates Architects, Inc. and shall remain the property of Bates Architects, Inc. It is not to be used on other projects or extended beyond the project without the written consent of Bates Architects, Inc. Bates Architects, Inc. is not responsible for construction means, methods, or safety precautions or for safety precautions and coordination with the project.

STORE #:
38227

CONSTRUCTION MANAGER
CREIGHTON CONSTRUCTION & MANAGEMENT, LLC
900 SW PINE ISLAND ROAD, SUITE 202
CAPE CORAL, FL 33991

TENANT
7-ELEVEN INC.
3200 HACKBERRY ROAD
IRVING, TX 75063
CONTACT: DANIEL TUBB
STRUCTURAL CONSULTANT
SELECT STRUCTURAL
12573 NEW BRITANNY BLVD FORT MYERS, FL 33907

PROTO:08-21-2017

7-ELEVEN STORE
SW CO CARROLL ST. & DYER BLVD.
KISSIMMEE, FL 34741

CREIGHTON CONSTRUCTION & MANAGEMENT, LLC
900 SW PINE ISLAND ROAD, SUITE 202
CAPE CORAL, FL 33991

Engineer Name - ANDREW D FINNEGAN
Engineer Number - 80051

THE SEAL AND SIGNATURE APPLY ONLY TO THE DOCUMENT TO WHICH THEY ARE APPLIED AND WE HEREBY DISCLAIM ANY RESPONSIBILITY FOR ALL OTHER PLANS, SPECIFICATIONS, ESTIMATES, REPORTS OR OTHER DOCUMENTS OR INSTRUMENTS RELATING TO OR INTENDED TO BE USED FOR ANY PARTS OR PARTS OF THE PROJECT.

REVISIONS	
NO.	DESCRIPTION

PROJECT NUMBER: 17111
RELEASE DATE: 12/19/2017

SITE POWER PLAN

E0.1