

F


E

D

C

B

A

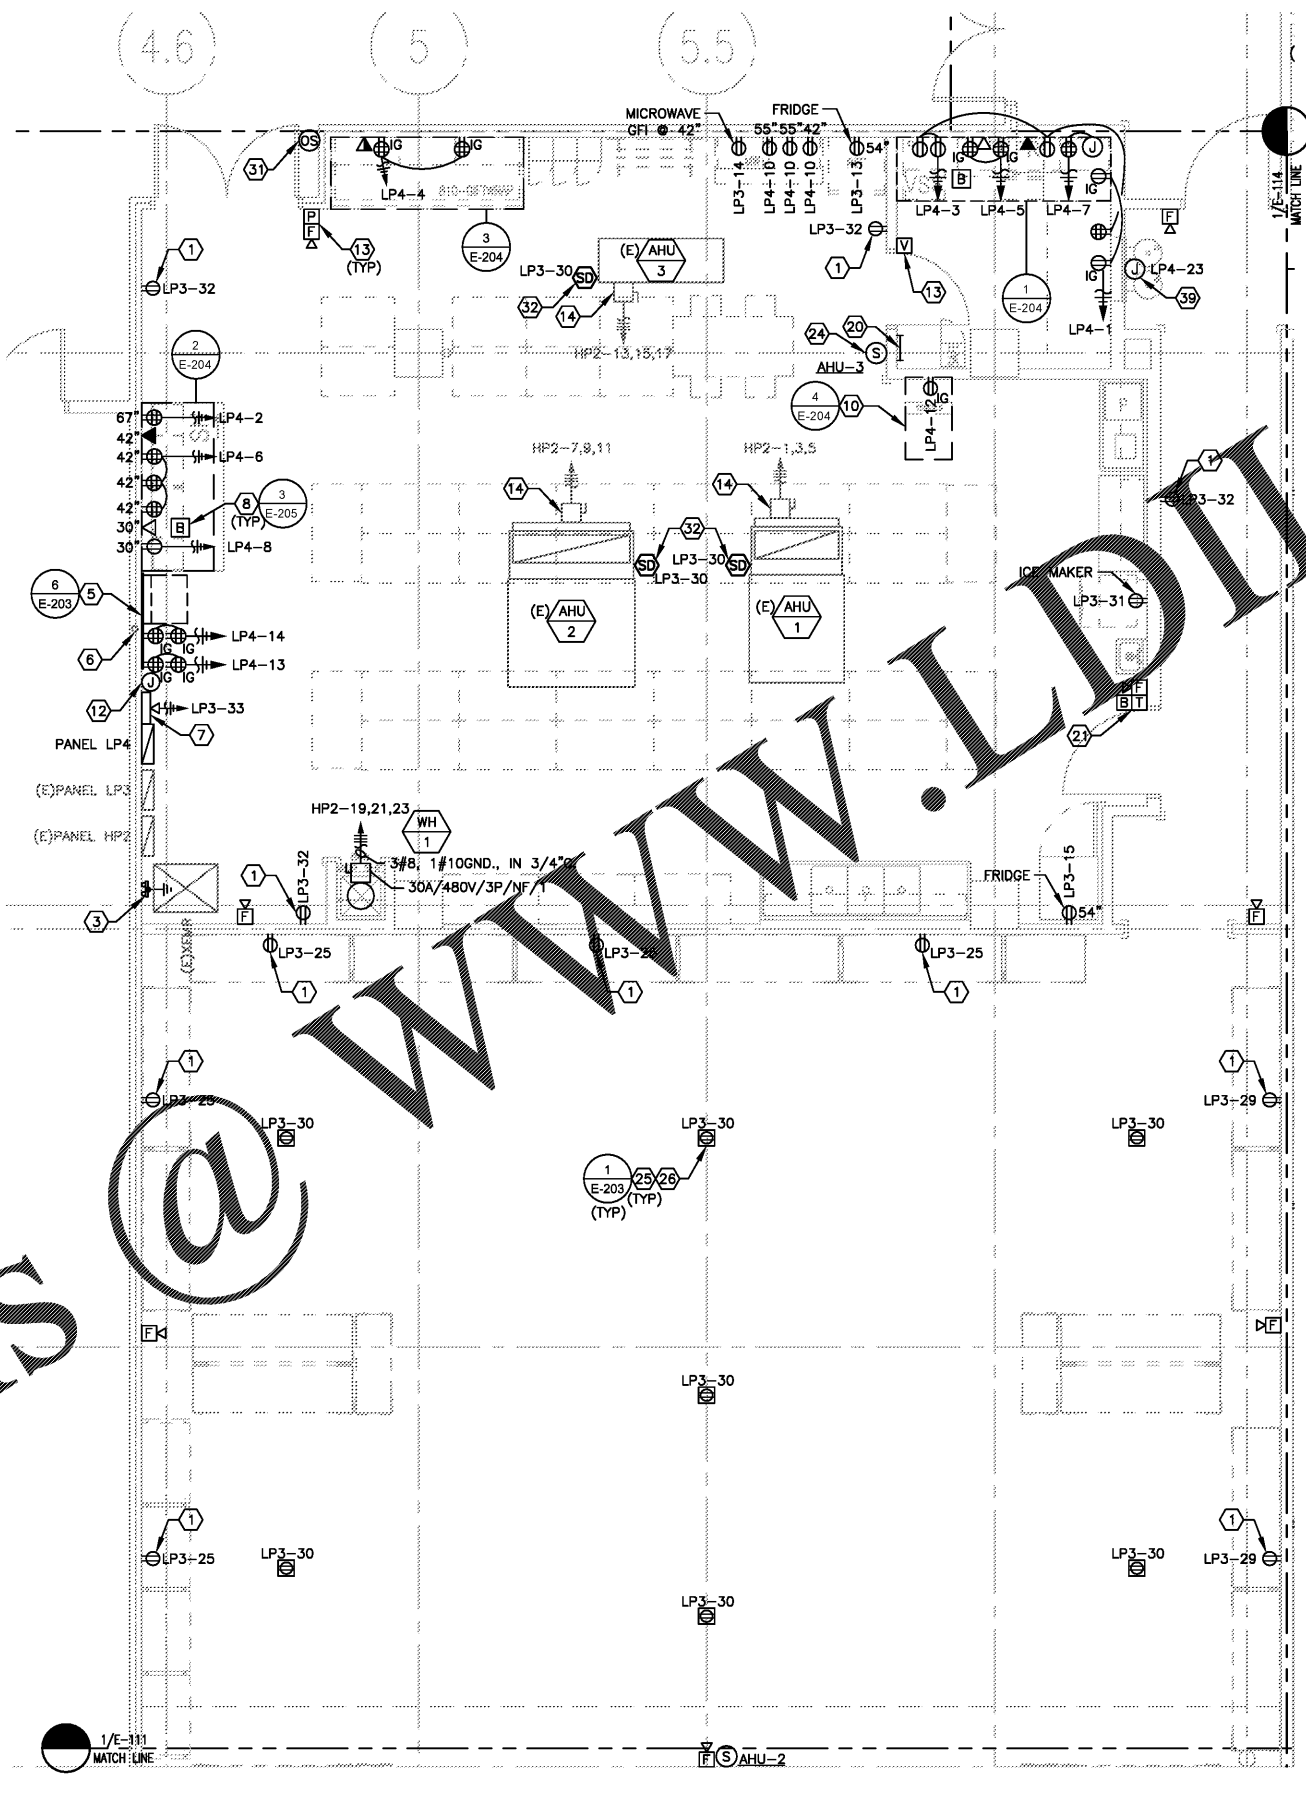

POWER GENERAL NOTES

- A. PROVIDE AND INSTALL RACEWAY AND BOX FOR LV SYSTEMS.
- B. REFER TO MECHANICAL PLAN SET FOR MECHANICAL EQUIPMENT INFORMATION.
- C. REFER TO LIGHTING CONTROL PANEL SCHEDULE ON SHEET E-003 FOR CONTROLLED RECEPTACLE CIRCUITS.
- D. REMOVE ALL EXISTING ELECTRICAL EQUIPMENT NOT SHOWN ON ELECTRICAL PLANS. REMOVE ALL CONDUIT AND CONDUCTORS BACK TO PANEL.

FIRE ALARM SYSTEM SHOWN ON ELECTRICAL DRAWINGS ARE FOR SCHEMATIC AND BIDDING PURPOSES ONLY. FIRE ALARM SYSTEM CONTRACTOR SHALL SUBMIT FIRE DRAWINGS, EQUIPMENT CUT SHEETS, ETC., PER LOCAL CODE AND NFPA72 TO LOCAL AUTHORITIES HAVING JURISDICTION AND OWNER'S INSURANCE COMPANY FOR APPROVAL PRIOR TO ORDERING EQUIPMENT. ENGINEER WILL NOT APPROVE FIRE ALARM DRAWINGS, EQUIPMENT CUT SHEETS, ETC. INCLUDE IN BID ALL COSTS FOR PERMITS AND FEES. ALL PANELS AND PERIPHERAL DEVICES SHALL BE STANDARD PRODUCT OF SINGLE MANUFACTURER AND SHALL DISPLAY THE MANUFACTURER'S NAME ON EACH COMPONENT. CONFIRM FIRE ALARM MODEL WITH LANDLORD.

ALL ABANDONED AND/OR UNUSED COMPONENTS CREATED OR EXPOSED DURING CONSTRUCTION, INCLUDING BUT NOT LIMITED TO HVAC, CABLES, PIPING, WIRING, AND ASSOCIATED SUPPORTS AND/OR ATTACHMENTS SHALL BE REMOVED.


THE FIRE ALARM PLANS ARE A DEFERRED SUBMITTAL AND WILL BE SUBMITTED BY A LICENSED FIRE ALARM CONTRACTOR SUBMITTED BY THE GENERAL CONTRACTOR.

COORDINATE EXACT LOCATION OF FLOOR BOXES WITH ARCHITECTURAL DRAWINGS PRIOR TO ROUGH-IN.

POWER KEYED NOTES

- 1 GENERAL PURPOSE RECEPTACLE MOUNTED AT 18" A.F.F.
- 2 NOT USED.
- 3 1"x1-1/4"x12" GROUND BAR.
- 4 NOT USED.
- 5 PROVIDE 4'x8'x3/4" FIRE RESISTANT PLYWOOD BACKBOARD WITH (4) QUADPLEX AND #6 CU TO BUILDING GROUND.
- 6 2" CONDUIT WITH PULL WIRE FROM TELEPHONE BACKBOARD LOCATION TO LANDLORD PROVIDED STUB-IN. FIELD VERIFY EXACT LOCATION ON LANDLORD PROVIDED STUB-IN.
- 7 LIGHTING CONTROL PANEL.
- 8 CHIME MOUNTED AT 96" A.F.F. VERIFY FIELD LOCATION WITH ARCHITECT PRIOR TO INSTALLATION.
- 9 NOT USED.
- 10 SOUND SYSTEM EQUIPMENT CABINET. REFER TO DETAIL FOR ADDITIONAL REQUIREMENTS INCLUDING LV CONDUIT.
- 11 NOT USED.
- 12 JUNCTION BOX FOR CONNECTION TO LANDLORD FIRE ALARM SYSTEM.
- 13 FIRE ALARM DEVICE. DEVICES TO BE CEILING MOUNTED IN SALES FLOOR AREA.
- 14 EXISTING DISCONNECT AT UNIT.
- 15 - 19 NOT USED.
- 20 LOCATION OF HVAC TSTATS BEHIND DOOR. COORDINATE WITH MECHANICAL CONTRACTOR FOR SPACE TEMP SENSORS.
- 21 ELECTRICAL CONTRACTOR IS TO FURNISH AND INSTALL DOOR BUZZERS, LOW VOLTAGE TRANSFORMER, PUSHBUTTON AND WIRING FOR DOOR BUZZER SYSTEM SEE SPECIFICATIONS. SIZE TRANSFORMERS AS REQUIRED.
- 22 - 23 NOT USED.
- 24 HVAC SENSOR LOCATIONS.
- 25 PROVIDE FLUSH FLOOR BOX, COMMERCIAL ROLL FORMED PRODUCTS 2000, #C2606-25 (COORDINATE FLOORBOX COLOR WITH ARCHITECT) AND NEMA 5-20R RECEPTACLE. SEE ARCHITECTURAL PLANS FOR EXACT LOCATIONS.
- 26 FOR DEVICE SHOWN, RUN 1/2" CONDUIT IN FLOOR UNDER LAYMENT SPACE. DO NOT RUN CONDUIT PARALLEL WITH WOOD FLOORING, COORDINATE CONDUIT ROUTING WITH FLOORING CONTRACTOR AND ARCHITECT PRIOR TO LAYOUT TO ACCOMMODATE CONDUIT CUT-OUTS IN PLYWOOD. SEE SPECIFICATION SECTION 3.02.B.5.
- 27 - 30 NOT USED.
- 31 BURGLAR ALARM SOUNDER AT 96" A.F.F.
- 32 DUCT MOUNTED SMOKE DETECTOR. COORDINATE WITH G.C. AND MECHANICAL CONTRACTOR FOR LOCATION.
- 33 AIPHONE WALL MOUNT INTERCOM AT 48" A.F.F.
- 34 - 38 NOT USED.
- 39 JUNCTION BOX FOR CONNECTION OF REMOTE CHILLER FOR WATER FOUNTAIN. VERIFY LOCATION WITH PLUMBING CONTRACTOR PRIOR TO INSTALLATION.

Order Plans



SCALE: 1/4" = 1'-0" @ FULL SIZE

OWNER:
WILLIAMS-SONOMA, INC.
 3250 Van Ness Avenue
 San Francisco, CA 94109
 T 415 616 8602
 F 415 439 8164
 www.williams-sonoma.com

EEA
 EEA Consulting Engineers
 6615 Vaught Ranch Road, Suite 100
 Austin, Texas 78730-2314 USA
 512.744.4400 main 512.744.4444 fax
 www.eeace.com
 State of Registration VIRGINIA
 Firm Registration No. 0407 004734
 EEA Project No. 20166524

DRAWN BY: BMW
 CHECKED BY: SAH

BID DOCUMENT ONLY
 Not Intended for Construction or Permit
 This document is released under the
 authority of:
 Registrant's Name: SARA A. HAMILL
 Serial No. 0402052431

P O T T E R Y B L A I N
WILLIAMS-SONOMA
 Town Center Virginia Beach
 173/177 Central Park Avenue
 Virginia Beach, VA 23462
 PROJECT #006-151817-00/#006-151412-00

ISSUED / REVISED	DATE
FEASIBILITY SET	08/10/17
PRELIMINARY SET	09/28/17
LL CD SET	11/30/17
PERMIT SET	12/18/17
BID SET	01/04/18

KEYPLAN N.T.S.
 PARTIAL POWER PLAN

E-112