



1 REFRIGERANT LEAK DETECTION UNIT - HGM MZ

- NOTE:
1. INSTALL ENCLOSURE ON A VIBRATION FREE SURFACE. MARK HOLE LOCATIONS. USE APPROPRIATE HARDWARE FOR MOUNTING TO STRUCTURE.
 2. FOLLOW ALL NATIONAL AND LOCAL ELECTRICAL CODES WHEN INSTALLING.
 3. WHEN INSERTING WIRING, BE SURE HIGH AND LOW VOLTAGE ARE KEPT ISOLATED.
 4. ALL REMOVED KNOCKOUTS MUST HAVE CONDUIT FITTINGS INSTALLED.


- REFRIGERANT LEAK DETECTION CONTROL PANEL:
- ONE (1) ENCLOSURE (INSTALLER SUPPLIED & MOUNTED)
 - CPC POWER SUPPLY (INSTALLER MOUNTED)
 - TWO (2) 8AI/BRO COMBO BOARD (INSTALLER MOUNTED)

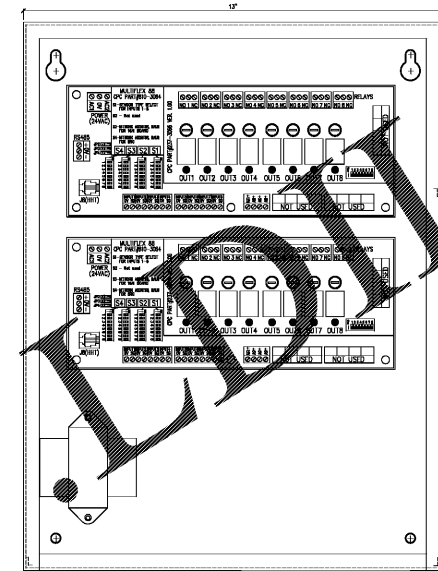

2 CONTROL SYSTEM - DANFOSS LEAK DETECTION CONTROL PANEL



COOPER TWPB-2-15W-NW





NOTE #3

NOTE #2




NOTE #1

- NOTE #1:
1. HORN & STROBE CONTACTS CONTROLLED BY SAME RELAY POINT.
 2. OP 1 SET TO DOWN.
 3. SW2 SET TO DOWN.
 4. SW3 SET TO UP.
 5. SW4 SET TO UP.

3 CONTROL SYSTEM - REFRIGERANT LEAK HORN & STROBE DETAIL


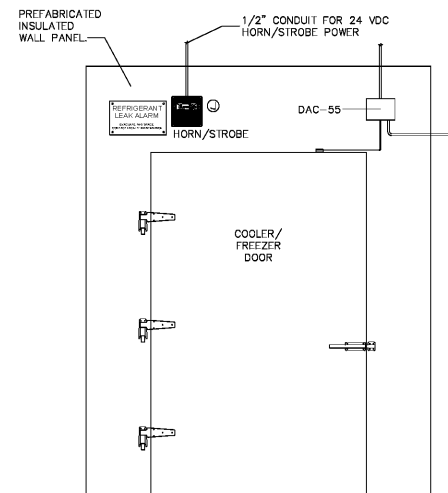



4 CONTROL SYSTEM - REFRIGERANT LEAK HORN/STROBE MOUNTING DETAIL



- NOTE:
- USE SPECIAL WASHDOWN J-BOX (OWNER SUPPLIED) TO MOUNT FILTER END FOR ZONES IN PREP AREAS, DAIRY COOLER AND OUTDOOR PURGE ZONE.
 - WHERE DAMAGE TO FILTER END MAY OCCUR, REMOVE THE J-BOX KNOCKOUTS AND INSTALL COVERPLATE.
 - FREEZERS TO UTILIZE WALL MOUNT LOCATION.
 - COOLERS AND PREP ROOMS TO UTILIZE WALL MOUNT OR CEILING MOUNT DEPENDING ON COIL CONFIGURATION.
 - SALES FLOOR ZONES TO UTILIZE THE COLUMN MOUNT.

5 CONTROL SYSTEM - REFRIGERANT LEAK DETECTION FILTER MOUNTING / INSTALL DETAIL

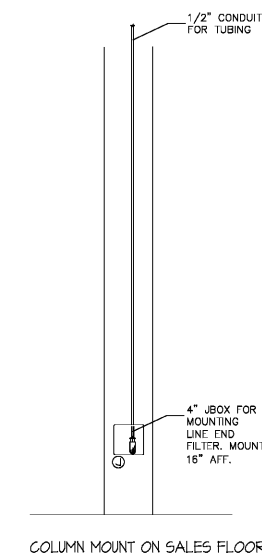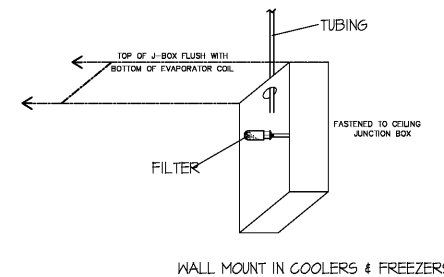

SCALE: NONE



GENERAL OFFICE
FACILITY ENGINEERING
10000 W. 11TH AVENUE
DENVER, CO 80202
PH: 303.796.1887
FAX: 303.796.4888

NEW STORE
CONTROLS
INSTALLATION TEMPLATE

CURRENT PLAN DATE
5/1/2015

ORIGINAL PLAN DATE
5/1/2015

DRAWN
MAD

CHECKED

REVISIONS

NO. DESCRIPTION

DATE

BY

REVIEWED PLOTTED BOUNDS

SCALE

DATE

BY

REVIEWED

DATE

BY

REVIEWED

DATE

BY

REVIEWED

DATE

BY

REVIEWED

DATE

BY

ENERGY MANAGEMENT
CPC DETAILS

EM-3

CO: NSI-TEMP-EMALING