



REVISIONS		
No.	Date	Description
01/22/18		50% OWNER REVIEW
01/25/18		ISSUED FOR PERMITTED

*ALL POWER RUNS TO BE INSTALLED AWAY FROM THE RACETRACK AT THE END OF THE GONDOLA.

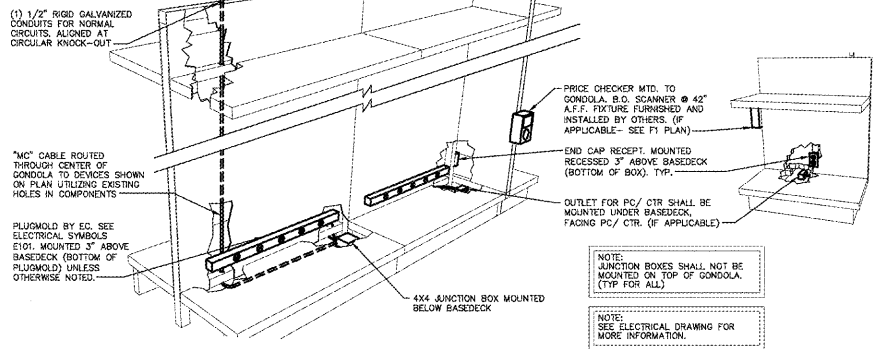

2 TALL GONDOLA DETAIL (7'-12' HIGH), TYP.
E103 SCALE: N.T.S.

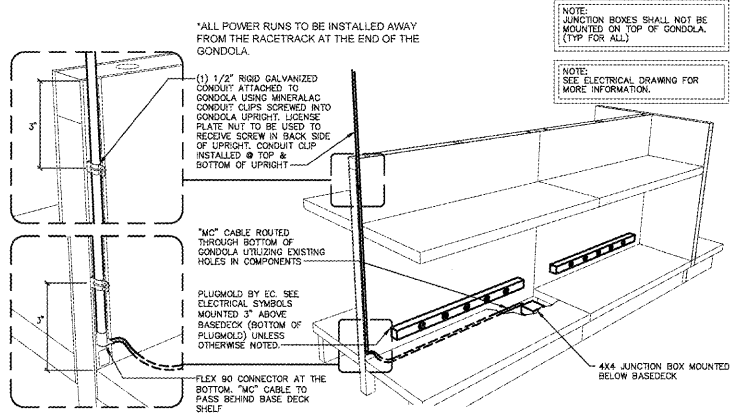


3 SHORT GONDOLA DETAIL (TYP.)
E103 SCALE: N.T.S.

ELECTRICAL KEYED NOTES	
No.	DESCRIPTION
1	STEELEMAN BRASS WHITE, 30 FT WHITE CORD, TRIP-TAP REEL, MOUNTED IN CEILING.
2	24 HOUR CIRCUIT UNDER BASE DECK FOR PRICE CHECKER, PRICE CHECKER DUPLEX SEPARATE FROM END CAP DUPLEX. SEE DETAIL 2/E103.
3	OUTLET FOR WINDOW BOX.
4	OUTLET FOR ILLUMINATED GRAPHICS/SEE ELEVATIONS 12 & 13 E201.
5	24 HOUR OUTLET, POWER & DATA DELIVERED VIA 2-COMPARTMENT POWER POLE.
6	24 HOUR OUTLET, EQUIPMENT ON A SEPARATE CIRCUIT FROM THE CASH REGISTER EQUIPMENT. SEE 2/201.
7	MILLWORK TO BE FURNISHED WITH OUTLETS FROM D&P CUSTOM LIGHTS AND WIRING SYSTEMS QUICK DISCONNECT SYSTEM WHILE TRU IS TO PROVIDE WIRING AND POWER CONDUCTORS FOR GC INSTALLATION AND COORDINATION. SEE 6/201.
8	MOUNT JUNCTION BOX TO UNDERSIDE OF EASEL. SEE 4/E103.
9	MOUNT OUTLET HORIZONTAL.
10	(1) 1\"/>

GENERAL NOTES

- ALL PLUGMOLD TO BE MOUNTED HORIZONTALLY/LEVEL. (E.L.C. TO PROVIDE PLUGMOLD - SEE ELECTRICAL DRAWINGS.)
 - POWER & DATA CONDUIT TO BE DROPPED AT THE REAR FOR FIXTURES.
 - ALL CONDUIT TO BE PRE-PAINTED WHITE PRIOR TO INSTALLATION.
- IT / DATA POWER NOTES - MANAGER'S WORKSTATION**
- MANAGER'S WORKSTATION WILL SIT ON FLOOR, FLUSH AGAINST REAR GONDOLA. POWER CABLES AND DATA PATCH CORDS WILL PLUG IN UNDERNEATH THE BASE DECK OF ENDCAP.
 - POWER NEEDS: DUPLEX I/O AND DUPLEX CONVENIENCE POWER. SEE ELECTRICAL DRAWINGS.
 - POWER OUTLETS MUST BE MOUNTED UNDERNEATH THE BASE DECK OF THE ENDCAP.
- IT / DATA POWER NOTES - PRICE CHECKER**
- PRICE CHECKER TO BE MOUNTED TO THE REAR OF THE FIXTURE EASEL.
 - SINGLE 110V 0.5 STRAIN RELIEF BLADE RECEPTACLE INSTALLED NOT TO BE VISIBLE ON SALES FLOOR. (E.L. UNDER THE FIXTURE.)
 - ALL PRICE CHECKERS TO BE MOUNTED TO THE TOP OF THE UNIT.

ELECTRICAL SYMBOLS	
RECEPTACLES/PLUGMOLD (MOUNTED 3\"/>	
□	QUAD RECEPTACLE
□	GENERAL PURPOSE DUPLEX RECEPTACLE
□	DUPLEX RECEPTACLE WITH TWO USB PORTS (CHARGING STATION)
•	POWER DROP
□	PLUG AND PLAY LIGHTING (4\"/>
□	PLUG AND PLAY LIGHTING (3\"/>

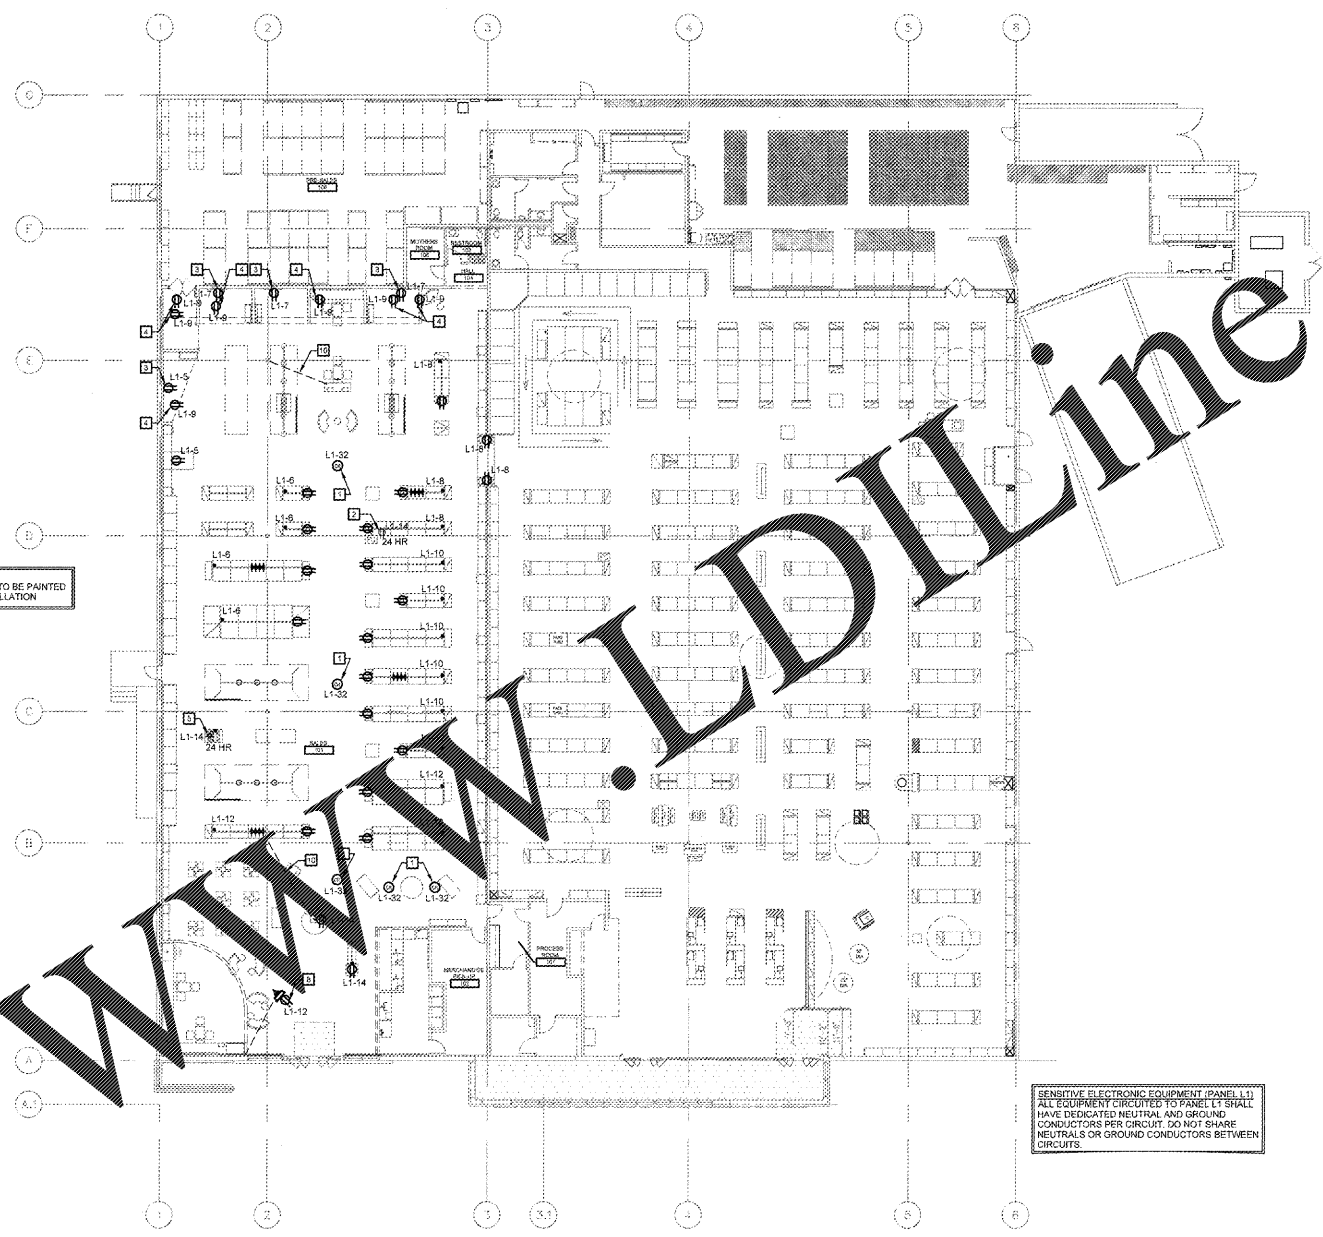

1 DISPLAY POWER & LIGHTING PLAN
E103 SCALE = 1/16\"/>



SENSITIVE ELECTRONIC EQUIPMENT (PANEL L1) ALL EQUIPMENT CIRCUITED TO PANEL L1 SHALL HAVE DEDICATED NEUTRAL AND GROUND CONDUCTORS PER CIRCUIT. DO NOT SHARE NEUTRALS OR GROUND CONDUCTORS BETWEEN CIRCUITS.

NO SUBSTITUTIONS SHALL BE ALLOWED UNLESS OTHERWISE NOTED (REFER TO SPECIFICATIONS)

DESIGNED FOR: FLORIDA BUILDING CODE, 6TH EDITION (2017).



BD DATE: 01/25/18 PROJECT NO: 918219
 CAD NAME: JSS PROJECT NO: 918219
 DRAWN BY: SA CHECKED BY: JSS
 PROTOTYPE



GLOBAL RESOURCE CENTER
 ONE GEOFFREY WAY
 WAYNE NJ 07470
 (973) 917-3500

THIS DRAWING IS THE EXCLUSIVE PROPERTY OF TOYS 'R' US. THE INFORMATION SHOWN MAY NOT BE USED NOR THE DRAWINGS REPRODUCED WITHOUT PERMISSION OF TOYS 'R' US.

Location
LAKELAND, FLORIDA
 3770 US HIGHWAY 98 NORTH 33809

Drawing Title
DISPLAY POWER & LIGHTING PLAN

Scale AS NOTED Date 1/25/18

Sheet No. **E103**