



CONSULTANT:

SEAL: HENRY D MONTAGUE, PE 78172

THIS DRAWING SHALL NOT BE USED FOR CONSTRUCTION PURPOSES UNTIL THE SEAL AND SIGNATURE OF THE RESPONSIBLE REGISTRANT APPEARS ON THE DRAWING, AND PROPER PERMIT FORMS AND RELATED FEES ARE TRANSMITTED BY THE OWNER, OWNER'S AGENT OR CONTRACTOR TO THE AUTHORITY HAVING JURISDICTION.

DATE	ISSUED FOR	REV
10/12/2017	PLANNING SUBMITTAL	
10/27/2017	PEMB COORDINATION	
12/15/2017	PLANNING RE-SUBMITTAL	
12/15/2017	PERMIT	

Project Manager B.COLBURN	Drawn N. NGUYEN
Project Leader B.COLBURN	Checked M. GOOD
Date 10/01/2017	Dept Mgr Approval M. GOOD

Client
Palmetto NFM - Hancock Bridge PKWY, LLC.
P.O. BOX 1615
THOMASVILLE, GA 31792
Office: (863) 808-1320
Contact: Jeff Lazenby

Project
DOLLAR GENERAL
4055 Hancock Bridge Parkway
North Fort Myers (Lee County), FL
Section 9, Township 44S., Range 24E.

Drawing Title

THREE PHASE
ELECTRICAL PANELS



DO NOT SCALE DRAWING

Project No. JCDT17.0313.00	Drawing No. E6
--------------------------------------	--------------------------

NOTES	MOUNT: SURFACE 120/208 3-PHASE, 4W					PANEL A		CAPACITY: 406A		INT CAP: 42KA		NOTES			
	LOCATION: BACK OF BLDG.	LTG	REC	HVAC	MISC	NP	DESCRIPTION	AMP	POLE	LTG	REC		HVAC	MISC	NP
	1						RTU 1	100	3						2
	3														4
	5														6
	7														8
	9						RTU 2	100	3						10
	11														12
	13														14
	15						GRINDER PUMP	20	3						16
	17														18
	19						SPARE	20	1						20
	21						WATER HEATER	20	1						22
	23						DRINKING FOUNTAIN	20	1						24
	25						OUTDOOR ICE REC	20	1						26
	27						COOLER #1	20	1						28
	29						COOLER #2	20	1						30
	31						COOLER #3	20	1						32
	33						COOLER #4	20	1						34
	35						COOLER #5	20	1						36
	37						SPARE	20	1						38
	39						SPARE	20	1						40
	41						SPARE	20	1						42

NOTES	MOUNT: SURFACE 120/208 3-PHASE, 4W					PANEL B		CAPACITY: 225A		INT CAP: 42KA		NOTES			
	LOCATION: BACK OF BLDG.	LTG	REC	HVAC	MISC	NP	DESCRIPTION	AMP	POLE	LTG	REC		HVAC	MISC	NP
	B/C	1					NIGHT LTS	20	1						2
	B/C	3					RECEIVING LTS	20	1						4
	B	5					70% SALES LTS	20	1						8
	B	7					70% SALES LTS	20	1						8
	B	9					70% SALES LTS	20	1						10
	B	11					70% SALES LTS	20	1						12
	B	13					30% SALES LTS	20	1						14
	B	15					30% SALES LTS	20	1						16
		17					SPARE	20	1						18
	C	19					EMERGENCYEXIT LTS	20	1						20
	C	21					BREAK/PRCE LTS/EFS	20	1						22
	B	23					BUILDING SIGN	20	1						24
	B	25					PYLON SIGN	20	1						26
	B	27					SITE LIGHTING	20	2						28
		29					SPARE	20	1						30
	B	33					EXTERIOR LTS	20	1						32
	B	36					PRNT WALL/CANPYLGT	20	1						34
	B	37					SPACE	1	A						36
	B	38					SPACE	1	B						40
	B	41					SPACE	1	C						42

PLAN MARK	EQUIPMENT SERVED	LOAD	VOLTY PHASE	FED BY	DISC BY	MCA	MOCPD	FEEBTR	REMARKS
RTU 1	ROOF TOP UNIT	31.70KVA	208/3	A	EC	88.0A	100	(3)X3,80G 1/4" C	PROVIDE 100A/3P DISCONNECT
RTU 2	ROOF TOP UNIT	31.70KVA	208/3	A	EC	88.0A	100	(3)X3,80G 1/4" C	PROVIDE 100A/3P DISCONNECT

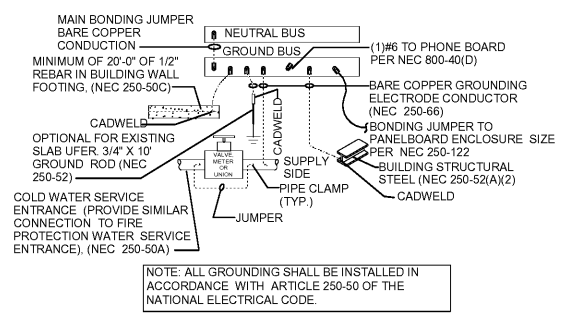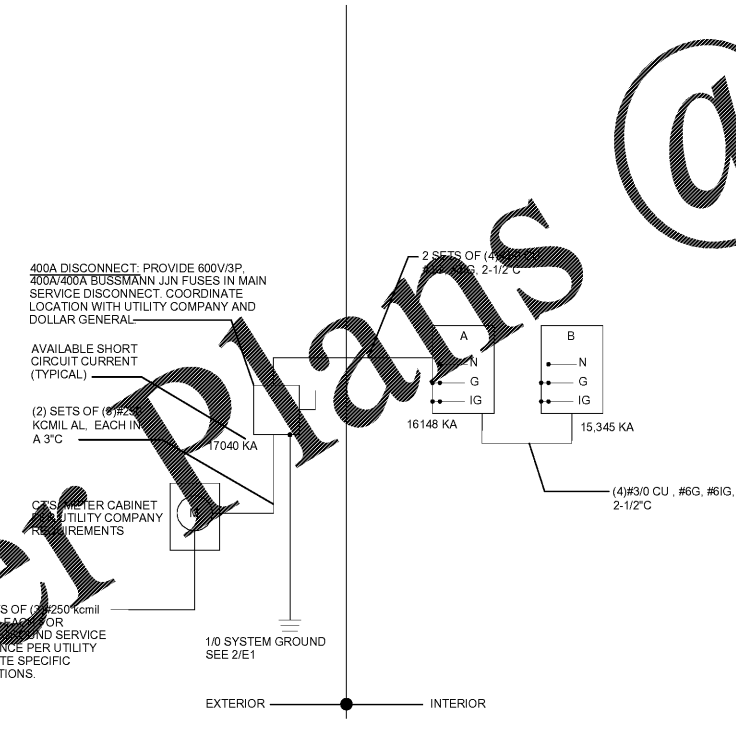

Order Plans @ WWW.LDLine.com