



- GENERAL NOTES:**
1. ALL COOLERS AND PREPARATION ROOM FLOOR SLABS SHALL BE POURED SEPARATE. PROVIDE CONTROL JOINT AT A MAXIMUM OF 12'-0" ON CENTER.
 2. PROVIDE LEVEL CONCRETE BEARING UNDER ALL COOLER AND FREEZER WALLS AND INTERIOR PARTITIONS.
 3. THE INTERFACE BETWEEN ANY PLUMBING OR ELECTRICAL COMPONENTS THAT WILL BE LEFT EXPOSED IN THE FINISHED FLOOR SHALL BE MADE SO THAT THERE IS NO CHANGE OF ELEVATION AT THE INTERFACE. THE ONLY EXCEPTION SHALL BE ANY NECESSARY RECESSING OF FLOOR DRAINS.
 4. TOP OF SLAB ELEVATION SHALL BE EQUAL TO DRAIN ELEVATION AT AREAS WITHOUT QUARRY TILE. TOP OF SLAB ELEVATION SHALL BE SET 5/8" LOWER THAN DRAIN ELEVATION AT AREAS WITH QUARRY TILE.
 5. CONDUITS AND PIPES EMBEDDED IN SLABS SHALL NOT BE LARGER IN OUTSIDE DIMENSION THAN ONE-THIRD THE OVERALL THICKNESS OF THE SLAB. SHALL NOT BE SPACED CLOSER THAN THREE DIAMETERS OR WIDTHS ON CENTER. A MINIMUM SLAB THICKNESS OF 6" MUST BE MAINTAINED OVER THE EMBEDDED ITEMS.
 6. CONTRACTOR TO PROVIDE ADDITIONAL SAW CUTS AS NEEDED AT CORNERS TO MINIMIZE SLAB CRACKING.
 7. CONTROL JOINT IN SIDEWALK TO BE TOGGLED AFTER BROOM FINISH CONCRETE.
 8. TRENCHES AND PITS REQUIRE COLOR CONC. AFTER ALL WORK HAS BEEN INSTALLED AND TESTED AND CONCRETE HAS CURED.
 9. ALL FLOOR RECEIVING TILE TO HAVE SAW CONTROL JOINTS AT 12'-0" O.C.
 10. PROVIDE CONSTRUCTION, CONTROL AND EXPANSION JOINTS AS REQUIRED IN AREAS NOT SPECIFICALLY ILLUSTRATED. REFERENCE SPECIFICATION SECTION 03 31 05 FOR SPECIFIC INFORMATION.
 11. WHERE SPECIFIC CONTROL/CONTRACTION JOINT LOCATIONS ARE NOT INDICATED FOR 6" THICK CONCRETE SLABS, PROVIDE CONTROL/CONTRACTION JOINTS AT A MAXIMUM SPACING OF 12'-0"x12'-0" O.C. SUCH THAT NO AREA EXCEEDS 144 SQUARE FEET NOR SHALL THE LENGTH OF ANY PANEL EXCEED 1.5 TIMES THE WIDTH.
 12. WHERE SPECIFIC CONTROL/CONTRACTION JOINT LOCATIONS ARE NOT INDICATED FOR CONCRETE SLABS GREATER THAN 6" THICK, PROVIDE CONTROL/CONTRACTION JOINTS AT A MAXIMUM SPACING OF 15'-0"x15'-0" O.C. SUCH THAT NO AREA EXCEEDS 225 SQUARE FEET NOR SHALL THE LENGTH OF ANY PANEL EXCEED 1.5 TIMES THE WIDTH.
 13. SUGGESTED LOCATIONS OF PITS AND PVC PIPES FOR THE ROUTING OF REFRIGERANT LINES NOT SHOWN IN PLAN. FIELD CONDITIONS TO BE VERIFIED FOR COMPLEXITY AND PRACTICALITY OF UTILIZING EXISTING ROUTIN. CARE SHOULD BE TAKEN IN ROUTING OF LINES TO MINIMIZE INTERFERENCE. WITH SLOUGHT OPENINGS. REFRIGERATION LINES NOT ROUTED UNDER FLOOR SHALL BE ROUTED AS HIGH AS PRACTICAL.

- KEY NOTES:**
- CONC 1) REPLACEMENT INTEGRAL COLORED CONCRETE. MATCH EXISTING CONTROL JOINTS. SEE ASD-69. QUESTMARK TO DYE AND POLISH CONCRETE, MATCH ADJACENT SURFACE COLOR.
 - CONC 2) NEW TRENCH/FLOOR DRAIN. COORDINATE LOCATION WITH PLUMBING SHEETS/PSD-34.
 - CONC 3) PROVIDE CONTROL JOINT AT 12'-0" O.C. MAX. AT PREP AREAS, DAIRY AND PRODUCE COOLER.
 - CONC 4) PROVIDE FLAT AREAS UNDER NEW DELI PREP WALLS.
 - CONC 5) STAINLESS STEEL FLASHING. SEE QSD - 14.
 - CONC 6) GC TO PROVIDE AND INSTALL NEW QUARRY TILES IN PREP AREA. MATCH EXISTING.
 - CONC 7) REPLACE EXISTING WOOD CURB WITH NEW CONCRETE CURB AT CORRIDOR BEHIND BAKERY.
 - CONC 8) INSTALL NEW CONCRETE CURB AT NORTH, WEST AND PORTIONS OF THE SOUTH WALL WITHIN THE MEAT PREP ROOM. REFER TO ASD-6 OR ASD-5A FOR DETAILS AND REINFORCING.

- CONC. FINISH NOTES:**
1. UNLESS INDICATED OTHERWISE, PROVIDE TROWEL FINISH ON CONC. SLAB UNDER CARPET FLOOR FINISHES. DO NOT APPLY SURFACE APPLICATIONS.
 2. PROVIDE SCRATCH FINISH ON CONC. SLAB UNDER CERAMIC TILE. DO NOT APPLY SURFACE APPLICATIONS.
 3. WET CURED CONCRETE, TYPICAL AT ALL RECESSED SLABS.

LEGEND

	INDICATES FINISHED CONCRETE SLAB ELEVATION.	TW :	TOP OF WALK ELEV.
	REPRESENTS FLOOR DRAIN.	FG :	FINISHED GRADE ELEV
	INDICATES FINISHED CONCRETE SLAB ELEVATION AT FLOOR DRAIN.	FFE :	FINISHED FLOOR ELEVATION
	CONCRETE SLAB - NEW OR REPLACED	TW+PVC :	TOP OF WALK-TOP OF PVC
		SPOT :	ELEVATION WITHOUT ABOVE NOTES DESIGNATES TOP OF FINISHMENT

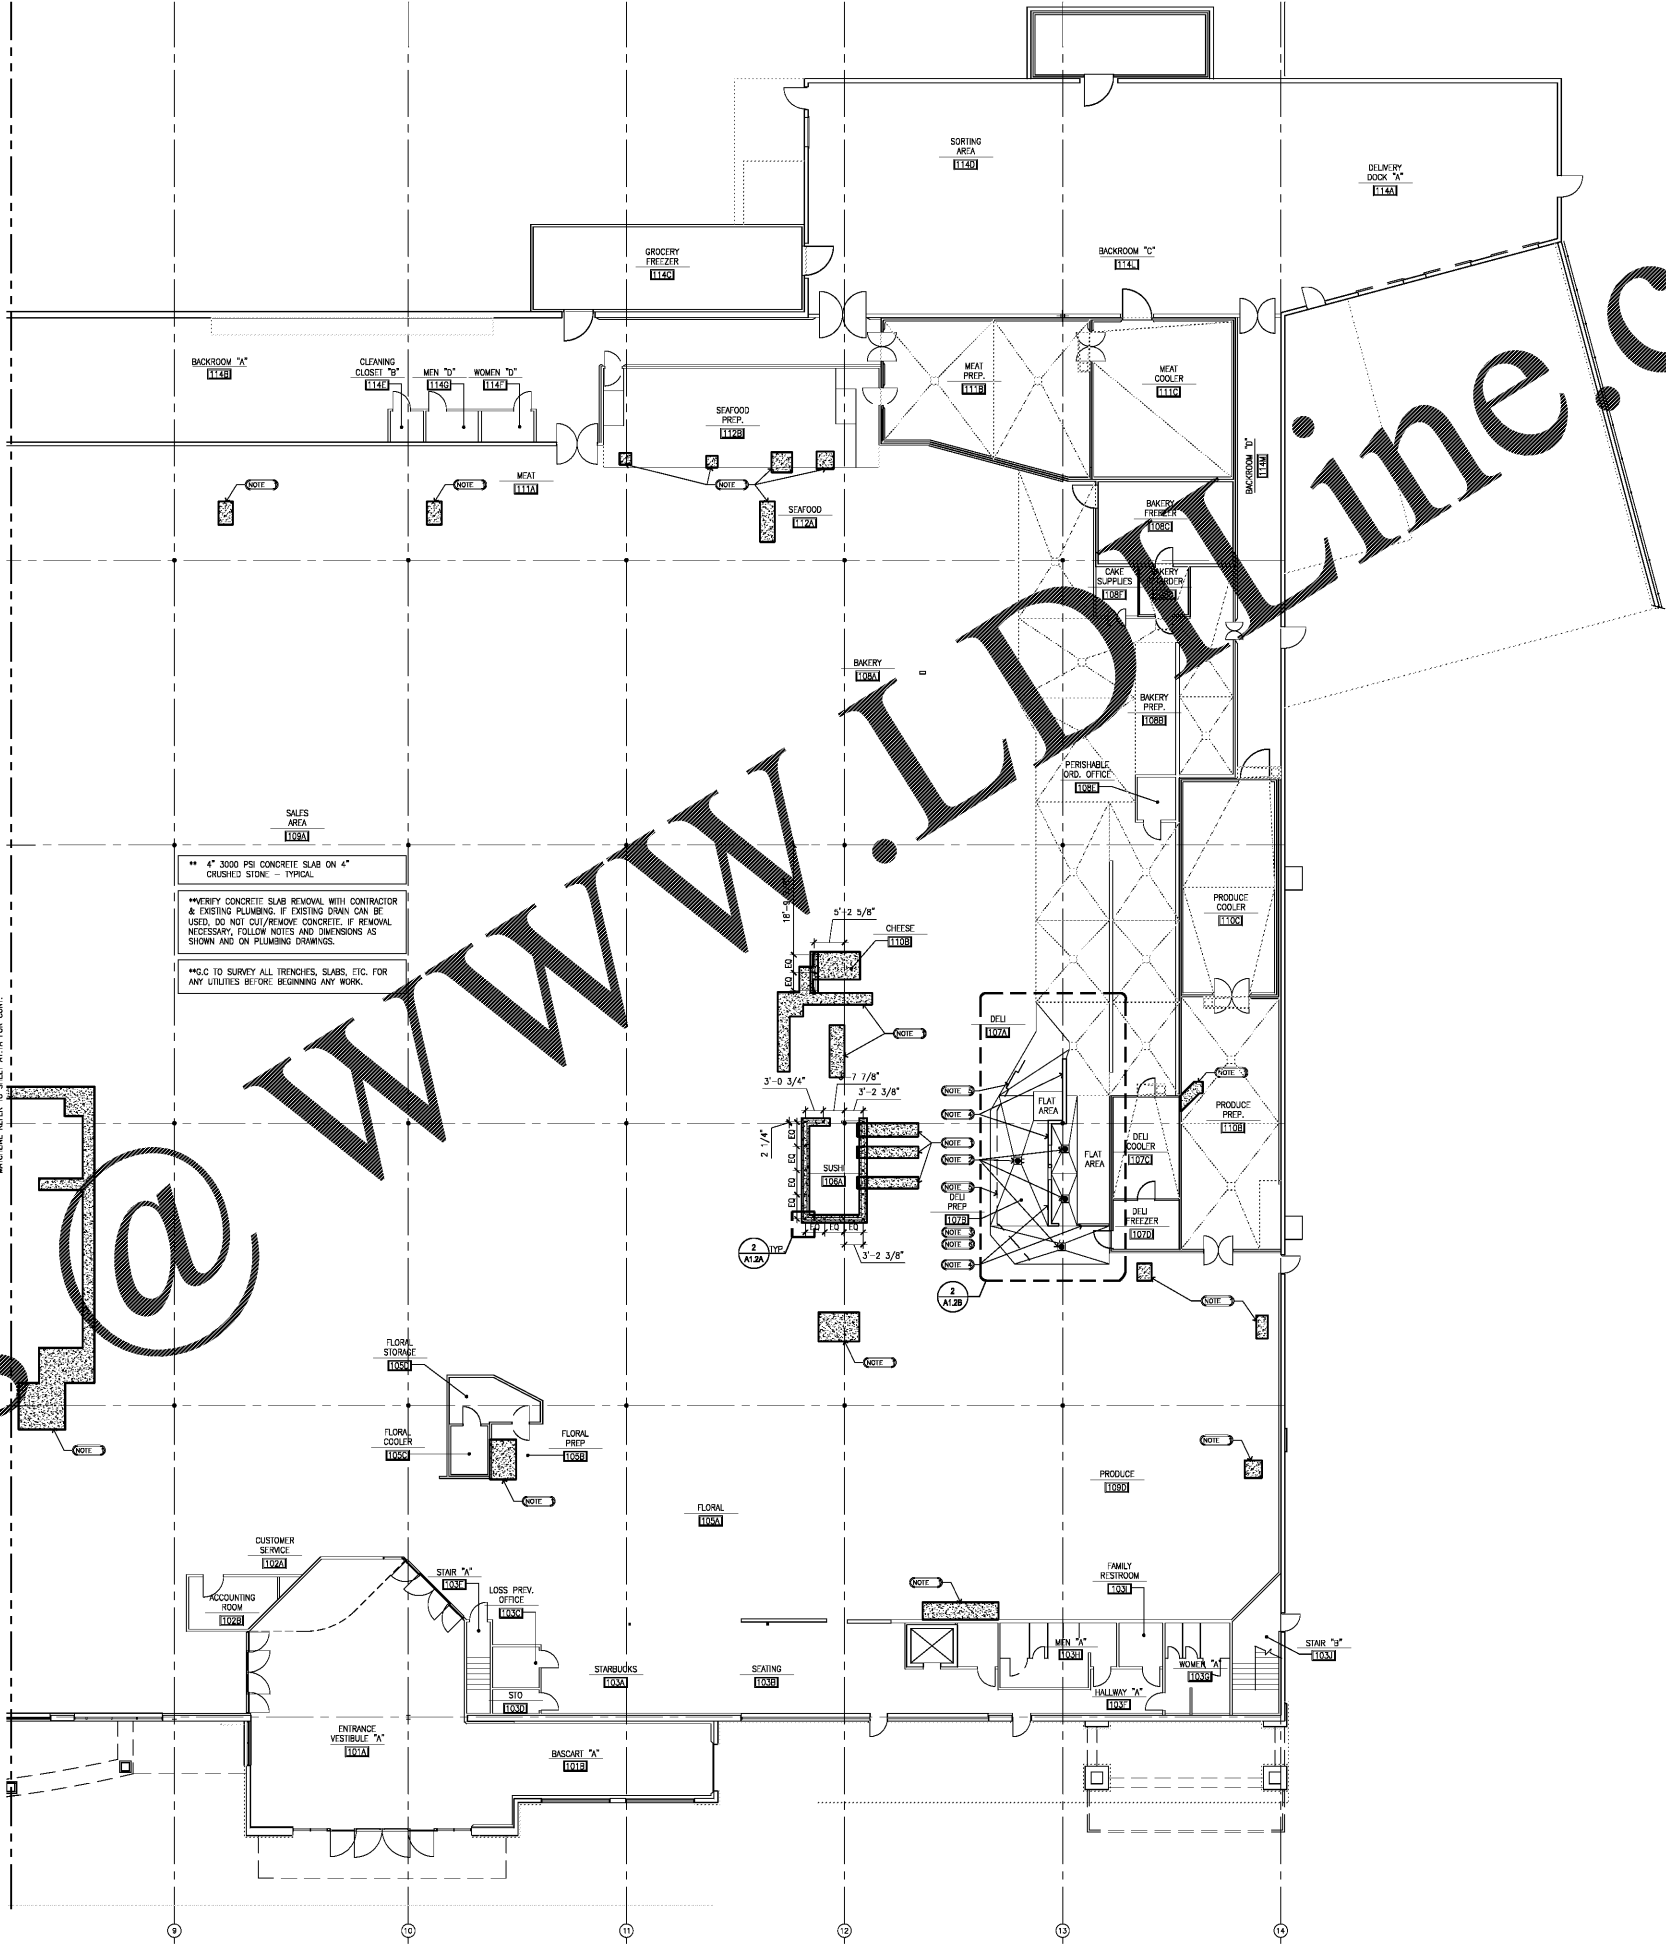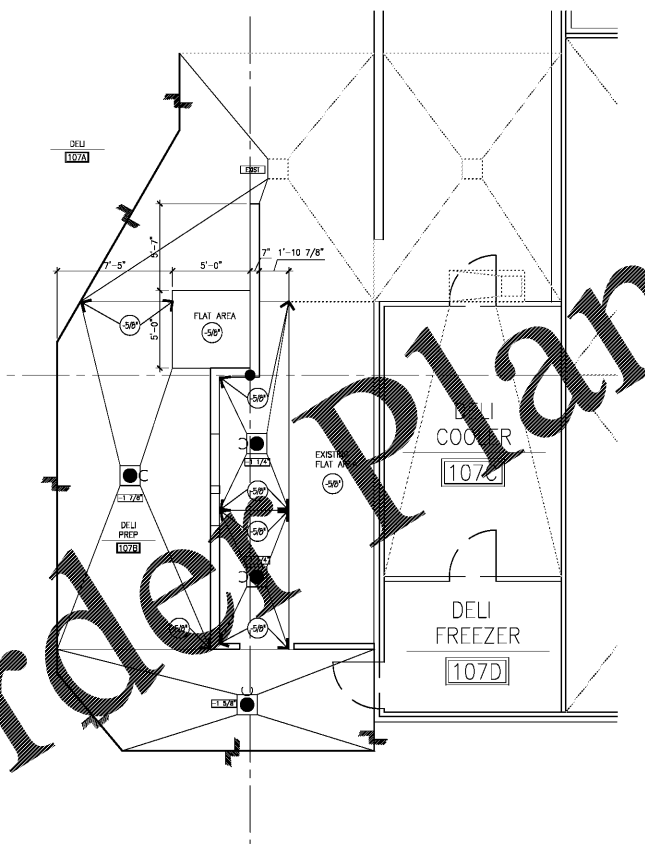

** 4" 3000 PSI CONCRETE SLAB ON 4" CRUSHED STONE - TYPICAL

*MAYBE CONCRETE SLAB REMOVAL WITH CONTRACTOR & EXISTING PLUMBING. IF EXISTING DRAIN CAN BE USED, DO NOT CUT/REMOVE CONCRETE. IF REMOVAL NECESSARY, FOLLOW NOTES AND DIMENSIONS AS SHOWN AND ON PLUMBING DRAWINGS.

*M.C. TO SURVEY ALL TRENCHES, SLABS, ETC. FOR ANY UTILITIES BEFORE BEGINNING ANY WORK.

2 ENLARGE CONCRETE PLACEMENT PLAN - DELI PREP
A1.2B SCALE: 3/32" = 1'-0"

1 CONCRETE PLACEMENT PLAN - RIGHT
A1.2B SCALE: 3/32" = 1'-0"

ROBERTSON LOIA ROOF ARCHITECTS & ENGINEERS
3460 Preston Highway, Suite 100, Atlanta, Georgia 30005
770-674-1100 Fax: 770-674-1101

THIS REPRODUCTION IS NOT A CERTIFIED DOCUMENT



Kroger L-407 - Remodel
3101 RICHMOND ROAD
LEXINGTON, KY
POE: The Kroger Company
1680 Omnisby Station Court, Louisville, KY 40223

REVISIONS

NO.	DESCRIPTION

SHEET TITLE
CONCRETE PLACEMENT PLAN - RIGHT

DATE: 01-25-18
PROJECT NUMBER: 17-125

SHEET NUMBER: **A1.2B**

Order Plans @

WWW.LDOnline.com