DEMOLITION KEYNOTE LEGEND

Key Value	Keynote Text
D1	EXISTING REFRIGERATED CASE(S) TO BE REPLACED. MAINTAIN ALL EXISTING POWER CIRCUITS (FANS, LIGHTS, ANTISWEATS) AND REFRIGERATION CIRCUITS (DEFROST, CONTROL, ETC.) AS REQUIRED FOR CONNECTION TO NEW CASE(S). REUSE EXISTING CONDUIT, JUNCTION BOXES, ETC. WHERE POSSIBLE. SEE POWER PLAN FOR MORE INFORMATION.
D3	EXISTING EQUIPMENT TO BE RELOCATED. EXTEND ALL ELECTRICAL CIRCUITS TO NEW LOCATION AS REQUIRED. REUSE EXISTING CONDUIT, JUNCTION BOXES, CORD DROPS, ETC. WHERE POSSIBLE. WHERE CONDUIT IS STUBBED UP IN SALES FLOOR, CUT CONDUIT FLUSH WITH FLOOR AND CAP. SEE POWER PLAN FOR MORE INFORMATION.
D4	EXISTING EQUIPMENT TO BE DEMOLISHED. REMOVE ALL ASSOCIATED ELECTRICAL DEVICES (WIRING, ETC.) BACK TO PANEL AND LABEL BREAKER AS SPARE. SEE POWER PLAN FOR NEW EQUIPMENT POWER REQUIREMENTS AT THIS LOCATION. REUSE EXISTING CONDUIT WHERE POSSIBLE.
D8	EXISTING EQUIPMENT TO BE REPLACED. MAINTAIN ALL ELECTRICAL CIRCUITRY (POWER, LOW VOLTAGE, ETC.) FOR CONNECTION TO NEW EQUIPMENT. REUSE EXISTING CONDUIT, JUNCTION BOXES, ETC. WHERE POSSIBLE. SEE POWER PLAN FOR MORE INFORMATION.
D12	EXISTING REFRIGERATED CASE(S) TO BE RELOCATED. EXTEND ALL EXISTING POWER CIRCUITS (FANS, LIGHTS, ANTISWEATS) AND REFRIGERATION CIRCUITS (DEFROST, CONTROL, ETC.) TO NEW LOCATION FOR CONNECTION TO NEW CASE(S). REUSE EXISTING CONDUIT, JUNCTION BOXES, ETC. WHERE POSSIBLE. WHERE APPLICABLE, EXISTING LIGHT FIXTURES MOUNTED ON TOP OF CASE ARE TO BE REUSED. WHERE EXHAUST FANS ARE INSTALLED ONBEHIND GLASS DOOR CASES THEY ARE TO BE REUSED. PERFORM ALL ELECTRICAL WORK AS REQUIRED FOR REUSE OF LIGHT FIXTURES AND EXHAUST FANS. FOR SEE POWER PLAN FOR MORE INFORMATION.
D13	EXISTING CHECKSTAND REFRIGERATED MERCHANDISER TO BE REPLACED. EXISTING CIRCUIT TO BE REROUTED OVERHEAD TO FEED NEW CHECKSTAND. SEE POWER PLANS FOR MORE INFORMATION.
D14	EXISTING CHECKLANE IS TO BE REPLACED. DISCONNECT AND MAINTAIN ALL ELECTRICAL CIRCUITRY (POWER, LOW VOLTAGE, ETC.) FOR CONNECTION TO NEW CHECKLANE. SEE POWER PLAN FOR MORE INFORMATION.
D15	EXISTING CHECKSTAND TO BE RELOCATED. EXISTING CIRCUITS TO BE REROUTED OVERHEAD TO FEED RELOCATED CHECKSTAND. EXTEND ALL ELECTRICAL CIRCUITS TO NEW LOCATION AS REQUIRED. REUSE EXISTING CONDUIT, JUNCTION BOXES, CORD DROPS, ETC. WHERE POSSIBLE. SEE POWER PLANS FOR MORE INFORMATION.
D16	EXISTING CHECKSTAND TO BE DEMOLISHED. REMOVE ALL ASSOCIATED ELECTRICAL DEVICES (CONDUIT, WIRING, ETC.) BACK TO PANEL AND LABEL BREAKER AS SPARE. MAINTAIN OPERATION OF ALL EXISTING ELECTRICAL SYSTEMS AND SUBSYSTEMS TO REMAIN. WHERE CONDUIT IS STUBBED UP IN SALES FLOOR, CUT CONDUIT FLUSH WITH FLOOR AND CAP.

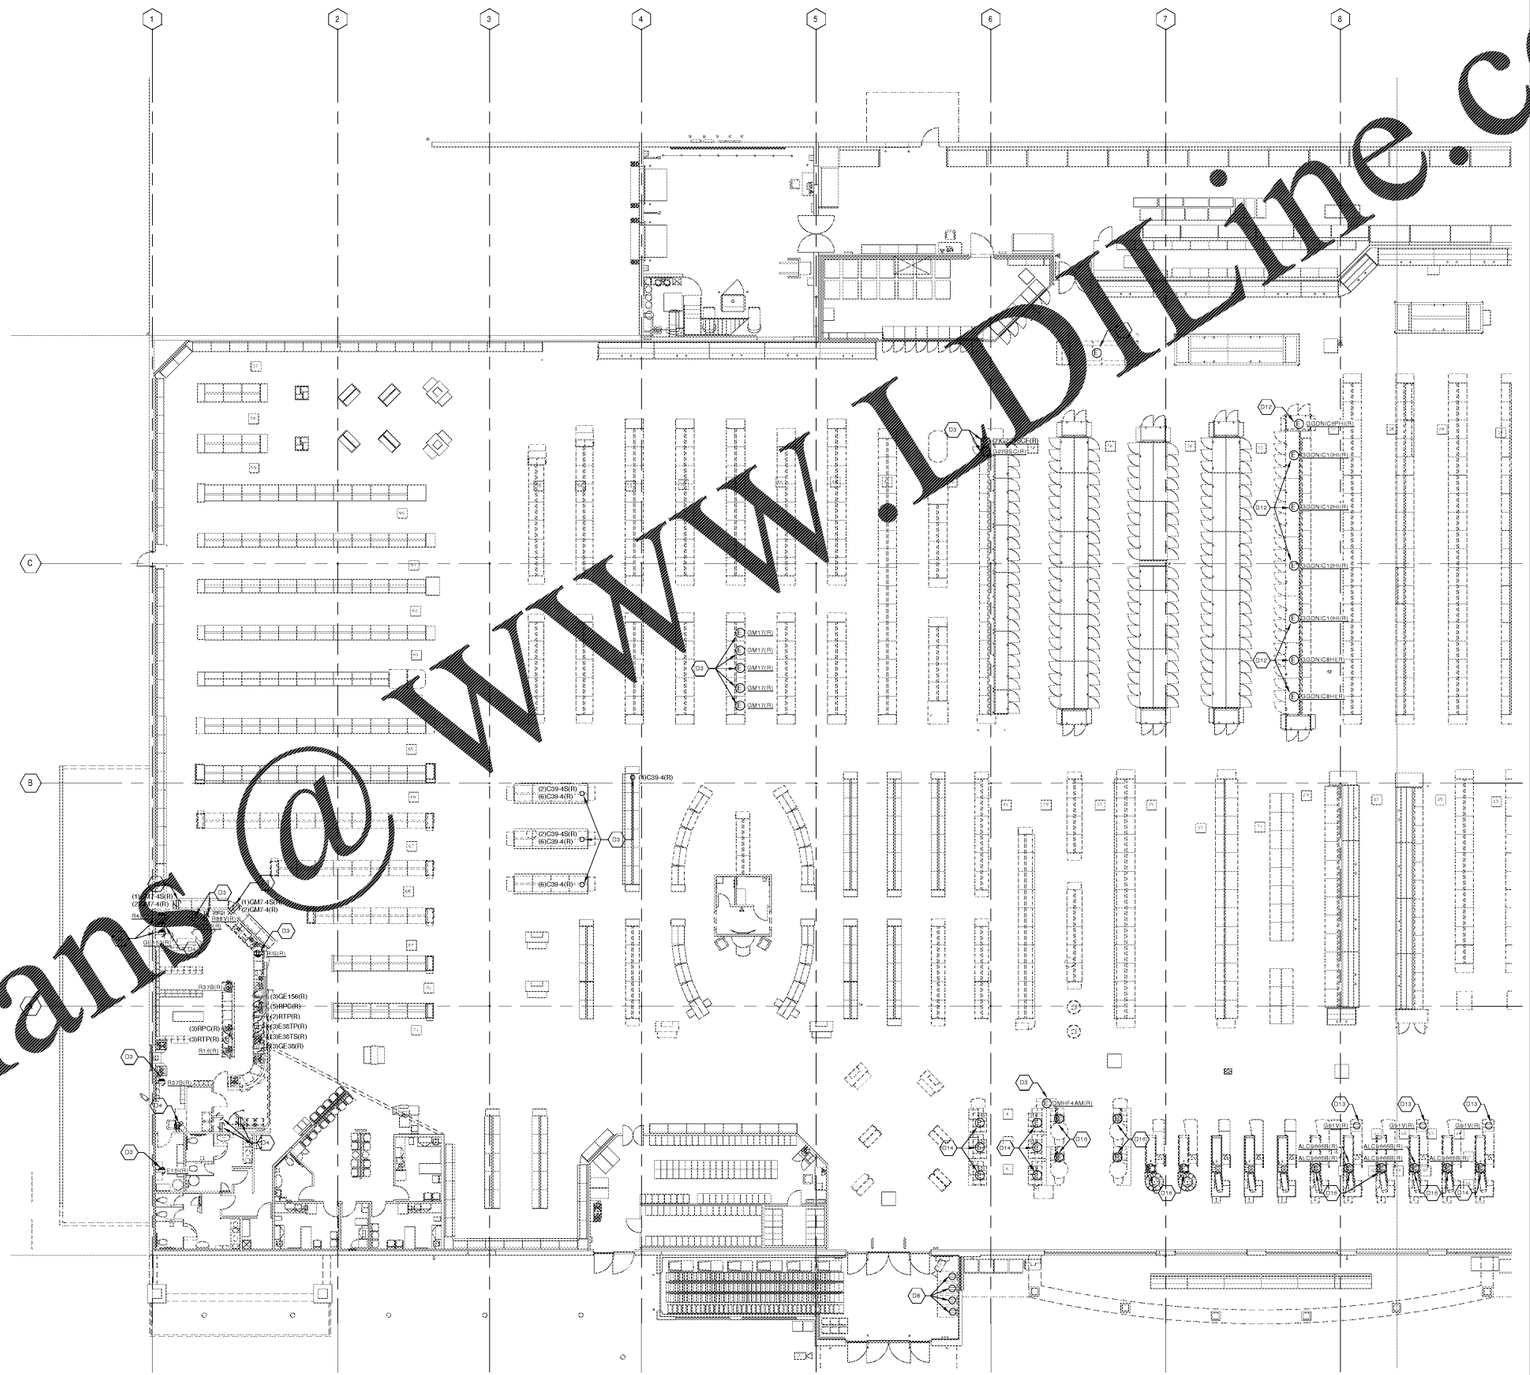

POWER DEMOLITION PLAN - LEFT
3/32" = 1'-0"

ROBERTSON LOIA ROOF
ARCHITECTS & ENGINEERS
3420 Holcomb Bridge Road, Suite 275 Alpharetta, GA 30005
770.674.3602 www.rlrarchitects.com

THIS REPRODUCTION IS NOT A CERTIFIED DOCUMENT

Kroger L-407 - Remodel
3101 RICHMOND ROAD
LEXINGTON, KY

FOR:
The Kroger Company
1600 Ormsby Station Court, Louisville, KY 40223

REVISIONS

DESCRIPTION
POWER DEMOLITION PLAN - LEFT

DATE
01-25-18

PROJECT NUMBER
17-125

SHEET NUMBER
ED1.2A

Order Plans @ WWW.LDLine.com