


Key Value	Keynote Text
D1	EXISTING REFRIGERATED CASE(S) TO BE REPLACED. MAINTAIN ALL EXISTING POWER CIRCUITS (FANS, LIGHTS, ANTISWEATS) AND REFRIGERATION CIRCUITS (DEFROST, CONTROL, ETC.) AS REQUIRED FOR CONNECTION TO NEW CASE(S). REUSE EXISTING CONDUIT, JUNCTION BOXES, ETC. WHERE POSSIBLE. SEE POWER PLAN FOR MORE INFORMATION.
D2	EXISTING EQUIPMENT TO BE DEMOLISHED. REMOVE ALL ASSOCIATED ELECTRICAL DEVICES (CONDUIT, WIRING, ETC.) BACK TO PANEL AND LABEL BREAKER AS SPARE. MAINTAIN OPERATION OF ALL EXISTING ELECTRICAL SYSTEMS AND SUBSYSTEMS TO REMAIN. WHERE CONDUIT IS STUBBED UP IN SALES FLOOR, CUT CONDUIT FLUSH WITH FLOOR AND CAP.
D3	EXISTING EQUIPMENT TO BE RELOCATED. EXTEND ALL ELECTRICAL CIRCUITS TO NEW LOCATION AS REQUIRED. REUSE EXISTING CONDUIT, JUNCTION BOXES, CORD DROPS, ETC. WHERE POSSIBLE. WHERE CONDUIT IS STUBBED UP IN SALES FLOOR, CUT CONDUIT FLUSH WITH FLOOR AND CAP. SEE POWER PLAN FOR MORE INFORMATION.
D4	EXISTING EQUIPMENT TO BE DEMOLISHED. REMOVE ALL ASSOCIATED ELECTRICAL DEVICES (WIRING, ETC.) BACK TO PANEL AND LABEL BREAKER AS SPARE. SEE POWER PLAN FOR NEW EQUIPMENT POWER REQUIREMENTS AT THIS LOCATION. REUSE EXISTING CONDUIT WHERE POSSIBLE.
D5	EXISTING GUSH ISLAND TO BE REPLACED. MAINTAIN ALL EXISTING POWER CIRCUITS (FANS, LIGHTS, ANTISWEATS) AND REFRIGERATION CIRCUITS (DEFROST, CONTROL, ETC.) AS REQUIRED FOR CONNECTION TO NEW CASE(S). MAINTAIN ALL ELECTRICAL CIRCUITRY (POWER, LOW VOLTAGE, ETC.) FOR CONNECTION TO NEW EQUIPMENT. REUSE EXISTING CONDUIT, JUNCTION BOXES, ETC. WHERE POSSIBLE. SEE POWER PLAN FOR MORE INFORMATION.
D6	EXISTING EQUIPMENT TO BE RELOCATED. REUSE EXISTING CONDUIT, JUNCTION BOXES, CORD DROPS, ETC. WHERE POSSIBLE. WHERE CONDUIT IS STUBBED UP IN SALES FLOOR, CUT CONDUIT FLUSH WITH FLOOR AND CAP. SEE POWER PLAN FOR MORE INFORMATION.
D7	EXISTING FLORAL WORKSTATION TO BE REPLACED. MAINTAIN ALL ELECTRICAL CIRCUITRY (POWER, LOW VOLTAGE, ETC.) FOR CONNECTION TO NEW EQUIPMENT. REUSE EXISTING CONDUIT, JUNCTION BOXES, ETC. WHERE POSSIBLE. SEE POWER PLAN FOR MORE INFORMATION.
D8	EXISTING EQUIPMENT TO BE RELOCATED. MAINTAIN ALL ELECTRICAL CIRCUITRY (POWER, LOW VOLTAGE, ETC.) FOR CONNECTION TO NEW EQUIPMENT. REUSE EXISTING CONDUIT, JUNCTION BOXES, ETC. WHERE POSSIBLE. SEE POWER PLAN FOR MORE INFORMATION.
D9	EXISTING REFRIGERATED CASE(S) TO BE DEMOLISHED. REMOVE ALL ASSOCIATED ELECTRICAL DEVICES (CONDUIT, WIRING, ETC.) BACK TO PANEL AND LABEL BREAKER AS SPARE. MAINTAIN OPERATION OF ALL EXISTING ELECTRICAL SYSTEMS AND SUBSYSTEMS TO REMAIN. WHERE CONDUIT IS STUBBED UP IN SALES FLOOR, CUT CONDUIT FLUSH WITH FLOOR AND CAP. SEE POWER PLAN FOR MORE INFORMATION.
D10	EXISTING REFRIGERATED CASE(S) TO BE DEMOLISHED. EXTEND ALL EXISTING POWER CIRCUITS (FANS, LIGHTS, ANTISWEATS) AND REFRIGERATION CIRCUITS (DEFROST, CONTROL, ETC.) AS REQUIRED FOR CONNECTION TO NEW CASE(S). REUSE EXISTING CONDUIT, JUNCTION BOXES, ETC. WHERE POSSIBLE. SEE POWER PLAN FOR MORE INFORMATION.
D11	EXISTING STANDOFFS TO BE DEMOLISHED. WHERE CONDUIT IS STUBBED UP IN SALES FLOOR, CUT CONDUIT FLUSH WITH FLOOR AND CAP. SEE POWER PLAN FOR MORE INFORMATION.
D12	EXISTING REFRIGERATED CASE(S) TO BE RELOCATED. EXTEND ALL EXISTING POWER CIRCUITS (FANS, LIGHTS, ANTISWEATS) AND REFRIGERATION CIRCUITS (DEFROST, CONTROL, ETC.) TO NEW LOCATION FOR CONNECTION TO NEW CASE(S). REUSE EXISTING CONDUIT, JUNCTION BOXES, ETC. WHERE POSSIBLE. WHERE APPLICABLE, EXISTING LIGHT FIXTURES MOUNTED ON TOP OF CASE ARE TO BE REUSED. WHERE EXHAUST FANS ARE INSTALLED ON BEHIND GLASS DOOR CASES THEY ARE TO BE REUSED PERFORM ALL ELECTRICAL WORK AS REQUIRED FOR REUSE OF LIGHT FIXTURES AND EXHAUST FANS. FOR SEE POWER PLAN FOR MORE INFORMATION.
D13	EXISTING CHECKSTAND REFRIGERATED MERCHANDISER TO BE REPLACED. EXISTING CIRCUIT TO BE RETIRED OVERHEAD TO FEED NEW CHECKSTAND. SEE POWER PLAN FOR MORE INFORMATION.
D14	EXISTING CHECKCLANE IS TO BE REPLACED. DISCONNECT AND MAINTAIN ALL ELECTRICAL CIRCUITRY (POWER, LOW VOLTAGE, ETC.) FOR CONNECTION TO NEW CHECKCLANE. SEE POWER PLAN FOR MORE INFORMATION.
D15	EXISTING FREEZE ISLAND TO BE REPLACED. MAINTAIN ALL EXISTING POWER CIRCUITS (FANS, LIGHTS, ANTISWEATS) AND REFRIGERATION CIRCUITS (DEFROST, CONTROL, ETC.) AS REQUIRED FOR CONNECTION TO NEW CASE(S). MAINTAIN ALL ELECTRICAL CIRCUITRY (POWER, LOW VOLTAGE, ETC.) FOR CONNECTION TO NEW EQUIPMENT. REUSE EXISTING CONDUIT, JUNCTION BOXES, ETC. WHERE POSSIBLE. SEE POWER PLAN FOR MORE INFORMATION.
D16	EXISTING FRYER TO BE REPLACED. MAINTAIN ALL ELECTRICAL CIRCUITRY (POWER, LOW VOLTAGE, ETC.) FOR CONNECTION TO NEW EQUIPMENT. REUSE EXISTING CONDUIT, JUNCTION BOXES, ETC. WHERE POSSIBLE. SEE POWER PLAN FOR MORE INFORMATION.

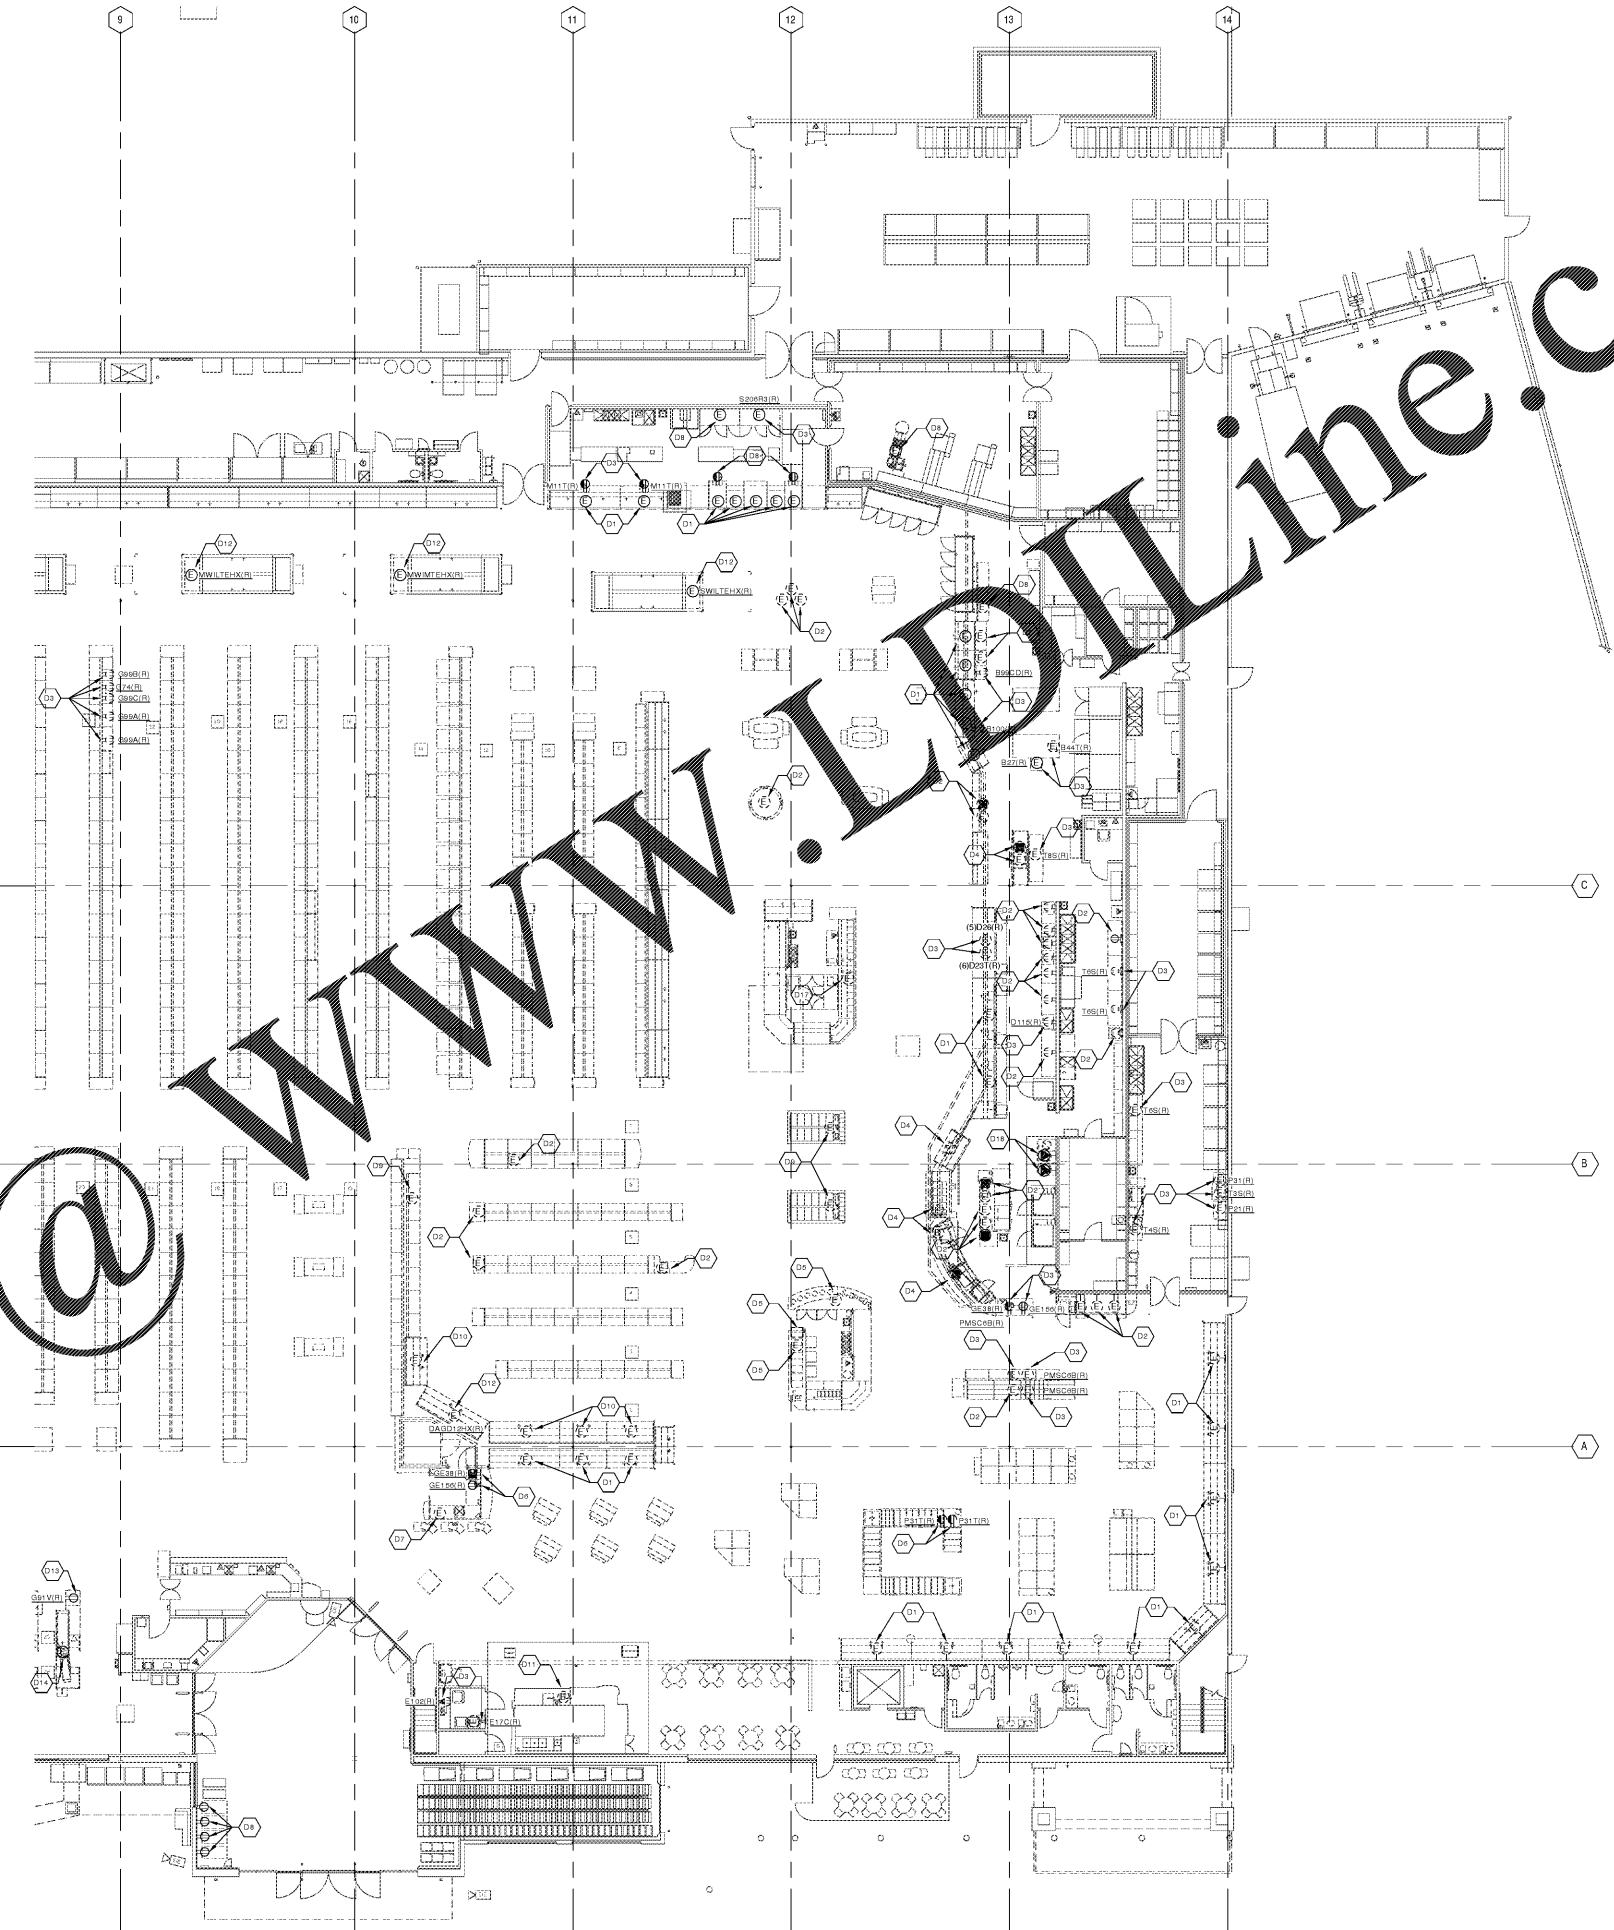

Order Plans

POWER DEMOLITION PLAN - RIGHT
17-125
3/22 - 1'-0"

ROBERSON LOJA ROOF
ARCHITECTS & ENGINEERS
3450 N. Shiloh Ridge Parkway, Suite 275, Alpharetta, GA 30008
770.994.2600

THIS REPRODUCTION IS NOT A CERTIFIED DOCUMENT



Kroger L-407 - Remodel
3701 RICHMOND ROAD
LEXINGTON, KY

FOR:
The Kroger Company
1600 Ombsy Station Court, Louisville, KY 40223

REVISIONS

POWER DEMOLITION
PLAN - RIGHT

01-25-18

17-125

ED1.2B