


LIGHTING FIXTURE SCHEDULE						
COUNT	MARK	DESCRIPTION	MANUFACTURER	MODEL	MOUNTING	FIXTURE USAGE
11	A	4 FOOT TRACK	COOPER (HALO)	RE4H 4 FOOT TRACK	CEILING MOUNT	TRACK PART FOR THE TRACK HEAD FIXTURES
14	B	TRACK PART FOR THE TRACK HEAD FIXTURES (T8)	COOPER (HALO)	0208H 4 FOOT TRACK	CEILING MOUNT	TRACK PART FOR THE TRACK HEAD FIXTURES
16	C	12 FOOT TRACK	COOPER (HALO)	0808H 12 FOOT TRACK	CEILING MOUNT	TRACK PART FOR THE TRACK HEAD FIXTURES
5	C	RECESSED 2'x4' W (2) T8 LAMPS & (1) INSTANT START BALLAST, PARABOLIC LENS W/BLACK REVEAL, GRID CEILING	COOPER (METALUX)	8P90X-3208R1-UNV-QH3-K20NSC	CEILING MOUNT	PHARMACY
2	C1	RECESSED 2'x4' W (2) T8 LAMPS & (1) INSTANT START BALLAST, PARABOLIC LENS W/BLACK REVEAL, GRID CEILING	COOPER (METALUX)	8P90X-3208R1-UNV-QH3-K20NSC	CEILING MOUNT	PHARMACY
2	CL10	CURRENT LIMITER	EATON	CB01CB100	CEILING MOUNT	WINE, PRODUCE, FLORAL
14	CL11	CURRENT LIMITER	EATON	CB01CB100	CEILING MOUNT	WINE, PRODUCE, FLORAL
18	CL12	CURRENT LIMITER	EATON	CB01CB100	CEILING MOUNT	WINE, PRODUCE, FLORAL
2	CL13	CURRENT LIMITER	EATON	CB01CB100	CEILING MOUNT	WINE, PRODUCE, FLORAL
1	CL14	CURRENT LIMITER	EATON	CB01CB100	CEILING MOUNT	WINE, PRODUCE, FLORAL
1	CL15	CURRENT LIMITER	EATON	CB01CB100	CEILING MOUNT	WINE, PRODUCE, FLORAL
1	CL16	CURRENT LIMITER	EATON	CB01CB100	CEILING MOUNT	WINE, PRODUCE, FLORAL
1	3	4' x 2' STRIP FLUORESCENT W (2) T8 LAMPS	COOPER (METALUX)	8T50F-320-UNV-QH4-K20NSC	CEILING MOUNT	REFRIGERATED FRESH MEAT AND DELI ISLAND CASES, FLORAL - REFER TO PLAN FOR LENGTH OF LIGHTING FIXTURE
1	K3-BF	AIRCRAFT CABLE HUNG, (4) T8 LAMPS W/ SILVER PARABOLIC LOUVER IN SILVER FINISH	COOPER (GORELITE)	N8-SW-278-1-C-UNV-AC20-S-7-08-DL1-CARDINAL SILVER 7305-GR028	SUSPENDED 7'-0"	REFRIGERATED FRESH MEAT AND DELI ISLAND CASES, FLORAL - REFER TO PLAN FOR LENGTH OF LIGHTING FIXTURE
1	K3-RBT	AIRCRAFT CABLE HUNG, (4) T8 LAMPS W/ SILVER PARABOLIC LOUVER IN SILVER FINISH	COOPER (GORELITE)	N8-SW-278-1-C-UNV-AC20-S-7-10-DL1-CARDINAL SILVER 7305-GR028	SUSPENDED 7'-0"	REFRIGERATED FRESH MEAT AND DELI ISLAND CASES, FLORAL - REFER TO PLAN FOR LENGTH OF LIGHTING FIXTURE
2	L17	4" LED RECESSED IN CEILING TILE DOWNLIGHT, NSF APPROVED (3000 LUMEN)	COOPER (PORTFOLIO)	FLD3A3D101TE FERMA33033 FERLM1W94 H088	RECESSED	PREP AREA
2	M13	2 FT VAPOR TIGHT LED LIGHT FIXTURE - 4100K	COOPER	2FT2-LD-3 OR UNV-L843-C 21-W-L-U	SURFACE MOUNT	ALL REFRIG COOLERS, RETARDERS & FREEZER BENCHES & FLORAL COOLER (NEIGHBORHOOD)
133	TR29	LED TRACK MOUNT ACCENT LIGHT, NARROW FLOOD BEAM SPREAD (24°)	COOPER (HALO)	3-0822NF-0103A1H (B) LVER-1	CEILING MOUNT	WINE, PRODUCE, FLORAL
113	TR30		COOPER (HALO)			

RELOCATED LIGHTING FIXTURE SCHEDULE						
COUNT	MARK	DESCRIPTION	MANUFACTURER	MODEL	MOUNTING	FIXTURE USAGE
5	C1(R)	RECESSED 2'x4' W (2) T8 LAMPS & (1) INSTANT START BALLAST, PARABOLIC LENS W/BLACK REVEAL, GRID CEILING	COOPER (METALUX)	8P90X-3208R1-UNV-QH3-K20NSC	CEILING MOUNT	PHARMACY
3	C2(R)	EXISTING TO BE RELOCATED, RECESSED 2'x4' W (2) T8 LAMPS & (1) INSTANT START BALLAST, PARABOLIC LENS W/BLACK REVEAL, GRID CEILING	COOPER (METALUX)	8P90X-3208R1-UNV-QH3-K20NSC	CEILING MOUNT	PHARMACY
4	D1(R)	4' x 2' STRIP FLUORESCENT W (2) T8 LAMPS (1) INSTANT START BALLAST	COOPER (METALUX)	8T50F-320-UNV-QH4-K20NSC	CEILING MOUNT	REFRIGERATED FRESH MEAT AND DELI ISLAND CASES, FLORAL - REFER TO PLAN FOR LENGTH OF LIGHTING FIXTURE
4	D2(R)	4' x 2' STRIP FLUORESCENT W (2) T8 LAMPS (1) INSTANT START BALLAST	COOPER (METALUX)	8T50F-320-UNV-QH4-K20NSC	CEILING MOUNT	REFRIGERATED FRESH MEAT AND DELI ISLAND CASES, FLORAL - REFER TO PLAN FOR LENGTH OF LIGHTING FIXTURE

LIGHTING KEYNOTE LEGEND	
Key Value	Keynote Text
1	CONNECT NEW/RELOCATED LIGHT FIXTURE TO EXISTING NON-EMERGENCY CIRCUIT AND CONTROLS SERVING THIS AREA. CONTRACTOR TO VERIFY THAT CIRCUIT WILL NOT BE OVERLOADED BY ADDITION OF NEW FIXTURE(S). PROVIDE NEW CIRCUIT FROM THE SAME PANEL IF REQUIRED. MAKE ALL FINAL CONNECTIONS.
2	CONNECT NEW/RELOCATED LIGHT FIXTURE TO EXISTING EMERGENCY CIRCUIT SERVING THIS AREA. CONTRACTOR TO VERIFY THAT CIRCUIT WILL NOT BE OVERLOADED BY ADDITION OF NEW FIXTURE(S). PROVIDE NEW CIRCUIT FROM THE SAME PANEL IF REQUIRED. MAKE ALL FINAL CONNECTIONS.
3	CONNECT NEW/RELOCATED LIGHT FIXTURE TO EXISTING CIRCUIT SERVING THE ADJACENT OVERHEAD ISLAND LIGHTING FIXTURE. CONTRACTOR TO VERIFY THAT CIRCUIT WILL NOT BE OVERLOADED BY ADDITION OF NEW FIXTURE(S). PROVIDE NEW CIRCUIT FROM THE SAME PANEL IF REQUIRED. MAKE ALL FINAL CONNECTIONS.
4	EXISTING LIGHT FIXTURE TO BE RELOCATED. EXTEND EXISTING CIRCUIT TO NEW LOCATION. SWITCHING OF FIXTURE TO REMAIN AS IS. MAKE ALL FINAL CONNECTIONS.
5	RELOCATE EXISTING APPAREL PENDANT FIXTURES TO ALIGN WITH REMAINDER PENDANTS.

**LIGHTING FIXTURE NOTE LEGEND**  
 ALL LIGHT FIXTURES NOT SHOWN ARE EXISTING TO REMAIN UNLESS NOTED OTHERWISE:  
 N - NEW FIXTURE  
 R - FIXTURE TO BE RELOCATED. REFER TO LIGHTING DEMOLITION PLAN FOR PREVIOUS LOCATION.  
 RA - FIXTURE TO BE RAISED TO NEW CEILING HEIGHT. MAINTAIN EXISTING POSITION WITHIN GRID CEILING. MAINTAIN EXISTING CIRCUITRY AND LIGHTING CONTROL.

- REFER TO SHEET E0.1 FOR GENERAL LIGHTING NOTES
- AT MECHANICAL CHASES AND STORES WITHOUT CEILING IN SALES AREA, GROUP VERTICAL PIPING (REFRIGERATION ELECTRICAL CONDUIT AND MECHANICAL DROPS) NEATLY TOGETHER AS POSSIBLE AND PAINT TO MATCH STRUCTURAL COLUMNS.
- NO ELECTRICAL EQUIPMENT SHALL BE LOCATED UNDERNEATH THE SKYLIGHTS INCLUDING BUT NOT LIMITED TO CONDUIT, LIGHTS, CABLES OR STORAGE, ETC.
- REFER TO ES SERIES SHEETS FOR ELECTRICAL STANDARD DETAILS (ESDs).
- ALL CONDUITS IN SALES AREA FROM ROOF TO LOW WALLS OR EQUIPMENT SHALL BE COORDINATED AND GROUPED TOGETHER WITH OTHER MECHANICAL CONDUITS.
- THE QUESTION SENSING DEVICE LOCATIONS SHALL HAVE PRIORITY OVER THE INTERIOR LIGHTING PATTERN WHERE INTERFERENCE OCCURS. ELECTRICAL CONTRACTOR SHOULD ADJUST THE LIGHTING PATTERN AS REQUIRED TO ACCOMMODATE THE REQUIREMENTS OF THE QUESTION SENSING DEVICES. CONTRACTOR TO COORDINATE ALL ADJUSTMENTS WITH THE QUESTION INSTALLATION REPRESENTATIVE AND THE KROGER PROJECT MANAGER.
- RUN CONDUITS ON TOP OF INSULATED ROOF PANEL, STUB THRU PANEL INTO FIXTURES FOR PREP ROOM LIGHTING.

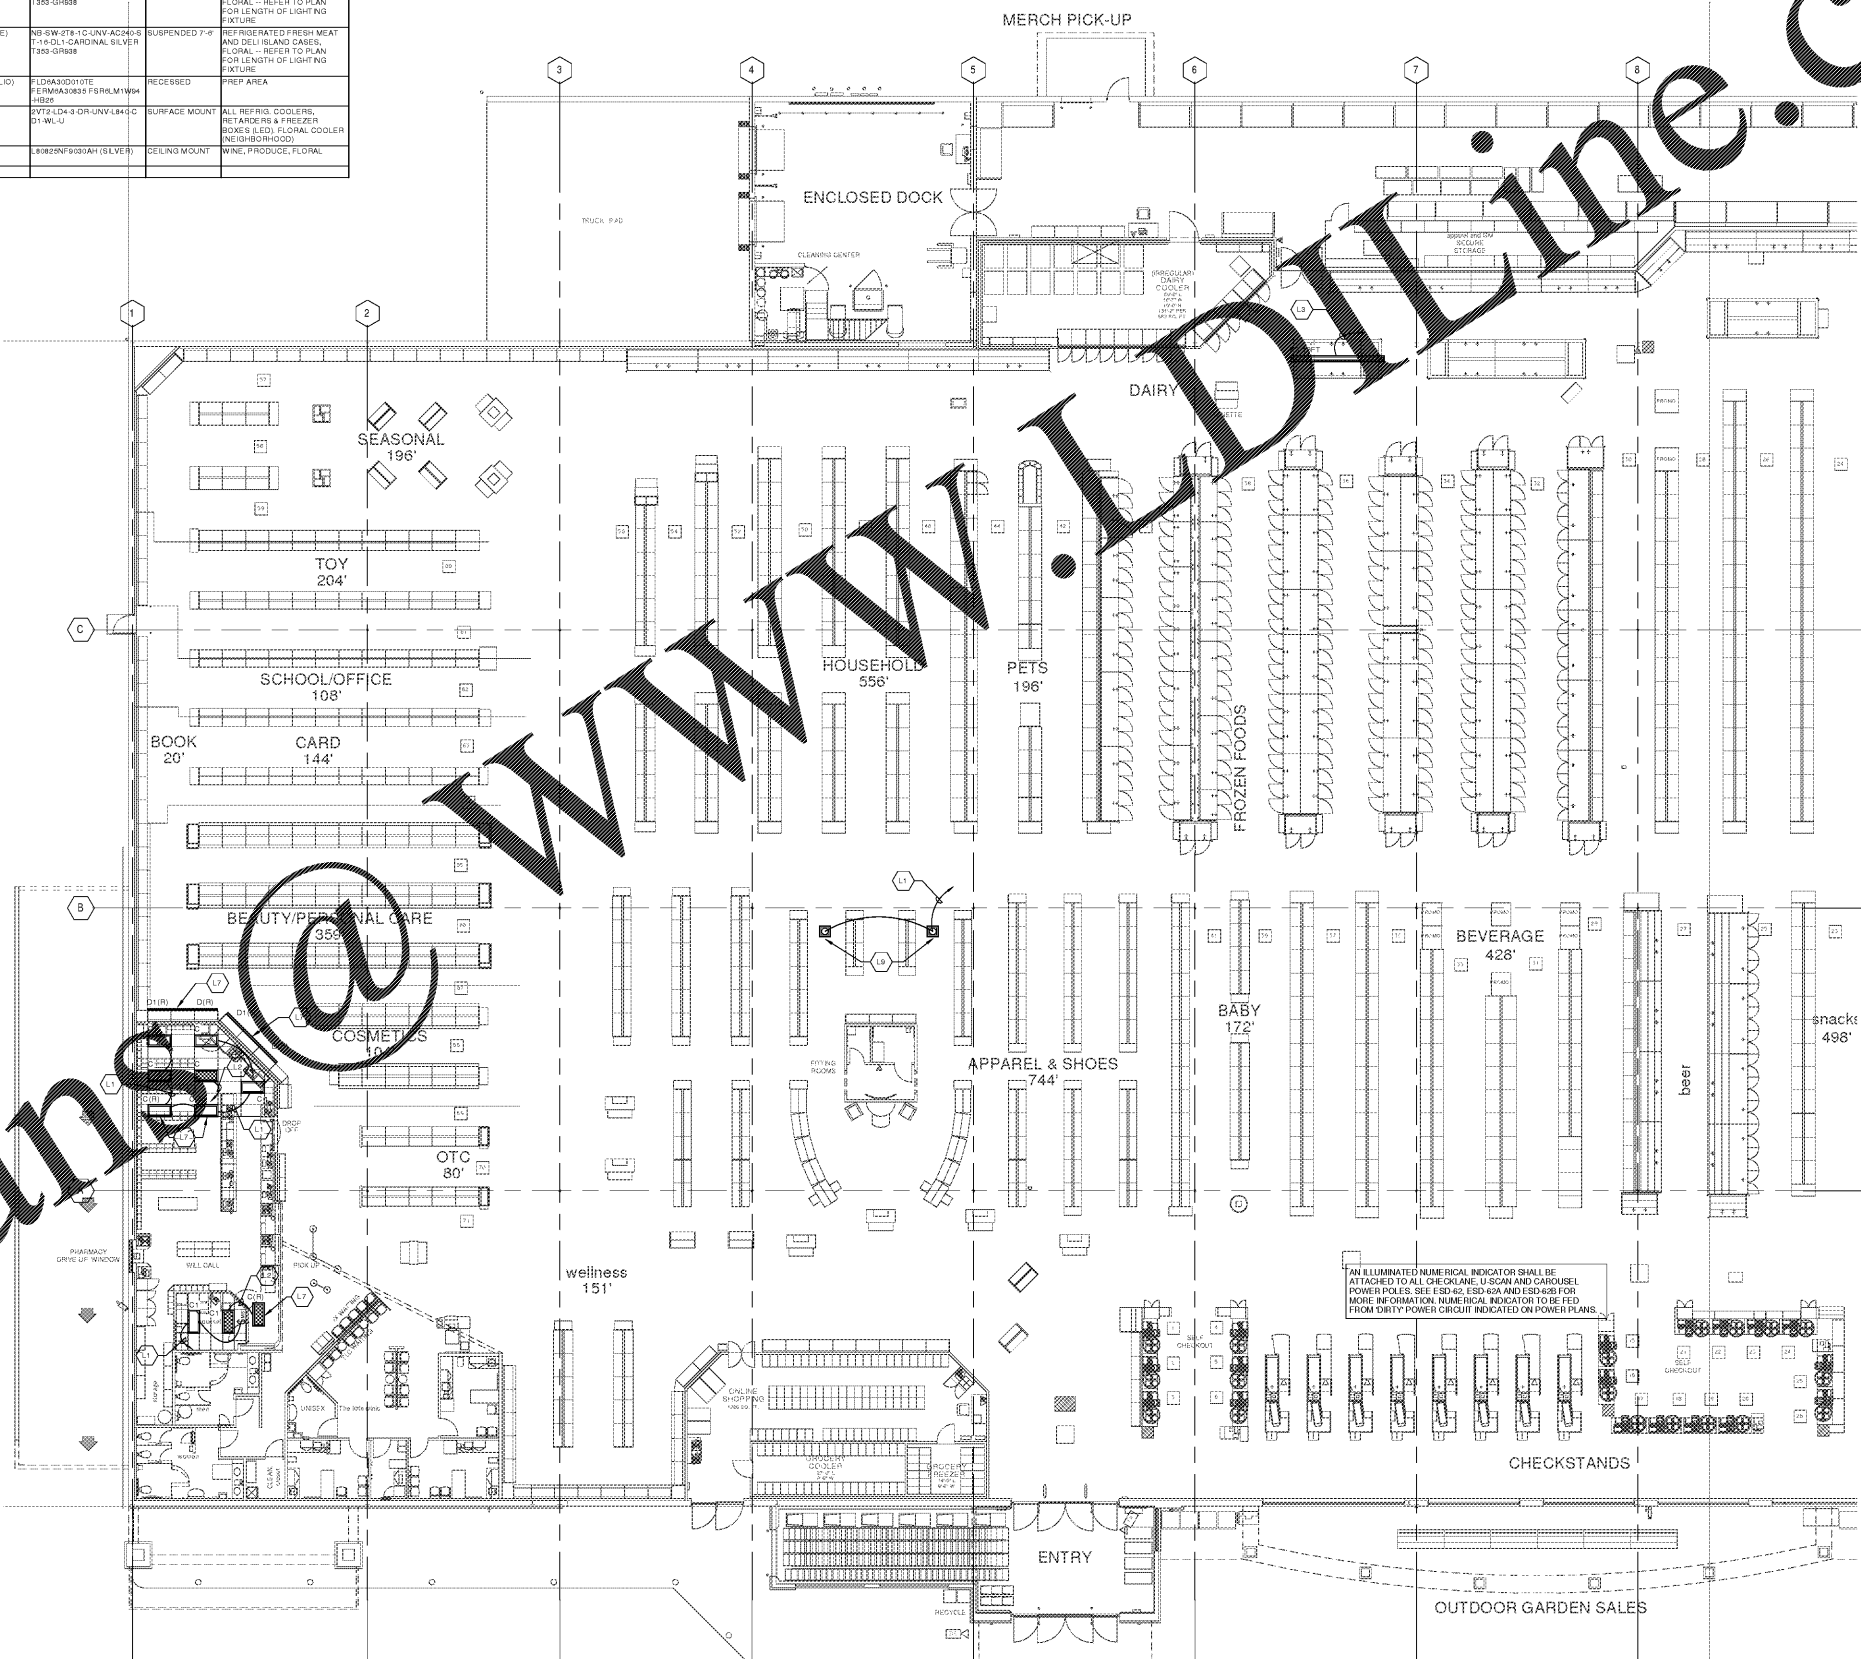

ELECTRICAL LIGHTING PLAN - LEFT  
 3/32" = 1'-0"

Order Plans @ [www.lpdline.com](http://www.lpdline.com)

ROBERSON LOJA ROOF  
 ROBERSON ROOFS & ENGINEERS  
 5400 W. Ridge Road, Suite 275, Alpharetta, GA 30005  
 770.974.2600

THIS REPRODUCTION IS NOT A CERTIFIED DOCUMENT



Kroger L-407 - Remodel  
 3101 RICHMOND ROAD  
 LEXINGTON, KY  
 FOR: The Kroger Company  
 1600 Omahy Station Court, Louisville, KY 40223

REVISIONS

ELECTRICAL LIGHTING PLAN - LEFT

01-25-18

17-125

E1.1A