


Order Plans


WWW.FOLLine.com

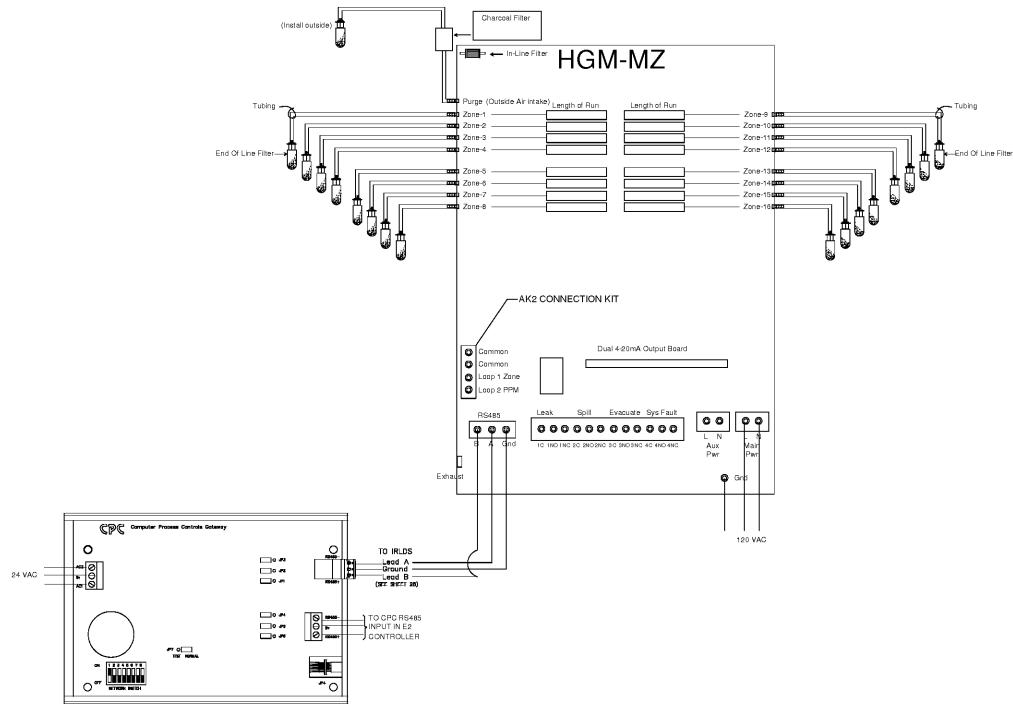



1 REFRIGERANT LEAK DETECTION UNIT - HGM MZ

- NOTE:
1. INSTALL ENCLOSURE ON A VIBRATION FREE SURFACE. MARK HOLE LOCATIONS. USE APPROPRIATE HARDWARE FOR MOUNTING TO STRUCTURE.
 2. FOLLOW ALL NATIONAL AND LOCAL ELECTRICAL CODES WHEN INSTALLING.
 3. WHEN INSERTING WIRING, BE SURE HIGH AND LOW VOLTAGE ARE KEPT ISOLATED.
 4. ALL REMOVED KNOCKOUTS MUST HAVE CONDUIT FITTINGS INSTALLED.



- REFRIGERANT LEAK DETECTION CONTROL PANEL:
- ONE (1) ENCLOSURE (INSTALLER SUPPLIED & MOUNTED)
 - CPC POWER SUPPLY (INSTALLER MOUNTED)
 - TWO (2) BA1/BRO COMBO BOARD (INSTALLER MOUNTED)

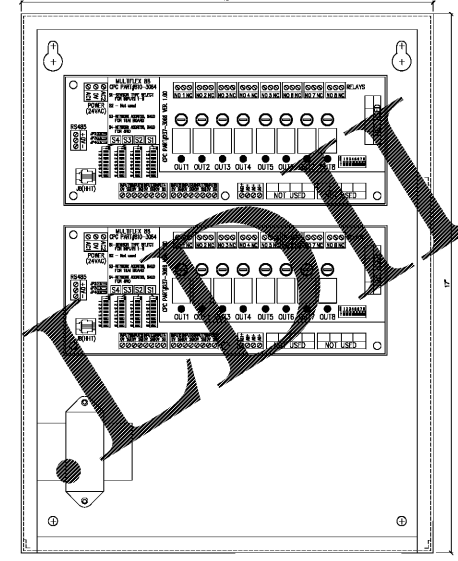

2 CONTROL SYSTEM - DANFOSS LEAK DETECTION CONTROL PANEL




REFRIGERANT LEAK ALARM
 EVACUATE THIS SPACE
 CONTACT FACILITY MAINTENANCE
 EXHAUST TO OUTSIDE
 DO NOT RE-ENTER UNTIL ADVISED BY MAINTENANCE PERSONNEL




- NOTES:
1. HORN & STROBE CONTACTS CONTROLLED BY SAME RELAY POINT.
 2. OP 1 SET TO 24 VDC.
 3. SW1 SET TO DOWN.
 4. SW2 SET TO UP.
 5. SW3 SET TO UP.
 6. SW4 SET TO UP.

3 CONTROL SYSTEM - REFRIGERANT LEAK HORN & STROBE DETAIL



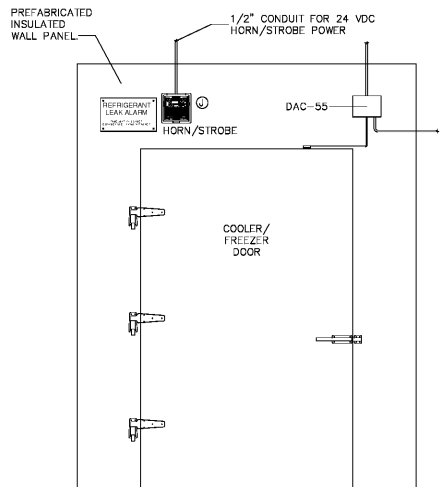


4 CONTROL SYSTEM - REFRIGERANT LEAK HORN/STROBE MOUNTING DETAIL

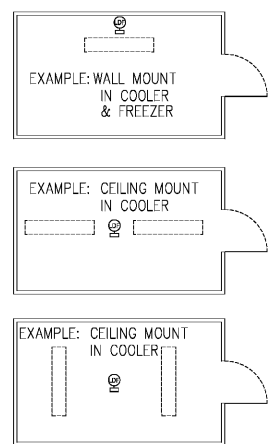

- NOTE:
- USE SPECIAL WASHDOWN J-BOX (OWNER SUPPLIED) TO MOUNT FILTER END FOR ZONES IN PREP AREAS, DAIRY COOLER AND OUTDOOR PURGE ZONE.
 - WHERE DAMAGE TO FILTER END MAY OCCUR, REMOVE THE J-BOX KNOCKOUTS AND INSTALL COVERPLATE.
 - FREEZERS TO UTILIZE WALL MOUNT LOCATION.
 - COOLERS AND PREP ROOMS TO UTILIZE WALL MOUNT OR CEILING MOUNT DEPENDING ON COIL CONFIGURATION.
 - SALES FLOOR ZONES TO UTILIZE THE COLUMN MOUNT.

5 CONTROL SYSTEM - REFRIGERANT LEAK DETECTION FILTER MOUNTING / INSTALL DETAIL

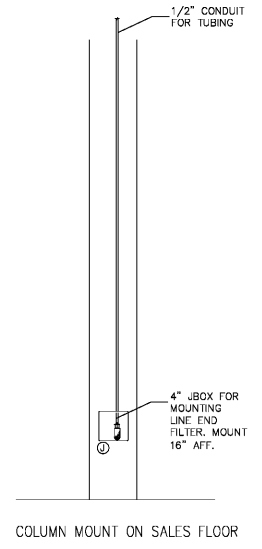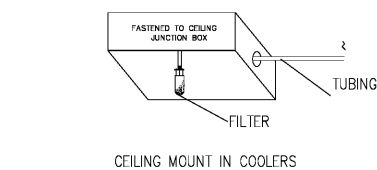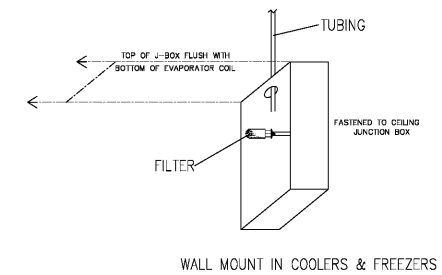

KROGER L-407
 CONTROLS
 INSTALLATION TEMPLATE

CURRENT PLAN DATE		01/25/2018	
ORIGINAL PLAN DATE		X	
DRAWN	MAD	CHECKED	
REVISION			
1	7		
2	8		
3			
4			
5			
6			
STANDARD PLOTTED SCALE			
BUILDING STATUS			
TOTAL SHIFTLING			
SALES AREA			
BASE STORE			
MEZZANINE			
DOCK / UTILITY			
LEAK DETECTION DETAILS			
SHEET PACKAGE ID			
SHEET			
EM-3			
CAD FILE			

FOR REFERENCE ONLY



NOTE: THIS DRAWING IS THE PROPERTY OF FOLLINE.COM. IT IS TO BE USED ONLY FOR THE PROJECT AND SITE SPECIFICALLY IDENTIFIED BY THE DRAWING NUMBER. IT IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF FOLLINE.COM.