



KPS GLOBAL PREFABRICATION
WALK-IN FREEZER/COOLER UNIT

kps GLOBAL ENGINEERING BULLETIN NO: 6415
SUBJECT: NSF LABELING DATE: April 15, 2016

The National Sanitation Foundation (NSF) in accordance with Standards 7 and 51 establishes minimum food protection and sanitation requirements for the materials, design, manufacture construction and performance of walk-in coolers and freezers and their related components. An NSF inspector audits each of our facilities every three months.

When specified on the drawings, an NSF label is applied to the interior of the door section, latch side or to the interior of the panel adjacent to an opening when a door section is not used.

A standard NSF label is applied to units with panels and refrigeration supplied by KPS Global. An NSF "COMPONENT" label is applied when panels only are supplied by KPS Global and the refrigeration is supplied by someone else.

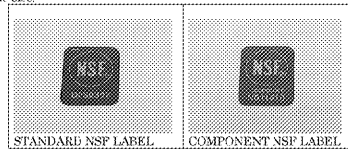



When specified on the drawings, a "PACKAGED PRODUCT ONLY" label is used.

kps GLOBAL ENGINEERING BULLETIN NO: 6420
SUBJECT: ETL ELECTRICAL LABELING DATE: April 15, 2016

ETL Testing Laboratories has conducted tests and evaluation of KPS Global wiring methods and installation in accordance with UL-471, CAN/CSA C22.2 and the National Electrical Code, NFPA 70. An ETL inspector audits each of our facilities every three months.

An ETL label is applied to the interior of the door section, latch side or to the interior of the panel adjacent to any factory installation of wiring or conduit.

A separate Procedures Manual is included as part of the ETL listing program. Each facility has a separate label and listing number.




kps GLOBAL ENGINEERING BULLETIN NO: 6423
SUBJECT: UL LABELING DATE: April 15, 2016

Underwriters Laboratories (UL) has conducted flammability tests on KPS Global products in accordance with UL-723 for surface burning characteristics. UL also conducted tests for Canadian Classification in accordance with CAN/ULC-S102 AND ULC/ORD-C376. A UL inspector audits each of our facilities every three months.

When specified on the drawings, an UL label is applied to the interior of the door section, latch side or to the interior of the panel adjacent to an opening when a door section is not used and to each corner panel (five labels per unit).

A separate Procedures Manual is included as part of the UL listing program. Each facility has a separate label.

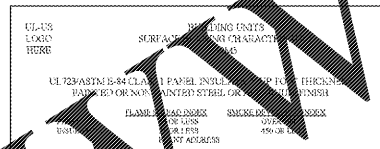

Lark Refrigeration A Brand of Heatcraft Refrigeration Products
2175 West Park Place Boulevard
Stone Mountain, GA 30087
800.537.7775
www.larkproducts.com

PTN042H6AE


Project: Dollar Tree Stores	QUOTATION
Location: Various	Submitted by: Mike S. Jarrell
Customer: Various	DATE: 7/9/2015
Model No: Cooler	For Record
Tag: Cooler	For Approval

PHYSICAL & ELECTRICAL & CAPACITY DATA

REFRIGERANT	EVAPORATOR	POWER SUPPLY	MCA1	MOPP	LINE AMPERE	NEMA	APPROX. NET WT.	Refrig. Charge (oz)
R404A	340	115/208/230V 1/2 Hz	11.3	15	9.3	3-20K	24	24

CAPACITY (BTUH)

+35°F Room	+30°F Room	0°F Room	+10°F Room	+20°F Room	AMBIENT TEMPERATURE CAPACITY (BTUH) at 95°F Ambient
4360	4570	0	0	0	9577

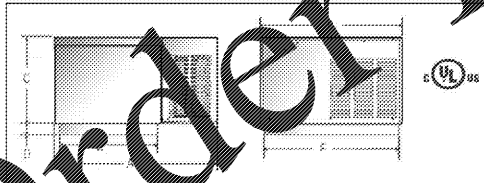

Dimensions (inches)

A	B	C	D	E	F	G	H	I	J	K
28.1	15.3	4.1	20.4							

Dimensions (inches)

L	M	N	P	R	S	T	U	V	W

WALK-IN COOLER SHEET 1 OF 2

Lark Refrigeration A Brand of Heatcraft Refrigeration Products
2175 West Park Place Boulevard
Stone Mountain, GA 30087
800.537.7775
www.larkproducts.com

PTN042H6AE


Project: Dollar Tree Stores	QUOTATION
Location: Various	Submitted by: Mike S. Jarrell
Customer: Various	DATE: 7/9/2015
Model No: Cooler	For Record
Tag: Cooler	For Approval

PHYSICAL & ELECTRICAL & CAPACITY DATA

REFRIGERANT	EVAPORATOR	POWER SUPPLY	MCA1	MOPP	LINE AMPERE	NEMA	APPROX. NET WEIGHT	Refrig. Charge (oz)
R404A	340	115/208/230V 1/2 Hz	11.3	20	15.3	6-20K	275	45

CAPACITY (BTUH)

+35°F Room	+30°F Room	0°F Room	+10°F Room	+20°F Room	AMBIENT TEMPERATURE CAPACITY (BTUH) at 95°F Ambient
0	0	7000	5860	3910	

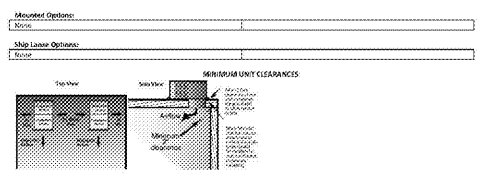

Dimensions (inches)

A	B	C	D	E	F	G	H	I	J
52	42	19	4	24.75	38.25				

Dimensions (inches)

L	M	N	P	R	S	T	U	V	W

WALK-IN COOLER SHEET 2 OF 2

Lark Refrigeration A Brand of Heatcraft Refrigeration Products
2175 West Park Place Boulevard
Stone Mountain, GA 30087
800.537.7775
www.larkproducts.com

PTN052L6BE


Project: Dollar Tree Stores	QUOTATION
Location: Various	Submitted by: Mike S. Jarrell
Customer: Various	DATE: 7/9/2015
Model No: Freezer	For Record
Tag: Freezer	For Approval

PHYSICAL & ELECTRICAL & CAPACITY DATA

REFRIGERANT	EVAPORATOR	POWER SUPPLY	MCA1	MOPP	LINE AMPERE	NEMA	APPROX. NET WEIGHT	Refrig. Charge (oz)
R404A	340	115/208/230V 1/2 Hz	18.1	20	15.3	6-20K	275	45

CAPACITY (BTUH)

+35°F Room	+30°F Room	0°F Room	+10°F Room	+20°F Room	AMBIENT TEMPERATURE CAPACITY (BTUH) at 95°F Ambient
0	0	7000	5860	3910	

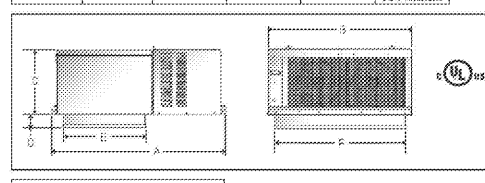

Dimensions (inches)

A	B	C	D	E	F	G	H	I	J
52	42	19	4	24.75	38.25				

Dimensions (inches)

L	M	N	P	R	S	T	U	V	W

WALK-IN FREEZER SHEET 1 OF 2

Lark Refrigeration A Brand of Heatcraft Refrigeration Products
2175 West Park Place Boulevard
Stone Mountain, GA 30087
800.537.7775
www.larkproducts.com

PTN052L6BE


Project: Dollar Tree Stores	QUOTATION
Location: Various	Submitted by: Mike S. Jarrell
Customer: Various	DATE: 7/9/2015
Model No: Freezer	For Record
Tag: Freezer	For Approval

STANDARD FEATURES

- Corrosion Resistant: This model is designed with corrosion resistant materials.
- Electrical: Complies with all applicable electrical codes.
- Lighting: 150W or 200W medium and large cabinet models.
- System: Factory assembled, evaluated, charged, tested and sealed in accordance with applicable codes.
- Sealed joints are guaranteed Free from refrigerant leaks.
- 2 year product warranty.

OPTIONAL FEATURES

- Frost-free interior.
- Frost-free exterior.
- Frost-free door.
- Frost-free gasket.

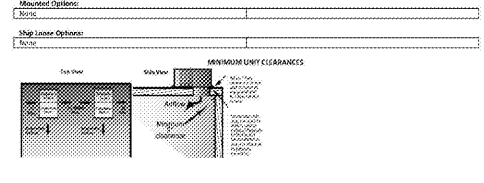

Dimensions (inches)

A	B	C	D	E	F	G	H	I	J
52	42	19	4	24.75	38.25				

Dimensions (inches)

L	M	N	P	R	S	T	U	V	W

WALK-IN FREEZER SHEET 2 OF 2

GENERAL NOTES:
1. THE PROPOSED FREEZER/COOLER UNIT SIZE IS INDICATED ON FLOOR PLAN.
2. ALL WALK-IN & MERCHANDISING UNITS ARE SELF CONTAINED AND DO NOT REQUIRE A FLOOR DRAIN.
3. INSTALLATION OF THESE NSF, ETL & UL LISTED UNITS SHALL COMPLY WITH ALL STATE AND LOCAL CODES PER APPROVED PLANS.

FOR REFERENCE ONLY

WWW.LDILine.com
 FOR INFORMATION ONLY
 REFRIGERATION SPECIFICATIONS
 project drawing
 D63