


ELECTRICAL SYMBOLS	
⊕	20A DUPLEX GROUNDING RECEPTACLE - 120V
⊕	15AMP 250 GROUNDING RECEPTACLE - 120V
⊕	SPECIAL PURPOSE 120V OUTLET
⊕	SPECIAL PURPOSE 200V OUTLET
⊕	CILING MOUNT CIRCULATED RECEPTACLE - 120V
⊕	JUNCTION BOX FOR DIRECT CONNECTION
S	SW SWITCH
⊕	TEL. TELEPHONE
DAT	DATA
FC	FIELD CONNECTION WIRED BY ELECTRICAL CONTRACTOR
FM	FAN MOTOR
LF	LIGHT FIXTURE
FLF	FLUORESCENT LIGHT FIXTURE
⊕	GENERAL PURPOSE 120-14V DR AT NOTED HEIGHT AFF
KW	KILOWATTS
HP	HORSEPOWER
AF	ABOVE FINISHED FLOOR
EC	ELECTRICAL CONTRACTOR

NOTE:  
ALL CONNECTIONS SHOWN ON WALLS ARE TO BE CONCEALED IN WALL CAVITY UNLESS NOTED OTHERWISE

- ELECTRICAL CONTRACTORS' NOTES**
- THIS PLAN SHOWS ONLY THE REQUIREMENTS FOR FOOD SERVICE EQUIPMENT BEING PROVIDED BY VENDORS. FOR ALL OTHER REQUIREMENTS, REFER TO ARCHITECT'S PLANS.
  - ALL WORK TO BE IN COMPLIANCE WITH PRE-PAID CODES.
  - ALL ELECTRICAL CONDUIT IS TO BE RUN WITHIN WALL CAVITY, BORES AND RECEPTACLES ARE TO BE RISE FLUSH WITH WALL SURFACE. SURFACE MOUNTED WORK IS NOT ACCEPTABLE.
  - ELECTRICAL CONTRACTOR IS TO VERIFY ALL REQUIREMENTS FOR EXISTING EQUIPMENT TO BE REMOVED OR DISCONNECTED TO BE REMOVED BY OTHERS.
  - ALL ELECTRICAL CONNECTION HEIGHTS ARE TO CENTERLINE UNLESS NOTED OTHERWISE.
  - WARRANTY WORK IS NOT BE RESPONSIBLE FOR UNFINISHED ELECTRICAL APPLIANCES, SUCH AS LANE OR DISCONNECT SWITCHES, SAFETY CUTOUTS, CONTROL PANELS, FUSE BOXES, FITTINGS AND BY-PRODUCTS REQUIRED BETWEEN EQUIPMENT AND CONTROL PANELS UNLESS SPECIFIED IN CONTRACT.
  - ELECTRICAL CONTRACTOR IS TO SUPPLY AND INSTALL ALL CONDUIT, WIRING, BOXES, SWITCHES, FACILITIES, BRACKETS ETC TO COMPLETE INSTALLATION. ALSO MAKE ALL FINAL CONNECTIONS TO KITCHEN EQUIPMENT INCLUDING ALL WIRING REQUIREMENTS FOR WALL COOLERS, FAN FREEZERS AND THEIR COMPRESSORS, BLOWER COILS, TRANS, HEATERS AND LIGHTING.
  - ELECTRICAL CONTRACTOR IS TO DO ALL INTERWIRING FOR EXHAUST HOOD 120V LINE, BLINDS, DAMPERS AND FIRE SUPPRESSION SYSTEM INCLUDING THE SUPPLYING AND INSTALLATION OF A SILENT TRIP BREAKER FOR EQUIPMENT AND A FAN INTERLOCK MECHANISM.
  - UNLESS OTHERWISE SPECIFIED, THE ELECTRICAL CONTRACTOR IS TO PROVIDE AND INSTALL ALL CONDUIT, WIRING AND RECEPTACLES WHERE NECESSARY. THIS SHALL INCLUDE ALL VOLTAGES (SEE 100, 200, 250, 240).
  - SOME STATE CODES REQUIRE GROUNDING ON ALL KITCHEN APPLIANCES. ELECTRICAL CONTRACTOR TO CONFIRM LOCAL CODE REQUIREMENTS IF REQUIRED. USE IN ACCORD WITH APPLICABLE AND IN ACCORD WITH ELECTRICAL PANEL.

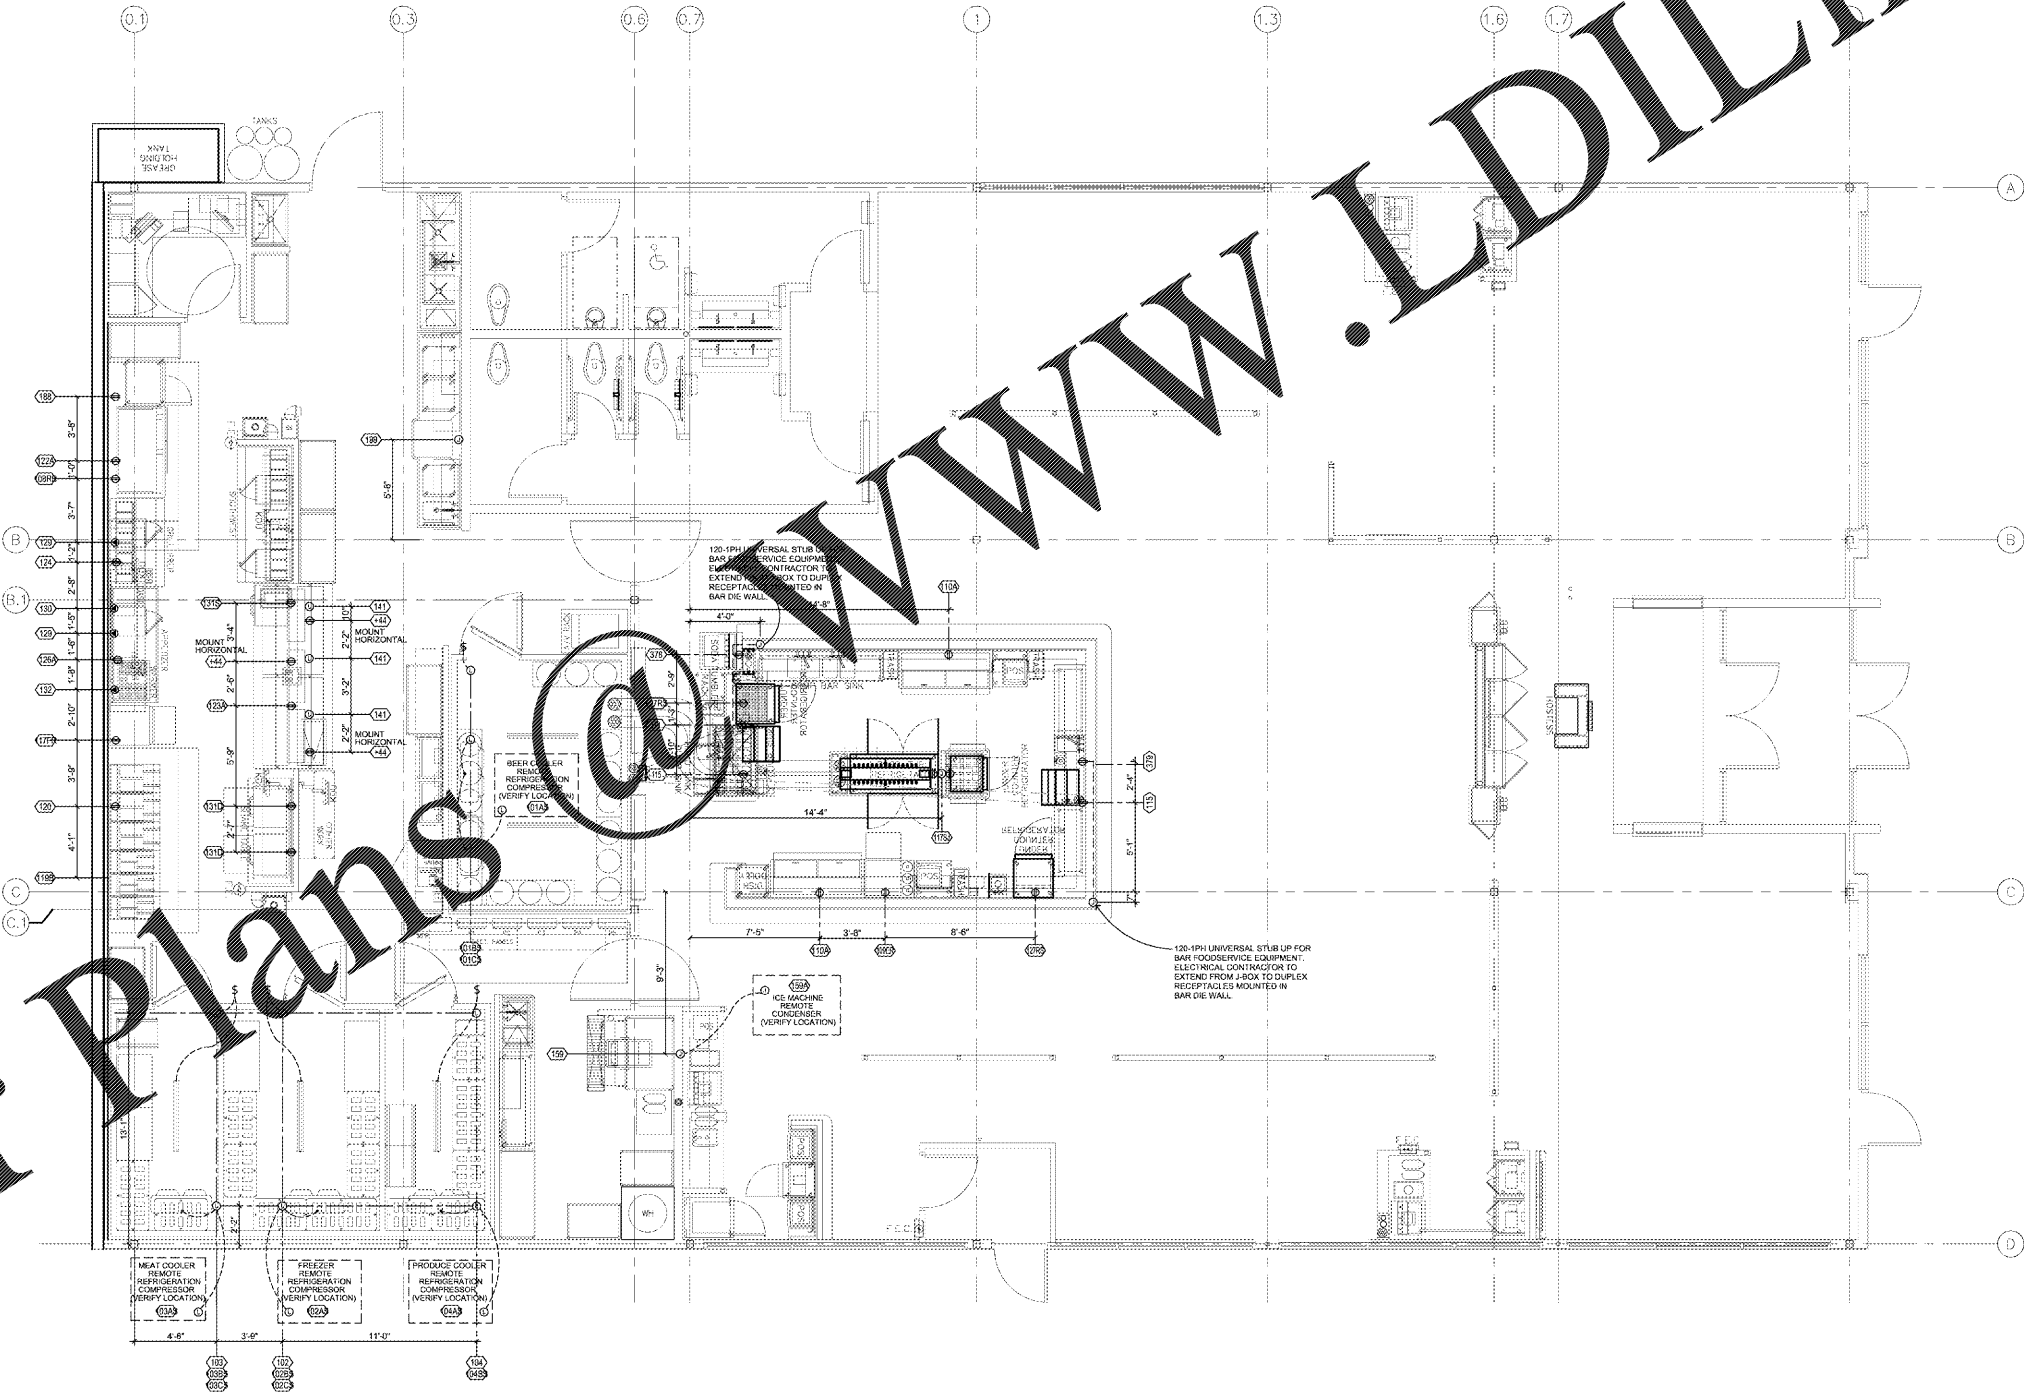

Order Plans @ [www.LDILine.com](http://www.LDILine.com)

CERTIFICATION																								
 <b>PRANGER GROUP INC.</b> PROJECT MANAGER																								
PROJECT NUMBER 5748																								
<b>BUFFALO WILD WINGS</b> BIRMINGHAM 1416 4th AVENUE SOUTH, BIRMINGHAM, AL 35233																								
 <b>BUFFALO WILD WINGS</b>																								
DRAWING ISSUE <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <th style="width: 15%;">NO.</th> <th style="width: 75%;">DESCRIPTION</th> <th style="width: 10%;">DATE</th> </tr> <tr><td>1</td><td></td><td></td></tr> <tr><td>2</td><td></td><td></td></tr> <tr><td>3</td><td></td><td></td></tr> <tr><td>4</td><td></td><td></td></tr> <tr><td>5</td><td></td><td></td></tr> <tr><td>6</td><td></td><td></td></tr> <tr><td>7</td><td></td><td></td></tr> </table>	NO.	DESCRIPTION	DATE	1			2			3			4			5			6			7		
NO.	DESCRIPTION	DATE																						
1																								
2																								
3																								
4																								
5																								
6																								
7																								
Drawing Title <b>ELECTRICAL ROUGH IN PLAN</b>																								
K3																								