
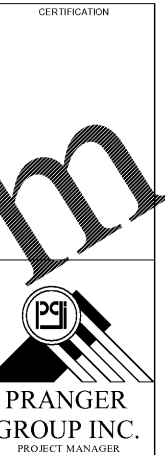
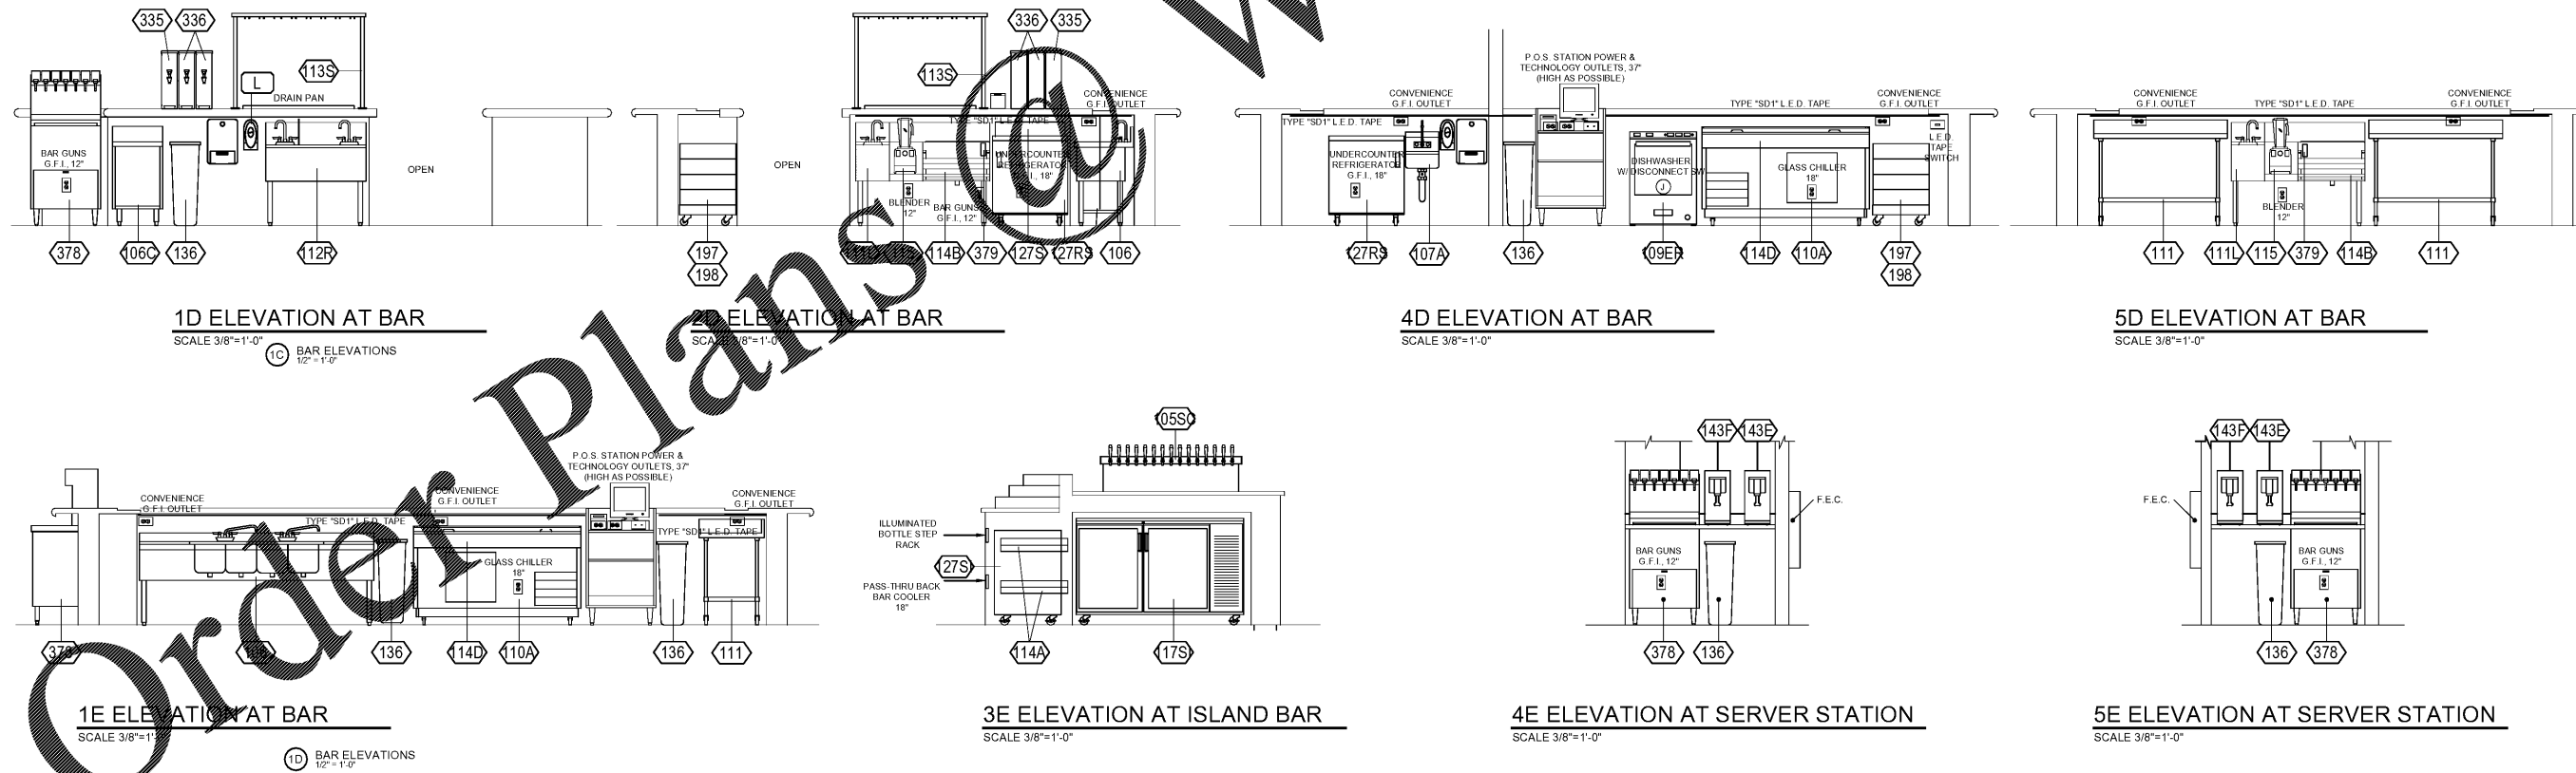


- GENERAL NOTES**
1. PROVIDE ISOLATED GROUND RECEPTACLES W/ EQUIPMENT GROUND & ISOLATED GROUND FOR ALL 120V RECEPTACLES SERVING OFFICE EQUIPMENT, COMMUNICATIONS EQUIPMENT, ALL POS EQUIPMENT, SECURITY AND FIRE CONTROL EQUIPMENT, ETC. CONNECT ISOLATED GROUND W/ IG BUS IN PANEL.
  2. FINAL INSTALLATION OF OFFICE EQUIPMENT POWER DEVICES & SIGNAL CONDUIT/BOXES SHALL BE COORDINATED W/ OWNER AND OWNER'S VENDORS PRIOR TO ROUGH-IN.
  3. FINAL INSTALLATION OF OFFICE OUTLETS LOCATED AT 7'-6" AFF SHALL BE LOCATED W/ THE BOTTOM OF THE DEVICE COVER PLATE MOUNTED AT 7'-6" AFF UNLESS OTHERWISE DIRECTED BY OWNER OR OTHERWISE INDICATED ON THESE DRAWINGS.
  4. BAR AREA - PROVIDE CLASS "A" GROUND FAULT PROTECTION FOR ALL 20A RECEPTACLES.

- KEY NOTES**
1. SWITCHES IN OFFICE FOR RESTROOM, OFFICE AND SIGNAGE, SEE DETAIL ON SHEET E302
  2. PROVIDE WIREMOLD V4000 SERIES RACEWAY ALONG TOP OF DESK FOR MOUNTING OF POWER & TECHNOLOGY DEVICES. RACEWAY SHALL BE COMPLETE WITH STEEL DIVIDER BETWEEN POWER & TECHNOLOGY CHAMBERS. ALL DEVICES SHALL UTILIZE V4000 BASED MOUNTING PLATE WITH REQUIRED 5507 SERIES FACE PLATES. PROVIDE ALL REQUIRED FITTINGS INCLUDING V4014A WALL BOX CONNECTOR. ROUTE CIRCUITRY CONCEALED IN WALL FROM CEILING TO SURFACE. RACEWAY PROVIDE 3/4" EMT TO CEILING CAVITY FOR LOW VOLTAGE CABLING.
  3. RECEPTACLE IN Wiremold V4000 SYSTEM FOR GENERAL DESKTOP OFFICE EQUIPMENT. SEE KEY NOTE 2.
  4. DATA/TELE/COMM OUTLET (BOXES) IN Wiremold V4000 SYSTEM. PROVIDE 3/4" CONDUIT UP TO ABOVE CEILING.
  5. HVAC THERMOSTATS. VERIFY QUANTITIES AND INSTALLATION WITH HVAC CONTRACTOR.
  6. DURESS ALARM PANIC BUTTON LOCATED AT 28" AFF BELOW COUNTER TOP.
  7. FIRE SPROKLER ROOM TEMPERATURE INDICATOR. REFER TO FLOOR BELL SILENCE SWITCH DETAIL 48" ON SHEET E201.
  8. NOT USED.
  9. PROVIDE FORM ANNUNCIATOR FOR DOOR BELL ALARM. REFER TO SHEET E201 FOR ADDITIONAL INFORMATION.
  10. SECURITY CLO. SIGNAL. PROVIDE 120V CONNECTION COORDINATE W/ OWNER'S SYSTEM INSTALLER PRIOR TO LATION.
  11. SECURITY CCTV MOUNTED AT CEILING. VERIFY REQUIREMENTS WITH OWNER & SECURITY VENDOR PRIOR TO CONSTRUCTION.
  12. PROVIDE CONNECTION TO A/D'S AUXILIARY SUPPLY EQUIPMENT ABOVE CEILING. VERIFY EXACT LOCATION WITH EQUIPMENT SUPPLIER/INSTALLER PRIOR TO ROUGH-IN.
  13. PROVIDE DUPLEX RECEPTACLE & JUNCTION BOX W/ 1" EMT INTO CEILING CAVITY AT 90" FOR OWNER'S MUSIC SYSTEM. VERIFY EXACT LOCATION W/ EQUIPMENT SUPPLIER/INSTALLER PRIOR TO ROUGH-IN.
  14. PROVIDE DUPLEX RECEPTACLE & 4"x4"x2 1/2" JUNCTION BOX W/ 2-GANG MUD RING & TWO 1" EMT INTO CEILING CAVITY AT 66" FOR OWNER'S SECURITY SYSTEM. VERIFY EXACT LOCATION W/ EQUIPMENT SUPPLIER/INSTALLER PRIOR TO ROUGH-IN.

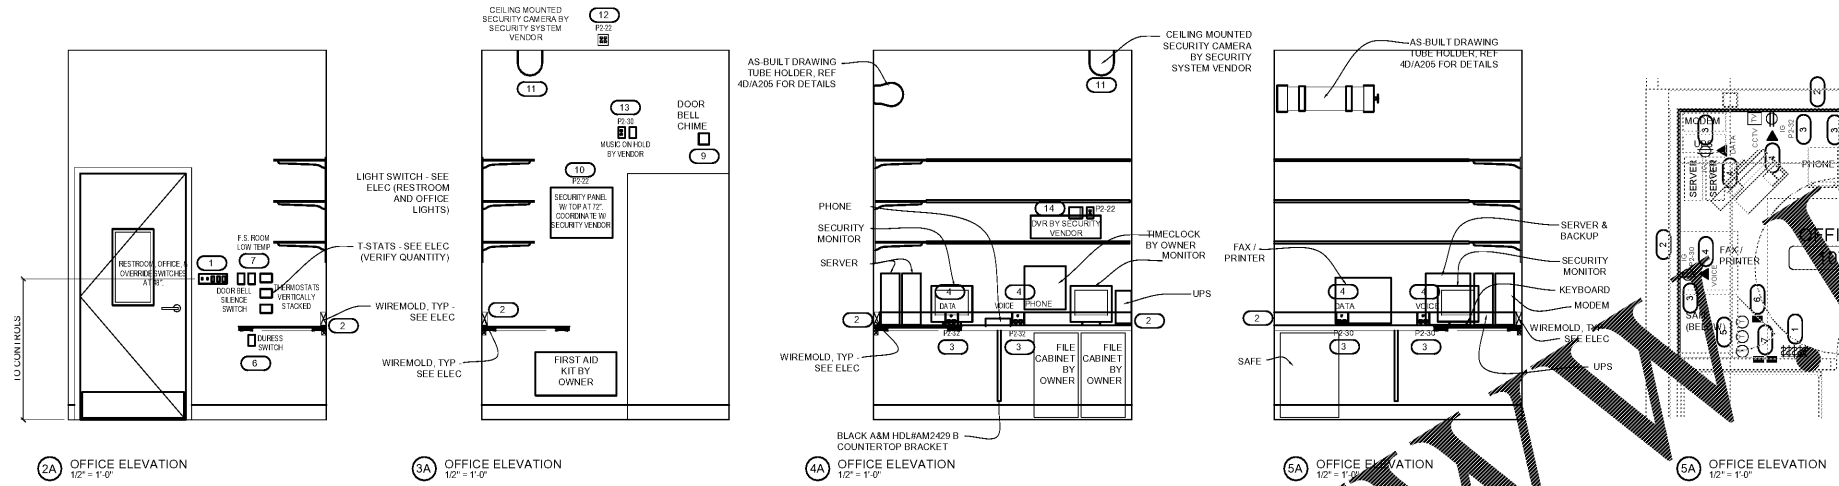

PROJECT NUMBER 5748

**BUFFALO WILD WINGS**  
 BIRMINGHAM SOUTH  
 1416 4th AVENUE SOUTH,  
 BIRMINGHAM, AL 35233



NO	DESCRIPTION	DATE						
		1	2	3	4	5	6	7

Drawing Title  
**ELECTRICAL ELEVATIONS AND ENLARGED OFFICE PLAN**

**E301**