

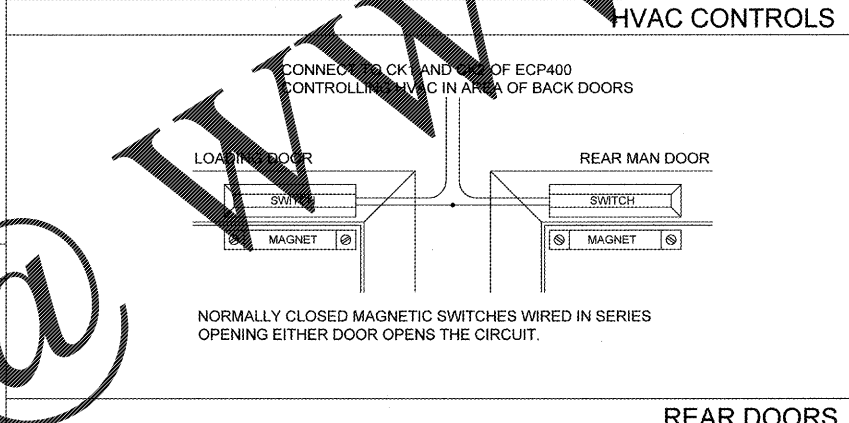
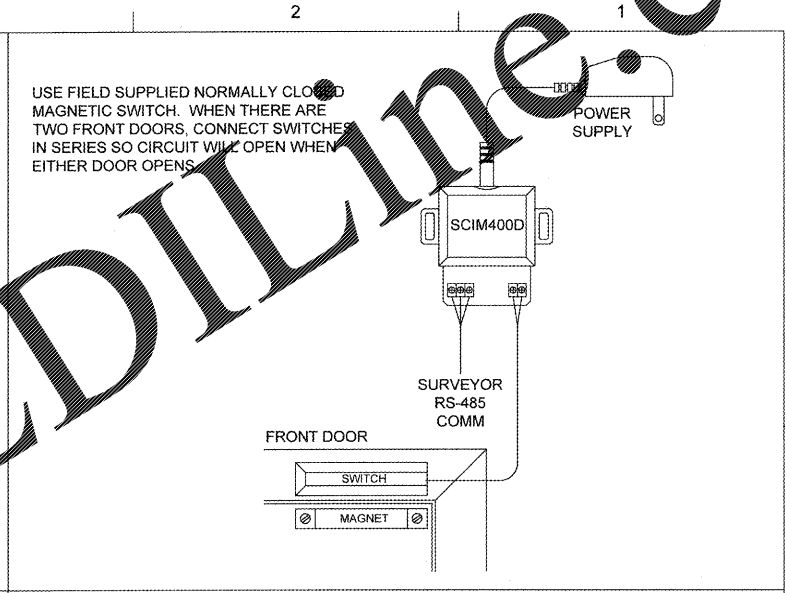
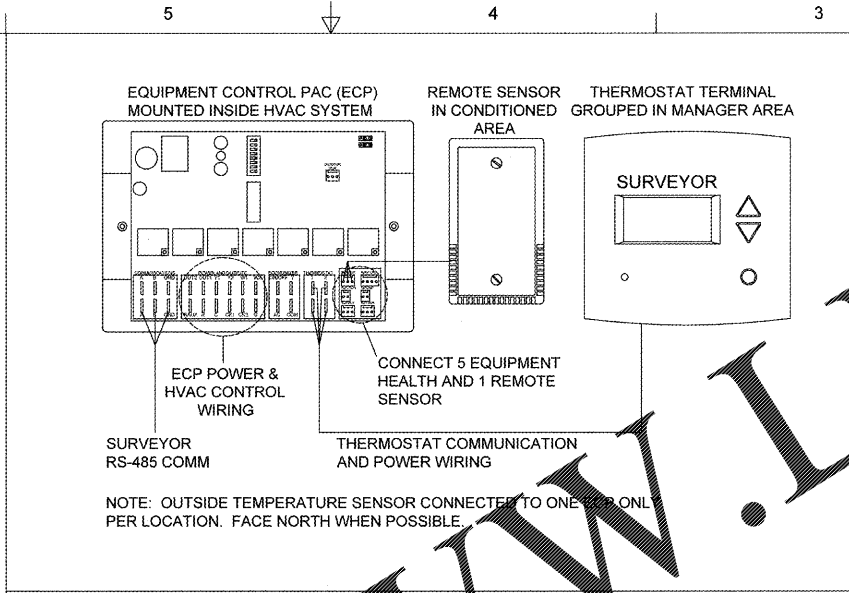
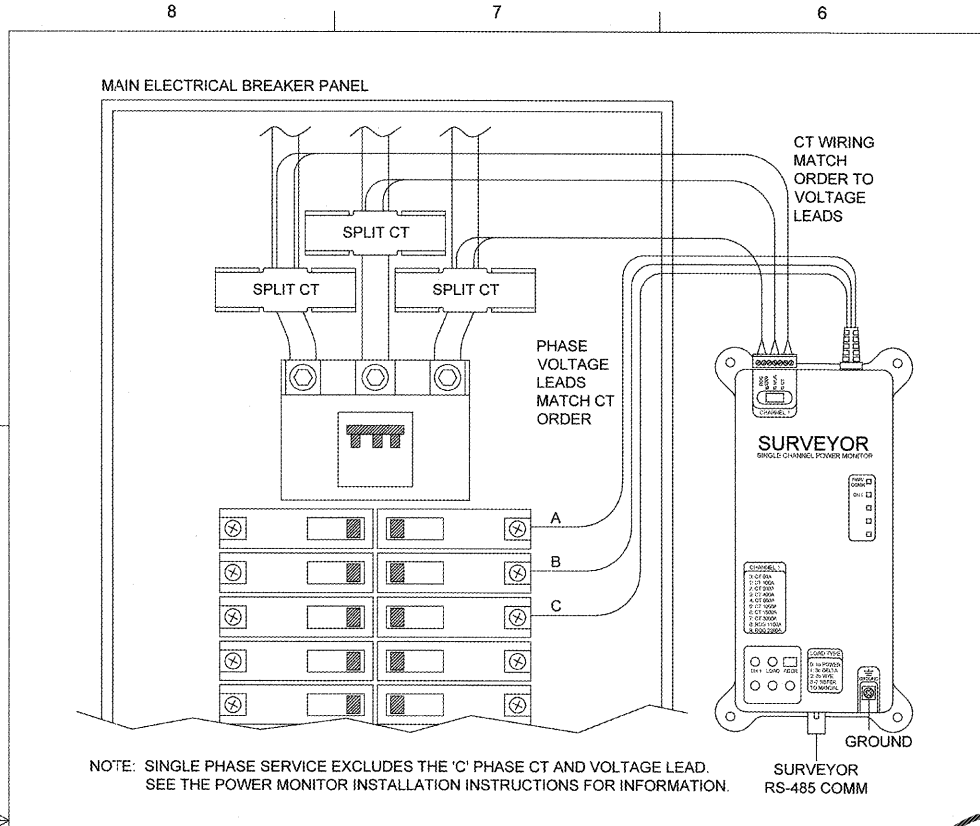


ECP LABELING
 LABEL EACH ECP PER O'REILLY TERMINOLOGY WITH EXACTLY THE SAME UNIQUE IDENTIFYING "CODE" AS SHOWN ON THE "HVAC PLAN" ON SHEET M1 (FOR EXAMPLE: RTU-1, RTU-2, ETC... OR FURN-1, FURN-2, ETC...)

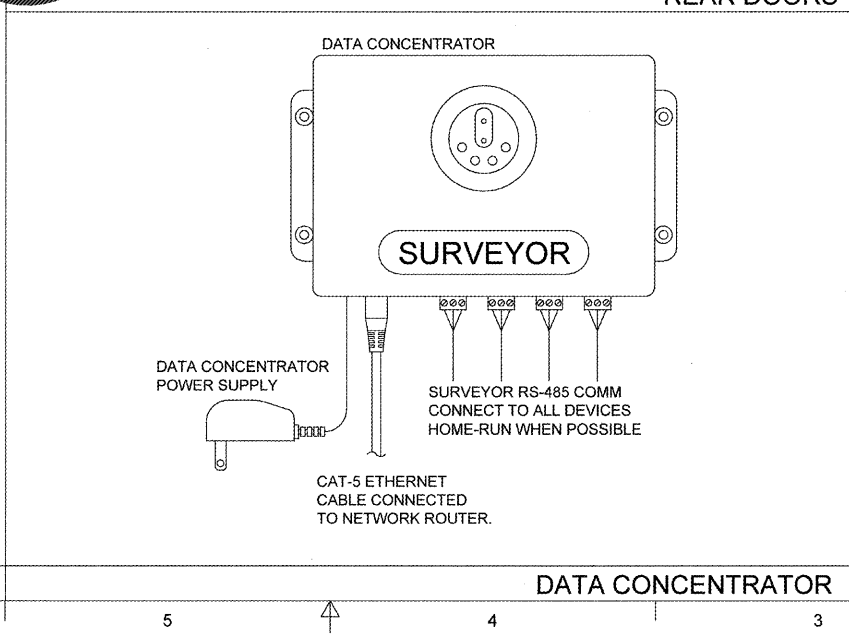

SURVEYOR EMS COMPONENTS

PART	DESCRIPTION	QTY
DC400	DATA CONCENTRATOR	1
ECP400	EQUIPMENT CONTROL PAC	1 PER HVAC
SP400	EQUIPMENT SENSOR PACK	1 PER HVAC
CT414	COMMUNICATING THERMOSTAT	1 PER HVAC
RS410	WALL MOUNT REMOTE SENSOR	1 PER HVAC
LCP401	LIGHTING CONTROL PANEL	1
MD400	ADDITIONAL MOTION DETECTOR	AS NEEDED
PM401	SINGLE CHANNEL POWER MONITOR	1
SCT600-200	600A SPLIT CT, 2" OPENING	3
SCIM400D	SINGLE CHANNEL INPUT MODULE	1
OTS400	OUTDOOR TEMPERATURE SENSOR	1

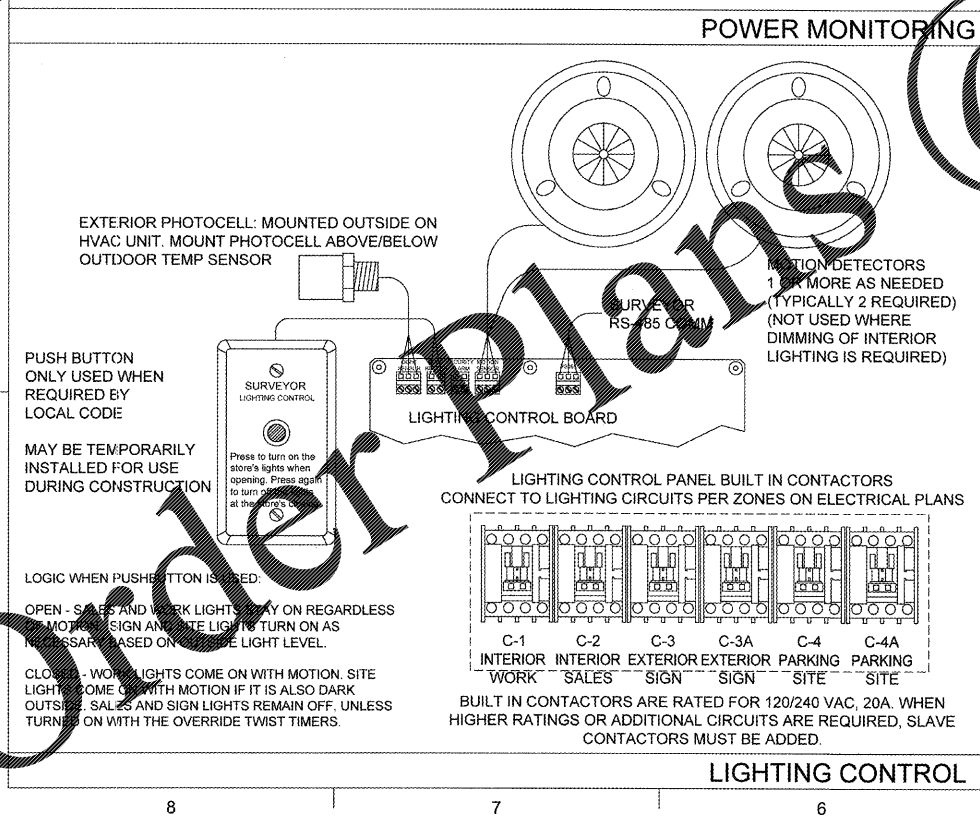

GENERAL NOTES

1. SURVEYOR ENERGY MANAGEMENT SYSTEM HARDWARE IS SUPPLIED BY O'REILLY AUTO PARTS.
2. DRAWING FOR GENERAL INFORMATION ONLY.
3. LOCAL BUILDING CODES TAKE PRECEDENCE OVER THIS DOCUMENT.
4. NOT ALL WIRING IS SHOWN ON THIS DRAWING. FOR CLARITY, ONLY ONE EXAMPLE OF EACH TYPE OF DEVICE IS SHOWN.
5. REFER TO "O'REILLY INSTALLATION DETAIL" DRAWING AND THE SURVEYOR INSTALLATION INSTRUCTIONS FOR EACH COMPONENT FOR DETAILED WIRING AND ADDITIONAL CRITICAL INFORMATION.
6. CAUTION! INSTALLATION REQUIRES THE REMOVAL OF SAFETY COVERS AND EXPOSE THE INSTALLER TO HIGH VOLTAGE AND ELECTRICAL HAZARDS. USE OF A LICENSED ELECTRICIAN IS REQUIRED. FOLLOW ALL APPROPRIATE SAFETY PRECAUTIONS. ADDITIONAL SAFETY INFORMATION IS IN THE SURVEYOR INSTALLATION MANUALS.
7. IT IS THE CONTRACTORS OPTION TO CONTACT ONE OF THE FOLLOWING FOR INSTALLATION OF THE VENSTAR SURVEYOR SYSTEM (MATERIALS PROVIDED BY O'REILLY AUTOMOTIVE STORES INC.):
 A. STONES RIVER ELECTRIC - DARRELL STARKEY - DSTARKEY@STONESRIVERELECTRIC.COM - 615-885-0019
 B. STOVER ELECTRIC - JAMES STOVER - JAMES@STOVERELECTRIC.COM - 805-581-0740
 C. ZUBRAS ELECTRIC - SIMON ZUBRAS - SIMON@ZUBRAELECTRIC.COM - 214-319-6900

FOR SURVEYOR EMS TECHNICAL SUPPORT AND SYSTEM COMMISSIONING, PLEASE CONTACT:

SURVEYOR TECHNICAL SUPPORT
 (818) 812-9812
 MON-FRI 6:00 AM - 5:00 PM PACIFIC
 surveyorsupport@venstar.com

VENSTAR INC.
SURVEYOR
 O'REILLY INSTALLATION OVERVIEW

REV	DESCRIPTION	DATE	BY	CHKD
1	REMOVED SECURITY WIRE	9-27-16	JH	
2	ADDED TEMP PUSHBUTTON USE	2-3-14	CG	
3	REVISED TO REFERENCE DETAIL DWG	9-12-13	CG	
4	ADDED CONTRACTOR CONTACTS	8-27-13	WB	
5	REMOVED CONTRACTOR CONTACTS	8-7-13	WB	
6	RENUMBER NOTES, REMOVE LOGOS	7-26-13	CG	
7	ADDED CONTACT NOTES	7-11-13	CG	

SIZE: 4-30-13 DATE: 8-27-16 DWG NO: S13-001 REV: E
 SCALE: NONE DRAWN: C. GODWIN SHEET: 1 OF 1

FOR INFORMATIONAL USE ONLY

WARNING: THIS SEAL ARE INDICATED. RESPONSIBILITY FOR OTHER PLANS, SPECIFICATIONS OR INSTRUMENTS ARE DISCLAIMED.

O'Reilly AUTO PARTS
 CORPORATE OFFICES
 233 SOUTH PATTERSON
 SPRINGFIELD, MISSOURI 65802
 (417) 862-2674 TELEPHONE

PROJECT: **NEW O'REILLY AUTO PARTS STORE**
915 AZALEA DRIVE
WAYNESBORO, MISSISSIPPI

VENSTAR SURVEYOR

Malone Finkbe Eckhardt & Collins, Inc.
 mfec
 Consulting Engineers
 3333 E. Battleground Rd., Suite 1000
 Springfield, Missouri, 65804
 Phone: 417-881-0020
 Fax: 417-881-0033
 mtec.com

DRAWN BY: _____ CHECKED BY: _____

DATE: **01/12/18**

REVISION: _____

PROJECT NUMBER: **WSB**

SHEET NUMBER: **VS1**

Copyright 2018 - All Rights Reserved. Reproduction Prohibited Without The Express Written Consent Of The Design Professional.