


LEGEND & GENERAL NOTES TO WALLS:

- REFER ALSO TO FLOOR PLANS, BUILDING SECTIONS, WALL SECTIONS AND DETAILS FOR ADDITIONAL INFORMATION ON WALLS.
 - REFER TO DRAWING A103, FLOOR PLAN FOR TYPE, LOCATION AND HEIGHT OF ALL CEILING.
 - EXTERIOR INTERIOR & EXTERIOR MASONRY & GYP. BD. METAL STUD WALLS MUST HAVE ALL EXISTING UNFINISHED HIGHER FROM REMOVED CORNICES, CONDUITS, DUCTWORK, PIPE, ETC. PATCHED UP TO MATCH EXISTING CONSTRUCTION & AS REQUIRED TO MAINTAIN FIRE RATING (SEE REFLECTED CEILING PLANS).
 - EXISTING INTERIOR & EXTERIOR MASONRY & GYP. BD. METAL STUD WALLS AND ALL NEW HOLES CORED ONLY AS REQUIRED FOR NEW CONDUIT, DUCTWORK, PIPING, ETC. NEW PENETRATIONS ARE TO BE PATCHED UP TO MATCH EXISTING CONSTRUCTION & AS REQUIRED TO MAINTAIN FIRE RATING OR FULL HEIGHT (SEE REFLECTED CEILING PLANS).
- 1 HOUR RATED WALL TO ROOF DECK:**
MIN. RATED METAL STUD @ 16" O.C. 5/8" GYP. BOARD
WALL CONSTRUCTION: GYP. BOARD WALLS ON SIDES TO EXTEND 12" ABOVE FINISHED CEILING SYSTEM. ALSO REFER TO PARTIAL FLOOR PLAN - ADMIN. AREA (12/14/01) FOR DESCRIPTION OF WALL CONSTRUCTION RECEIVING SOUND BATT INSULATION BETWEEN METAL STUDS.
- EXISTING 1 HOUR RATED BLOCK TO ROOF DECK:**
EXISTING 1 HOUR FIRE RATED CONCRETE BLOCK WALL AND/OR METAL STUDS & GYP. BOARD WALL ASSEMBLY CONTRACTOR TO UPDATE EXISTING 1 HOUR WALL RATING BY FILLING ALL EXPOSED METAL DECK JOINTS AT ROOF LINE ALONG WALL WITH MINERAL WOOL AND 07842 SPRAY APPLIED FIRESTOP COATING. ALL EXISTING & NEW WALL PENETRATIONS TO MEET CURRENT U.L. FIRE ASSEMBLY BY SEALING AND APPLYING FIRE CALMING AROUND ALL PENETRATIONS. U.L. # U906 AND U419.
- 1 HOUR RATED WALL ROOF DECK:**
1 HOUR FIRE RATED METAL STUD & GYP. BOARD
WALL CONSTRUCTION: 3 5/8" METAL STUDS @ 16" O.C.
FASTEN TO CONIC. FLOOR & ROOF DECK. PROVIDE 5/8" FIRE RATED GYP. BOARD ON BOTH SIDES, TAPED & FINISHED. REFER TO GYP. BD. & METAL STUD WALL TYPES N13(A40).
REFER TO SPECIFICATIONS FOR STEEL STUDS REQUIREMENTS. U.L. # U906 AND U419.
- 1 HOUR RATED BLOCK & GYPSUM WALL TO ROOF DECK:**
1 HOUR FIRE RATED CONCRETE BLOCK WALL UP TO FIRST COURSE; MIN. 4" ABOVE CEILING TYPE 2 ORANGE POP OF FIRE RATED CEILING OR AND TOP OF NON-RATED HORIZONTAL SMOKE PARTITION. EXTEND WALL TO ROOF DECK WITH 1 HOUR FIRE RATED DRYWALL PARTITION; ONE LAYER OF FIRE RATED 5/8" GYPSUM BOARD ON EACH SIDE OF STEEL STUDS @ 16" O.C. REFER TO SPECIFICATIONS FOR STUDS REQUIREMENTS. U.L. # U906 AND U419.
**U.L. # U906 AND U419.

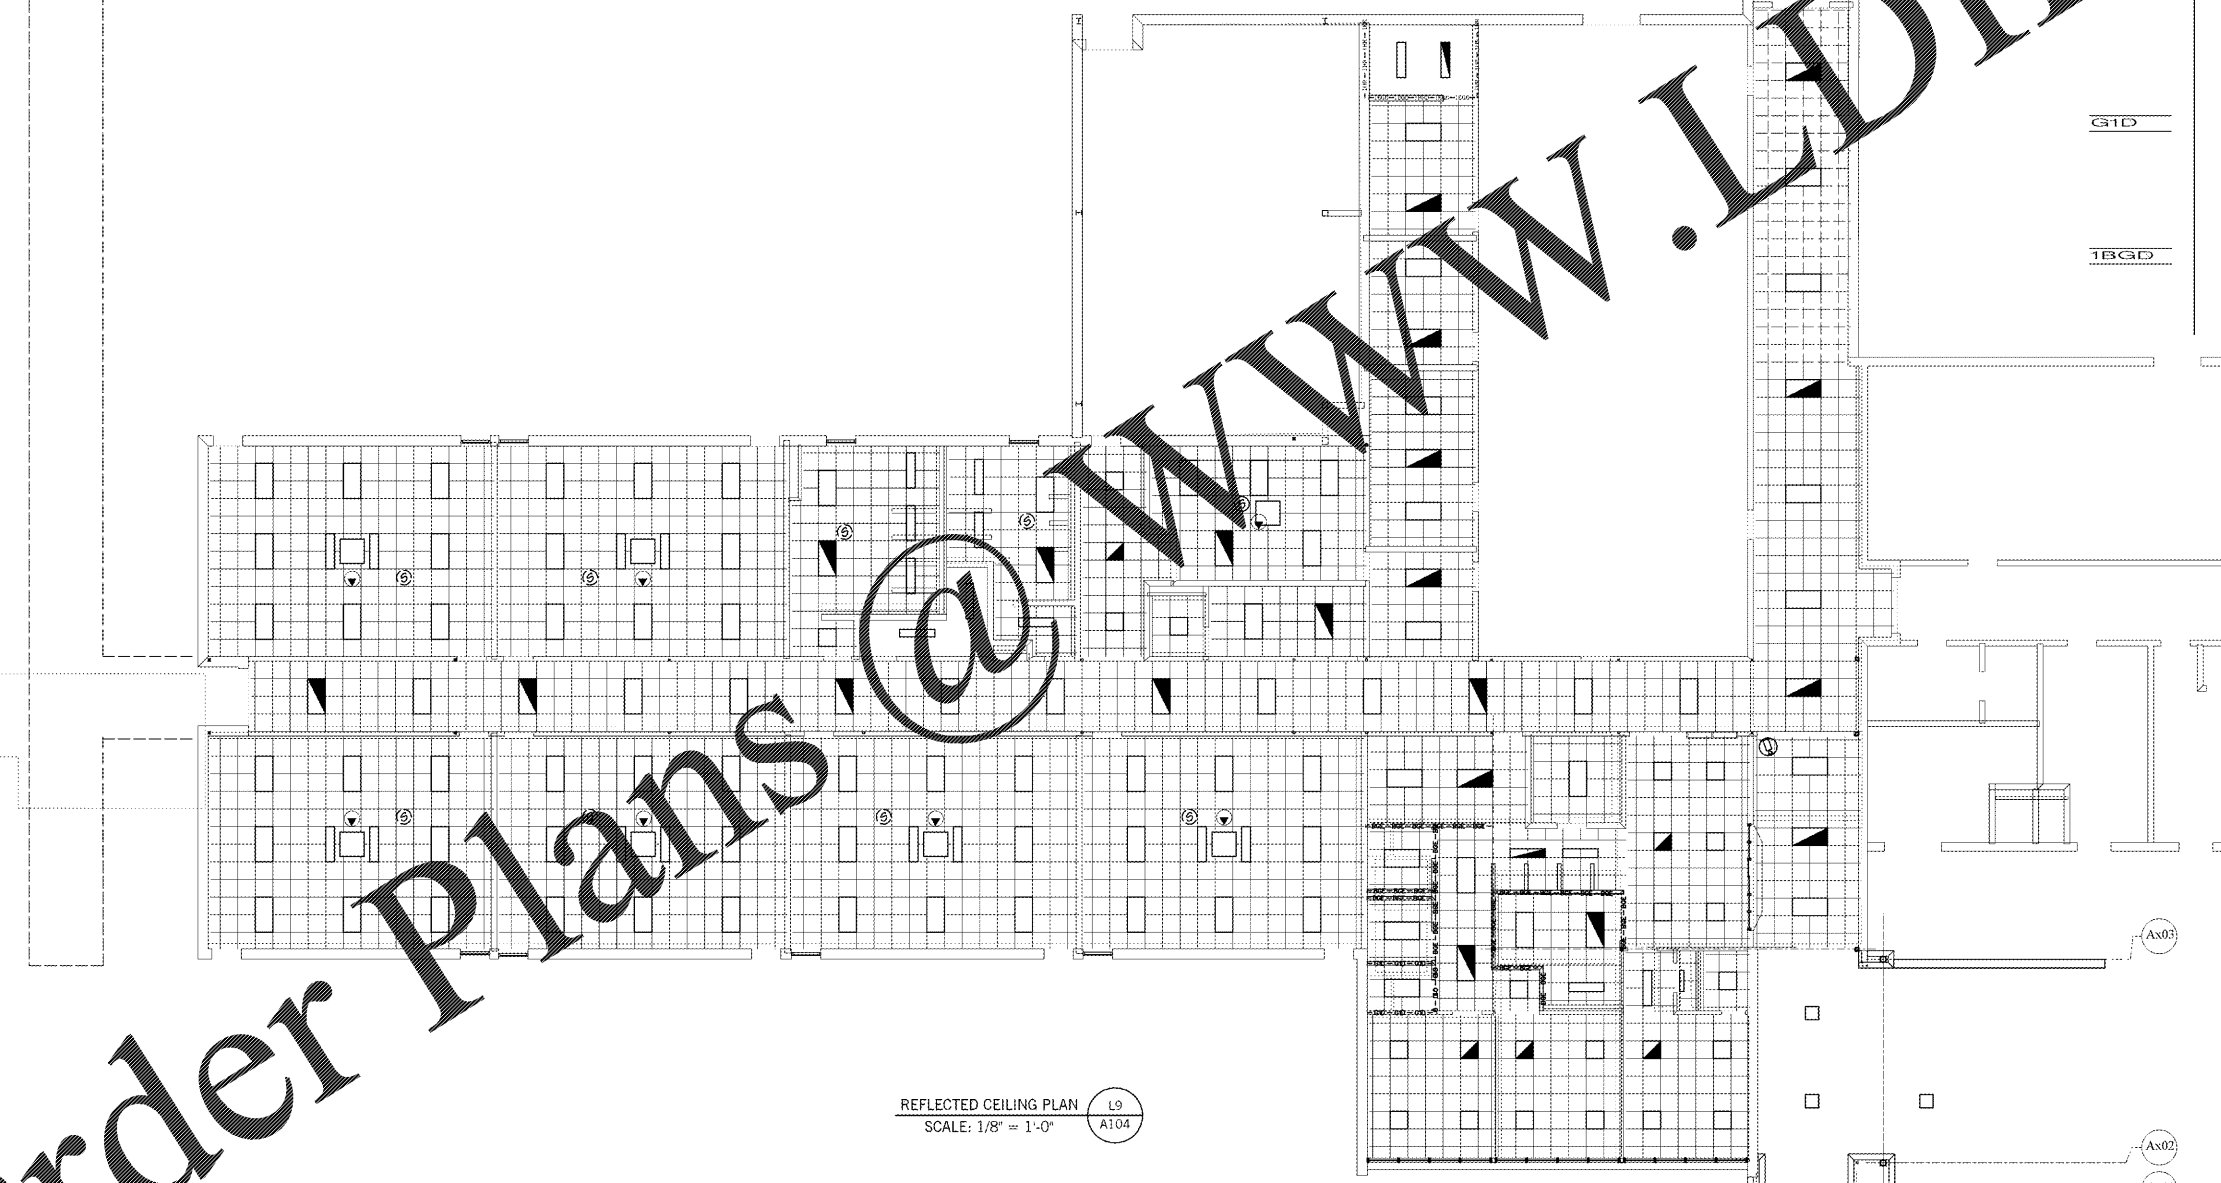

Order Plans @ www.lidilines.com

Southern A&E REVISED
7951 Iron Circle
Austell, Ga. 30168
(770) 819-7777
architects & engineers
DATE: February 28, 2018
JOB NUMBER: 01-847-061
FACILITY CODE NUMBER: 664-1050
RENOVATIONS TO:
BELWOOD ELEMENTARY SCHOOL
GORDON COUNTY BOARD OF EDUCATION
CALHOUN, GEORGIA
DRAWING NUMBER: **A104**

STATE OF GEORGIA
REGISTERED ARCHITECT