

1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20


A
B
C
D
E
F
G
H
I
J
K
L
M
N

- NOTES:
1. WEATHERPROOF ALL EXPOSED DUCTING IN COMPLIANCE WITH SPECIFICATION SECTION 230713 AS APPLICABLE. COVER DUCT WITH VINYL BACKED RIGID BOARD INSULATION AND SEAL.
 2. SEE ARCHITECTURAL FOR FLASHING OF DUCT PENETRATION AT WALL.

DUCT TRANSITION SHALL NOT BLOCK OUTSIDE AIR HOOD AND SHALL BE AS GENTLE AS POSSIBLE.

FULL SIZE, TRAPPED, PVC CONDENSATE LINE - EXTEND FROM UNIT TO 2 1/2" DIA. 4 FT. DEEP GRAVEL DRAIN. SEE DRAIN TRAP DETAIL.

MINIMUM 3" X 3" X 1/8" STEEL ANGLE EQUIVALENT STAND, ALL WELLS. CONSTRUCTION WITH EDGES ROUND SM. TH. MIN. 18" HIGH. CONTRACTORS TO PROVIDE STEEL I BEAMS MAY BE USED. PAINT TO MATCH UNIT.

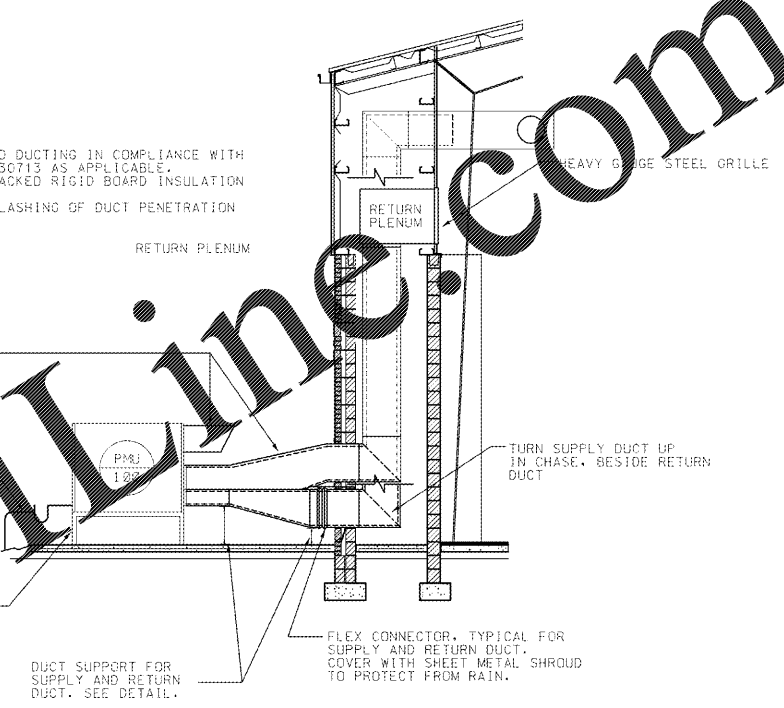

DETAIL- PACKAGED UNIT AT CHASE F19
No Scale M502

Order Plans @ WWW.IDIline.com

Southern A&E 7951 Troon Circle Austell, Ga. 30168 (770) 819-7777 architects & engineers	REVISED
	DATE February 28, 2018
© COPYRIGHT 2018 BY SOUTHERN A&E, LLC. ALL RIGHTS RESERVED. THIS DOCUMENT IS THE PROPERTY OF SOUTHERN A&E, LLC AND SHALL NOT BE COPIED OR REPRODUCED IN WHOLE OR IN PART WITHOUT EXPRESS WRITTEN CONSENT FROM SOUTHERN A&E, LLC.	JOB NUMBER 01-647-061
FACILITY CODE NUMBER: 66-1050 RENOVATIONS TO: BELWOOD ELEMENTARY SCHOOL GORDON COUNTY BOARD OF EDUCATION CALHOUN, GEORGIA	
STATE OF GEORGIA REGISTERED ARCHITECT 	STATE OF GEORGIA REGISTERED ENGINEER
	DRAWING NUMBER M502