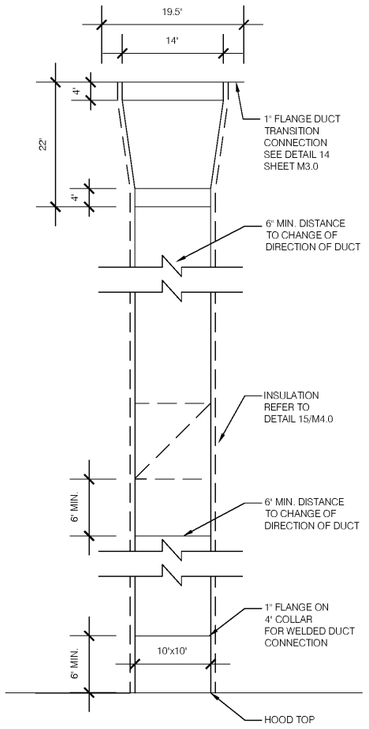

TB HOOD DUCT TRANSITION N.T.S. | 18

NOT USED | 13

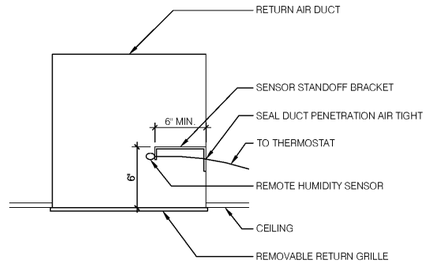

REMOTE HUMIDITY SENSOR N.T.S. | 9

NOT USED | 5

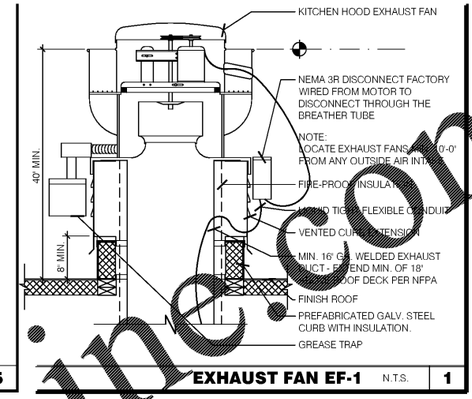

EXHAUST FAN EF-1 N.T.S. | 1

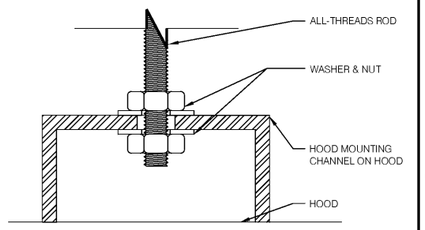

BOLT CONNECTION TO HOOD N.T.S. | 14

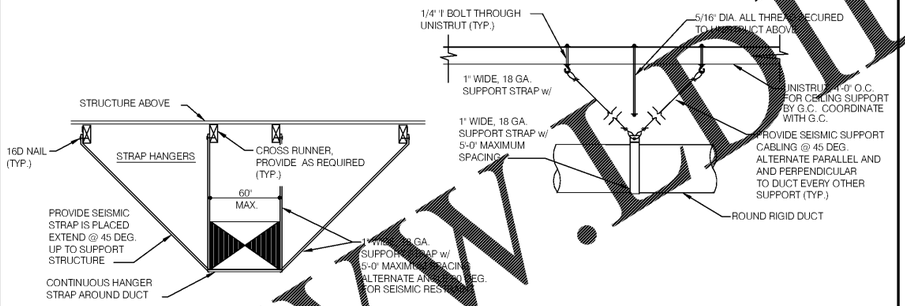

DUCT SUPPORT DETAIL N.T.S. | 6

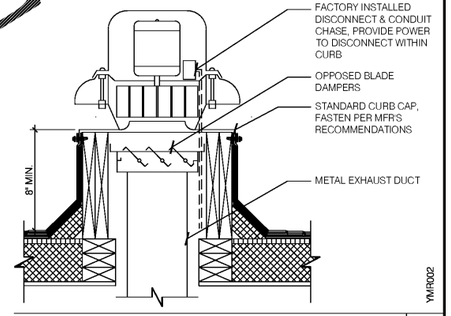

RESTROOM FAN (EF-2) N.T.S. | 2

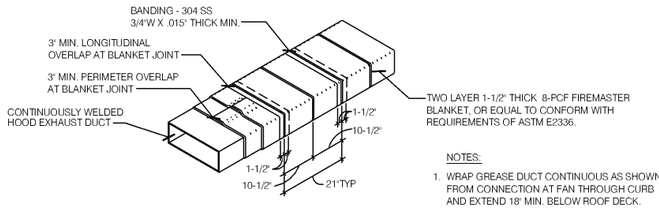

BANDING REQUIREMENTS: USE 304 STAINLESS STEEL BANDS A MAXIMUM 1-1/2" FROM BLANKET EDGE AND SPACED A MAXIMUM OF 10-1/2" ON CENTER.

NOTES:

1. WRAP GREASE DUCT CONTINUOUS AS SHOWN FROM CONNECTION AT FAN THROUGH CURB AND EXTEND 18" MIN. BELOW ROOF DECK.
2. FOR HORIZONTAL RUNS OF EXHAUST DUCTS PROVIDE TYPICAL TRAPEZE SUPPORT SYSTEM WITH 1/2" HANGER RODS A MAXIMUM OF 6" FROM INSULATION EDGE. TRAPEZE SUPPORTS SHALL BE SPACED A MAXIMUM OF 60" ON CENTER FROM CENTERLINE OF VERTICAL EXHAUST DUCT.
3. SLOPE HORIZONTAL EXHAUST DUCT RUNS A MINIMUM OF 1/4" PER FOOT (2% SLOPE) TOWARDS EXHAUST HOOD.
4. PROVIDE INSULATED ACCESS DOOR PANEL NEAR MID POINT OF EXHAUST DUCT RUN FOR CLEANING AND INSPECTION OF DUCT. PROVIDE APPROVED SIGN ON ACCESS DOOR OR PANEL WHICH READS " ACCESS PANEL DO NOT OBSTRUCT".

KITCHEN HOOD EXHAUST DUCT SYSTEM DETAIL N.T.S. | 15

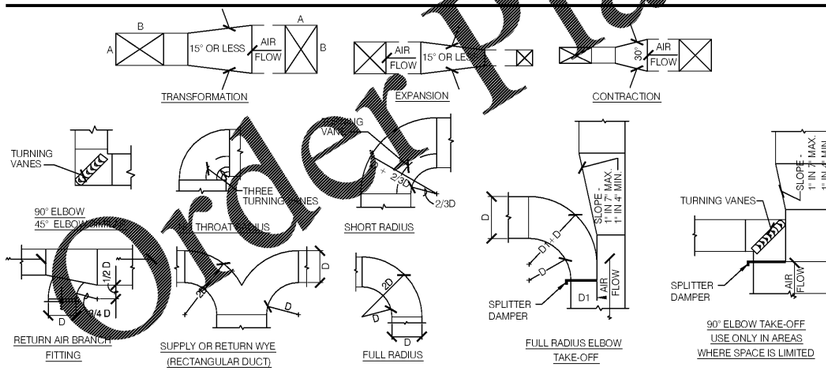

TYPICAL DUCTWORK DETAILS N.T.S. | 16

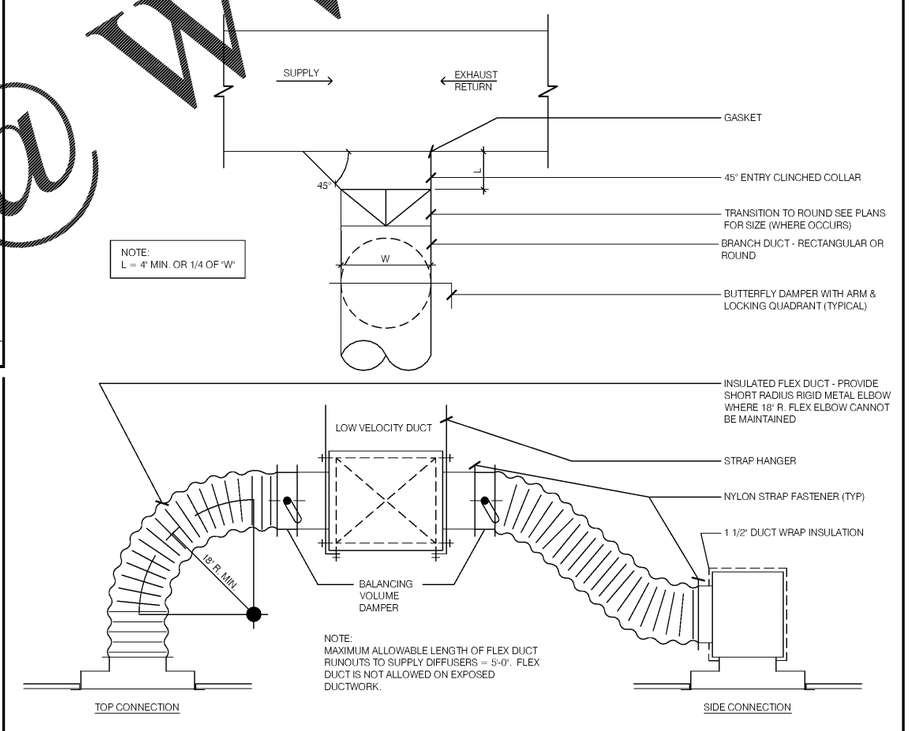

CEILING DIFFUSER CONNECTIONS N.T.S. | 8

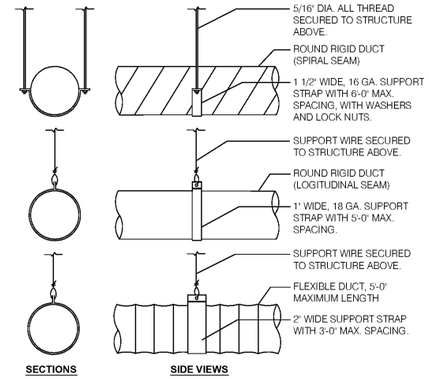

DUCT SUPPORT DETAIL | 4

GLMV ARCHITECTURE, PLLC
1525 E. Douglas Wichita, KS 67211
Tel: (316) 265-9347 Fax: (316) 265-9846
www.glmv.com

DEVITA
ATLANTA • CHARLOTTE • GREENVILLE • RICHMOND
877.4.DEVITA • corp@devitainc.com
DeVita & Associates, Inc. Project ID: 17002-22
Drawn By: MAS Checked By: DV
NC Firm License # C-0819

12144.400

CONTRACT DATE:	10.23.17
BUILDING TYPE:	EXP. LITE MED40
PLAN VERSION:	DECEMBER 2016
SITE NUMBER:	311687
STORE NUMBER:	436563

TACO BELL

3923 SHAKEDOWN ST.
CHARLOTTE, NC

TACO BELL
EXPLORER LITE
MEDIUM54

MECHANICAL AND HOOD DETAILS

M4.0

Order Plans @ www.DILine.com