

REVISIONS	BY

OLIVERI ARCHITECTS
 Member of the American Institute of Architects
 3075 Peachtree Road, Suite 200
 Atlanta, GA 30329 • Phone: 404.271.7811 • Fax: 404.271.7812 • www.oliveriarchitects.com

© 2017 OLIVERI ARCHITECTS, INC.
 ALL RIGHTS RESERVED. THIS DRAWING IS THE PROPERTY OF OLIVERI ARCHITECTS, INC. ALL RIGHTS RESERVED.



WILLIAM O. RITOLA PE
 Georgia Professional Engineer
 License No. 33761
 State of Georgia
 © Copyright 2017 Project No. 17074


New Free Standing Building for
POPEYE'S
 US Highway 29 & Nease Drive
 Athens, Georgia

Date: 11. 07. 17
 Scale: AS NOTED
 Project Mgr: DG
 Drawn: IT/WR
 Job: 17-083

Sheet
ES1


DRAWING NOTES

- UTILITY COMPANY 12/2008Y 3 PHASE PAD MOUNTED UTILITY TRANSFORMER.
- PROVIDE AND INSTALL JUNCTION BOX FOR PYLON SIGNAGE. PROVIDE DISCONNECT TO SIGNAGE PER ARTICLE 600-2 OF THE N.E.C. ROUTE HOME RUN VIA LIGHTING CONTRACTOR LCI. COORDINATE EXACT LOCATION WITH GENERAL CONTRACTOR AND OWNER.
- PROVIDE FINAL CONNECTION TO DIRECTIONAL SIGNS. COORDINATE EXACT LOCATION AND QUANTITY WITH SIGN INSTALLER AND GENERAL CONTRACTOR. ROUTE HOME RUN VIA LIGHTING TIME CLOCK.

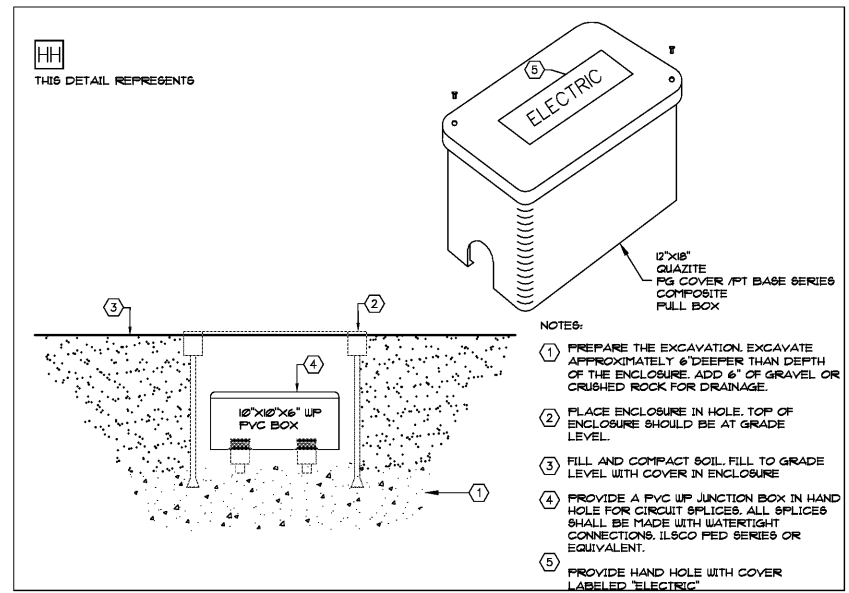

Symbol	Qty	Label	Arrangement	Lumens/Lamp	LLF	Total Watts	Description
	7	OSQ-4ME	SINGLE	1700	1.000	1190	OSQ-A-NM-4ME-T-57K-UL-BK

FIXTURE MOUNTING HEIGHT: 27' AFG (25' POLE + 2' BASE)
 ADDITIONAL EQUIPMENT REQUIRED:
 (7) CL-88F-40H-25-OT-BZ (25' x 4" 80 POLE, TENON MOUNT)
 (7) OSQ-0ABZ DIRECT ARM MOUNT
 PROPOSED POLES MEET 20MPH SUSTAINED WIND LOADS

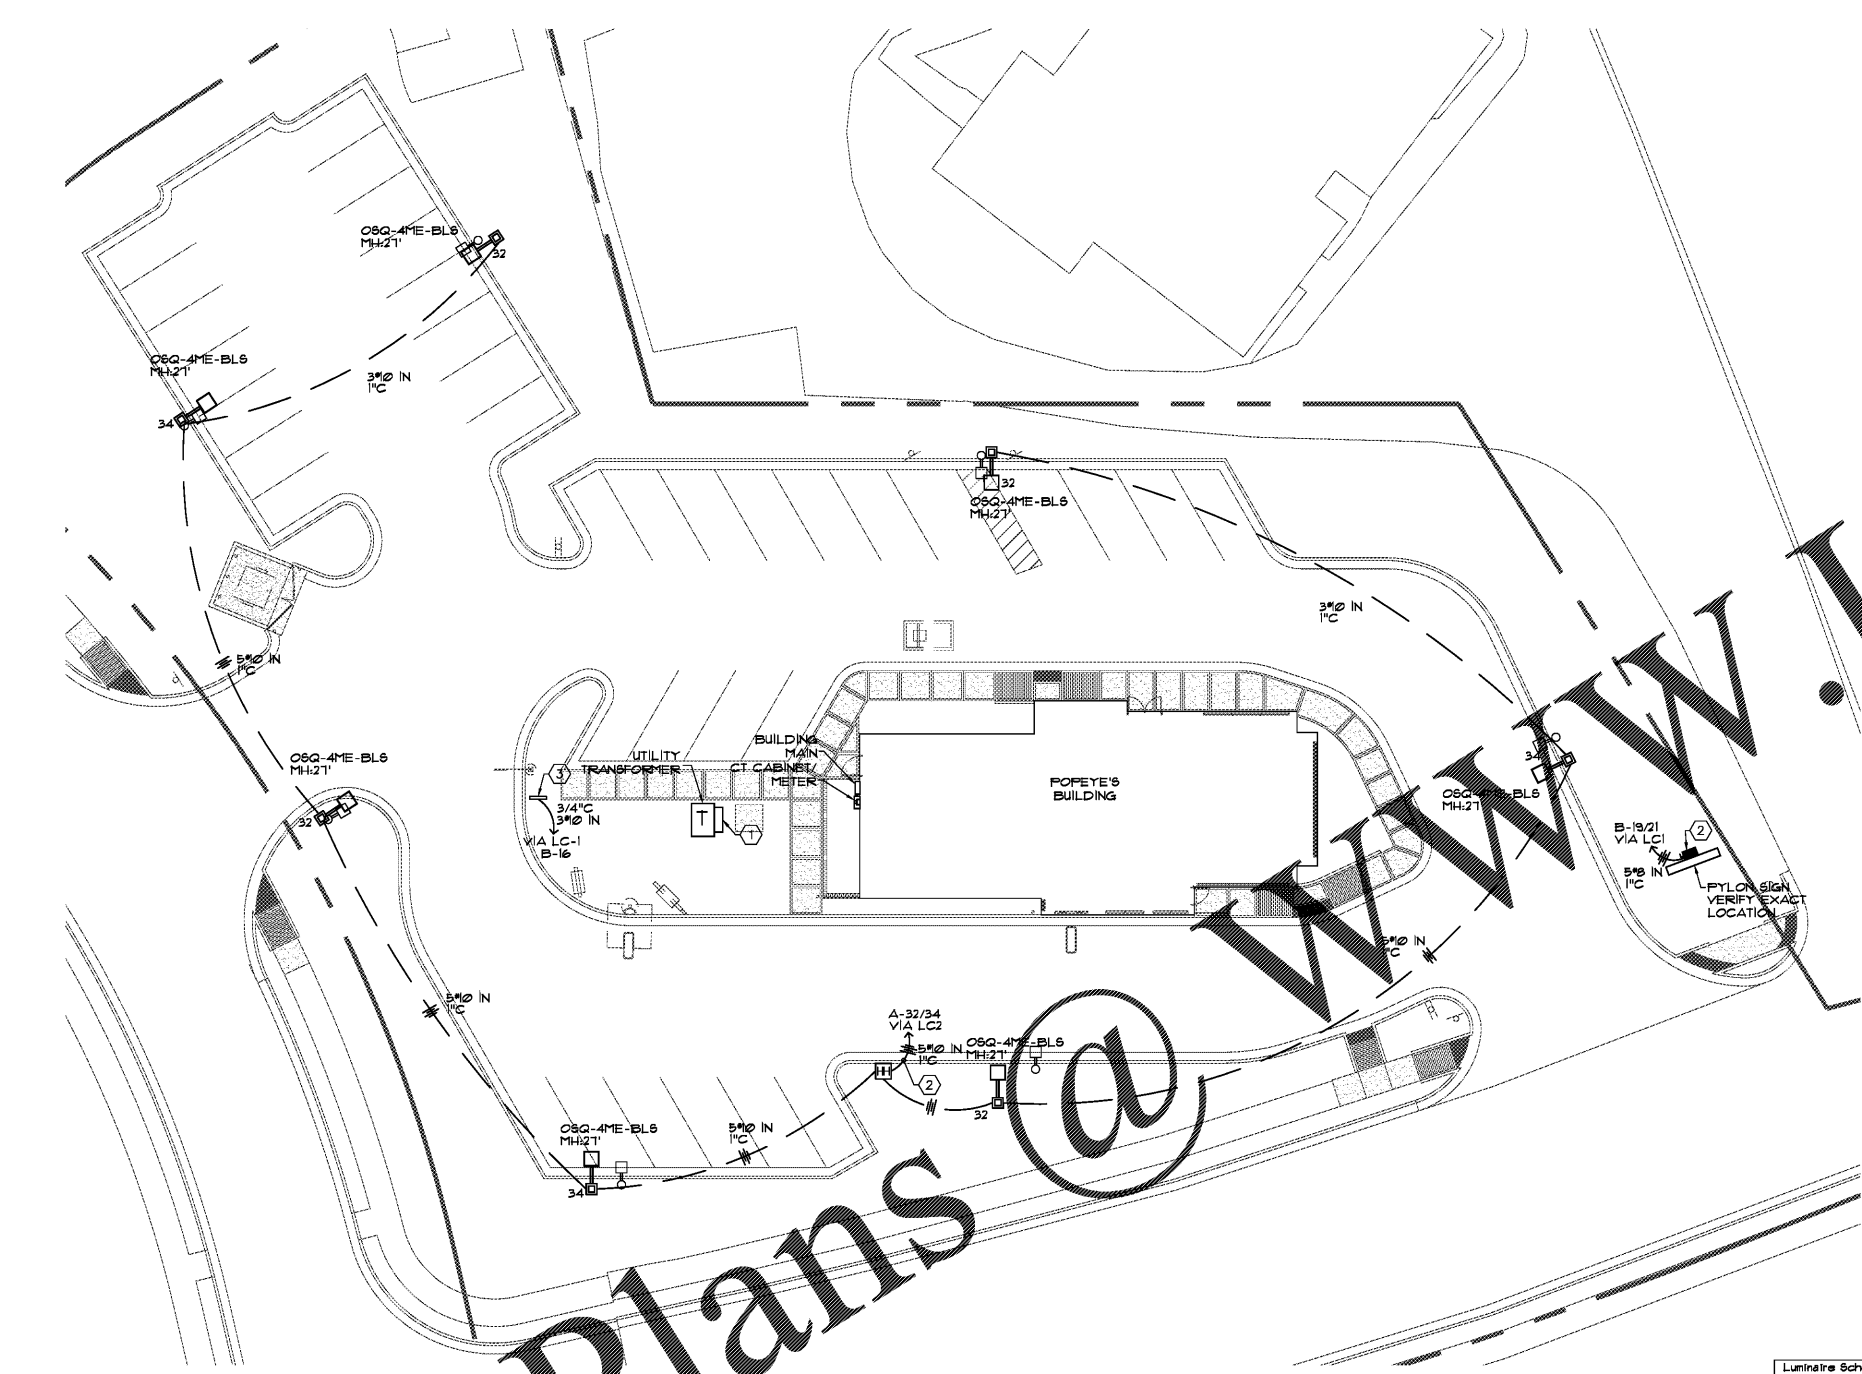

Order Plans @ www.LDILine.com