
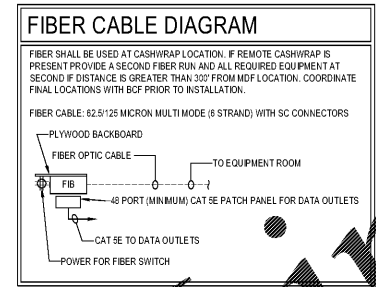



Order Plans @

WWW.LDILine.com

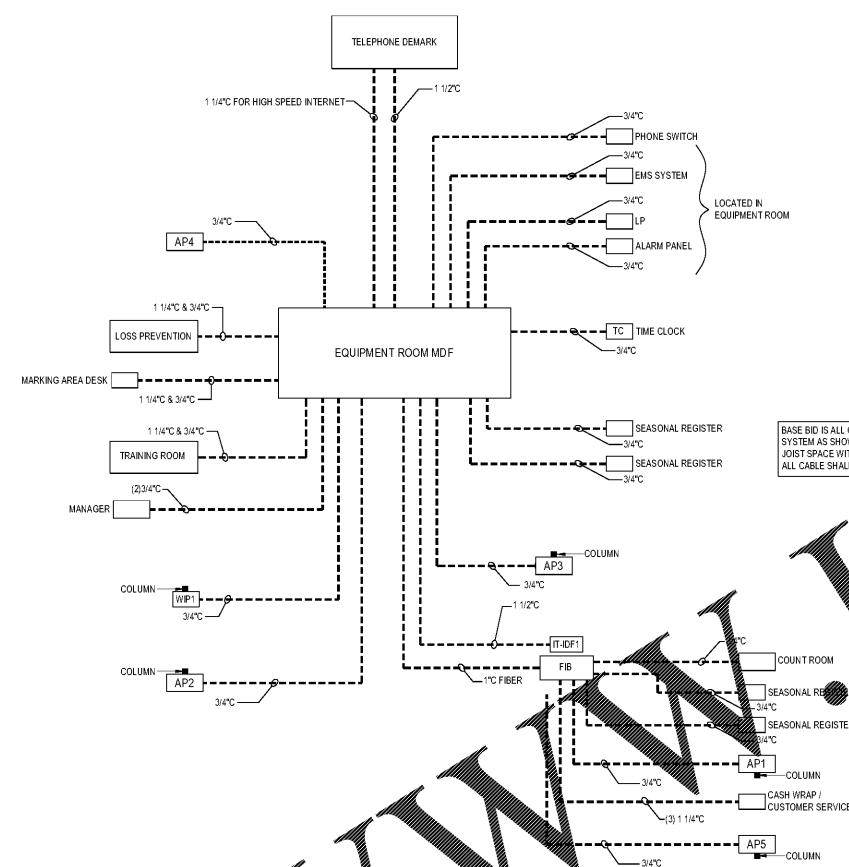


BASE BID IS ALL CAT5E CABLE SHALL BE RUN IN A CONDUIT SYSTEM AS SHOWN. PROVIDE AN ALTERNATE JOIST SPACE WITH CONDUIT STUBS FROM JOIST SPACE TO CABLE. ALL CABLE SHALL BE PLENUM RATED. BASE BID & ALTERNATE.

1 TYPICAL DATA CONDUIT REQUIREMENTS DIAGRAM NOT TO SCALE



2 DATA JACK LABELING - EIA606B STANDARD NOT TO SCALE

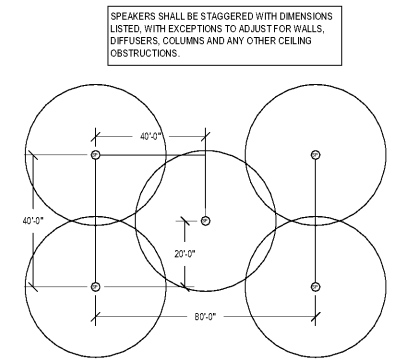

SPEAKERS SHALL BE STAGGERED WITH DIMENSIONS LISTED, WITH EXCEPTIONS TO ADJUST FOR WALLS, DIFFUSERS, COLUMNS AND ANY OTHER CEILING OBSTRUCTIONS.

PETER M. HONEYFORD
PROFESSIONAL ENGINEER
VA BUSINESS ENTITY PERMIT NO. 427705483
VA LICENSE NUMBER 402228541
EXP: 11/30/2019

PMH ASSOCIATES, INC.
PROFESSIONAL ELECTRICAL, FIRE PROTECTION & STRUCTURAL ENGINEERING
1217 N. CHEROKEE ST. STE. B WOODBRIDGE, VA 22191
TEL: (703) 591-1144 FAX: (703) 591-1731 WWW.PMH-ASSOCIATES.COM
1000 W. BURNING WOOD DR. SUITE 100 CHARLOTTE, NC 28203
TEL: (704) 484-1144 FAX: (704) 484-1144 WWW.PMH-ASSOCIATES.COM

801 Chapel Avenue East
 Cherry Hill, New Jersey 08034
 P 856.428.8877
 F 856.429.6379
 W ignarrilummis.com

Date: _____
 William J Fearon AIA
 VA 017851

CLIENT & PROJECT

Burlington
 BURLINGTON STORES, INC.
 1830 ROUTE 130 NORTH
 BURLINGTON, NEW JERSEY
 08016

TENANT IMPROVEMENT FOR
MANASSAS, VA
STORE #188

SUDLEY TOWN PLAZA
 7685 SUDLEY ROAD
 MANASSAS, VA 20109

DISTRIBUTION:	DATE:
PERMIT SUBMISSION	02-22-2018

PROJECT INFO:
 PROJECT NUMBER:
 9333_10
 DRAWN: PPW
 CHECKED: JMD

NOTE & COPYRIGHT:
 CONTRACTOR SHALL VERIFY EXISTING CONDITIONS AND CORRELATE DIMENSIONS PRIOR TO PROVIDING THE WORK DETAILED IN THESE DRAWINGS AND SHALL PROMPTLY NOTIFY THE ARCHITECT OF ANY DISCREPANCIES.
 UNAUTHORIZED REPRODUCTION OR OTHER USE OF THIS DRAWING IS PROHIBITED.

DRAWING NAME & TITLE:
 COMMUNICATIONS
 DETAILS
E7.1