

SEAL:  
THIS DOCUMENT IS NOT FOR CONSTRUCTION  
UNLESS THE ARCHITECT OR ENGINEER'S  
SIGNATURE AND SEAL APPEAR BELOW.

NOT FOR  
CONSTRUCTION

BID SET  
04-10-18

NO.	DATE	REVISIONS	REMARKS




**RAINBOW CHILD CARE CENTER**

C - PROTOTYPE  
2609 W. LAKE MARY BLVD.  
LAKE MARY, FL 32746



PROJECT NO: 2017.0250  
DATE: 12.22.17

**P.200**  
WASTE AND VENT RISER  
DIAGRAM

CHECKED: ROH DRAWN: PH

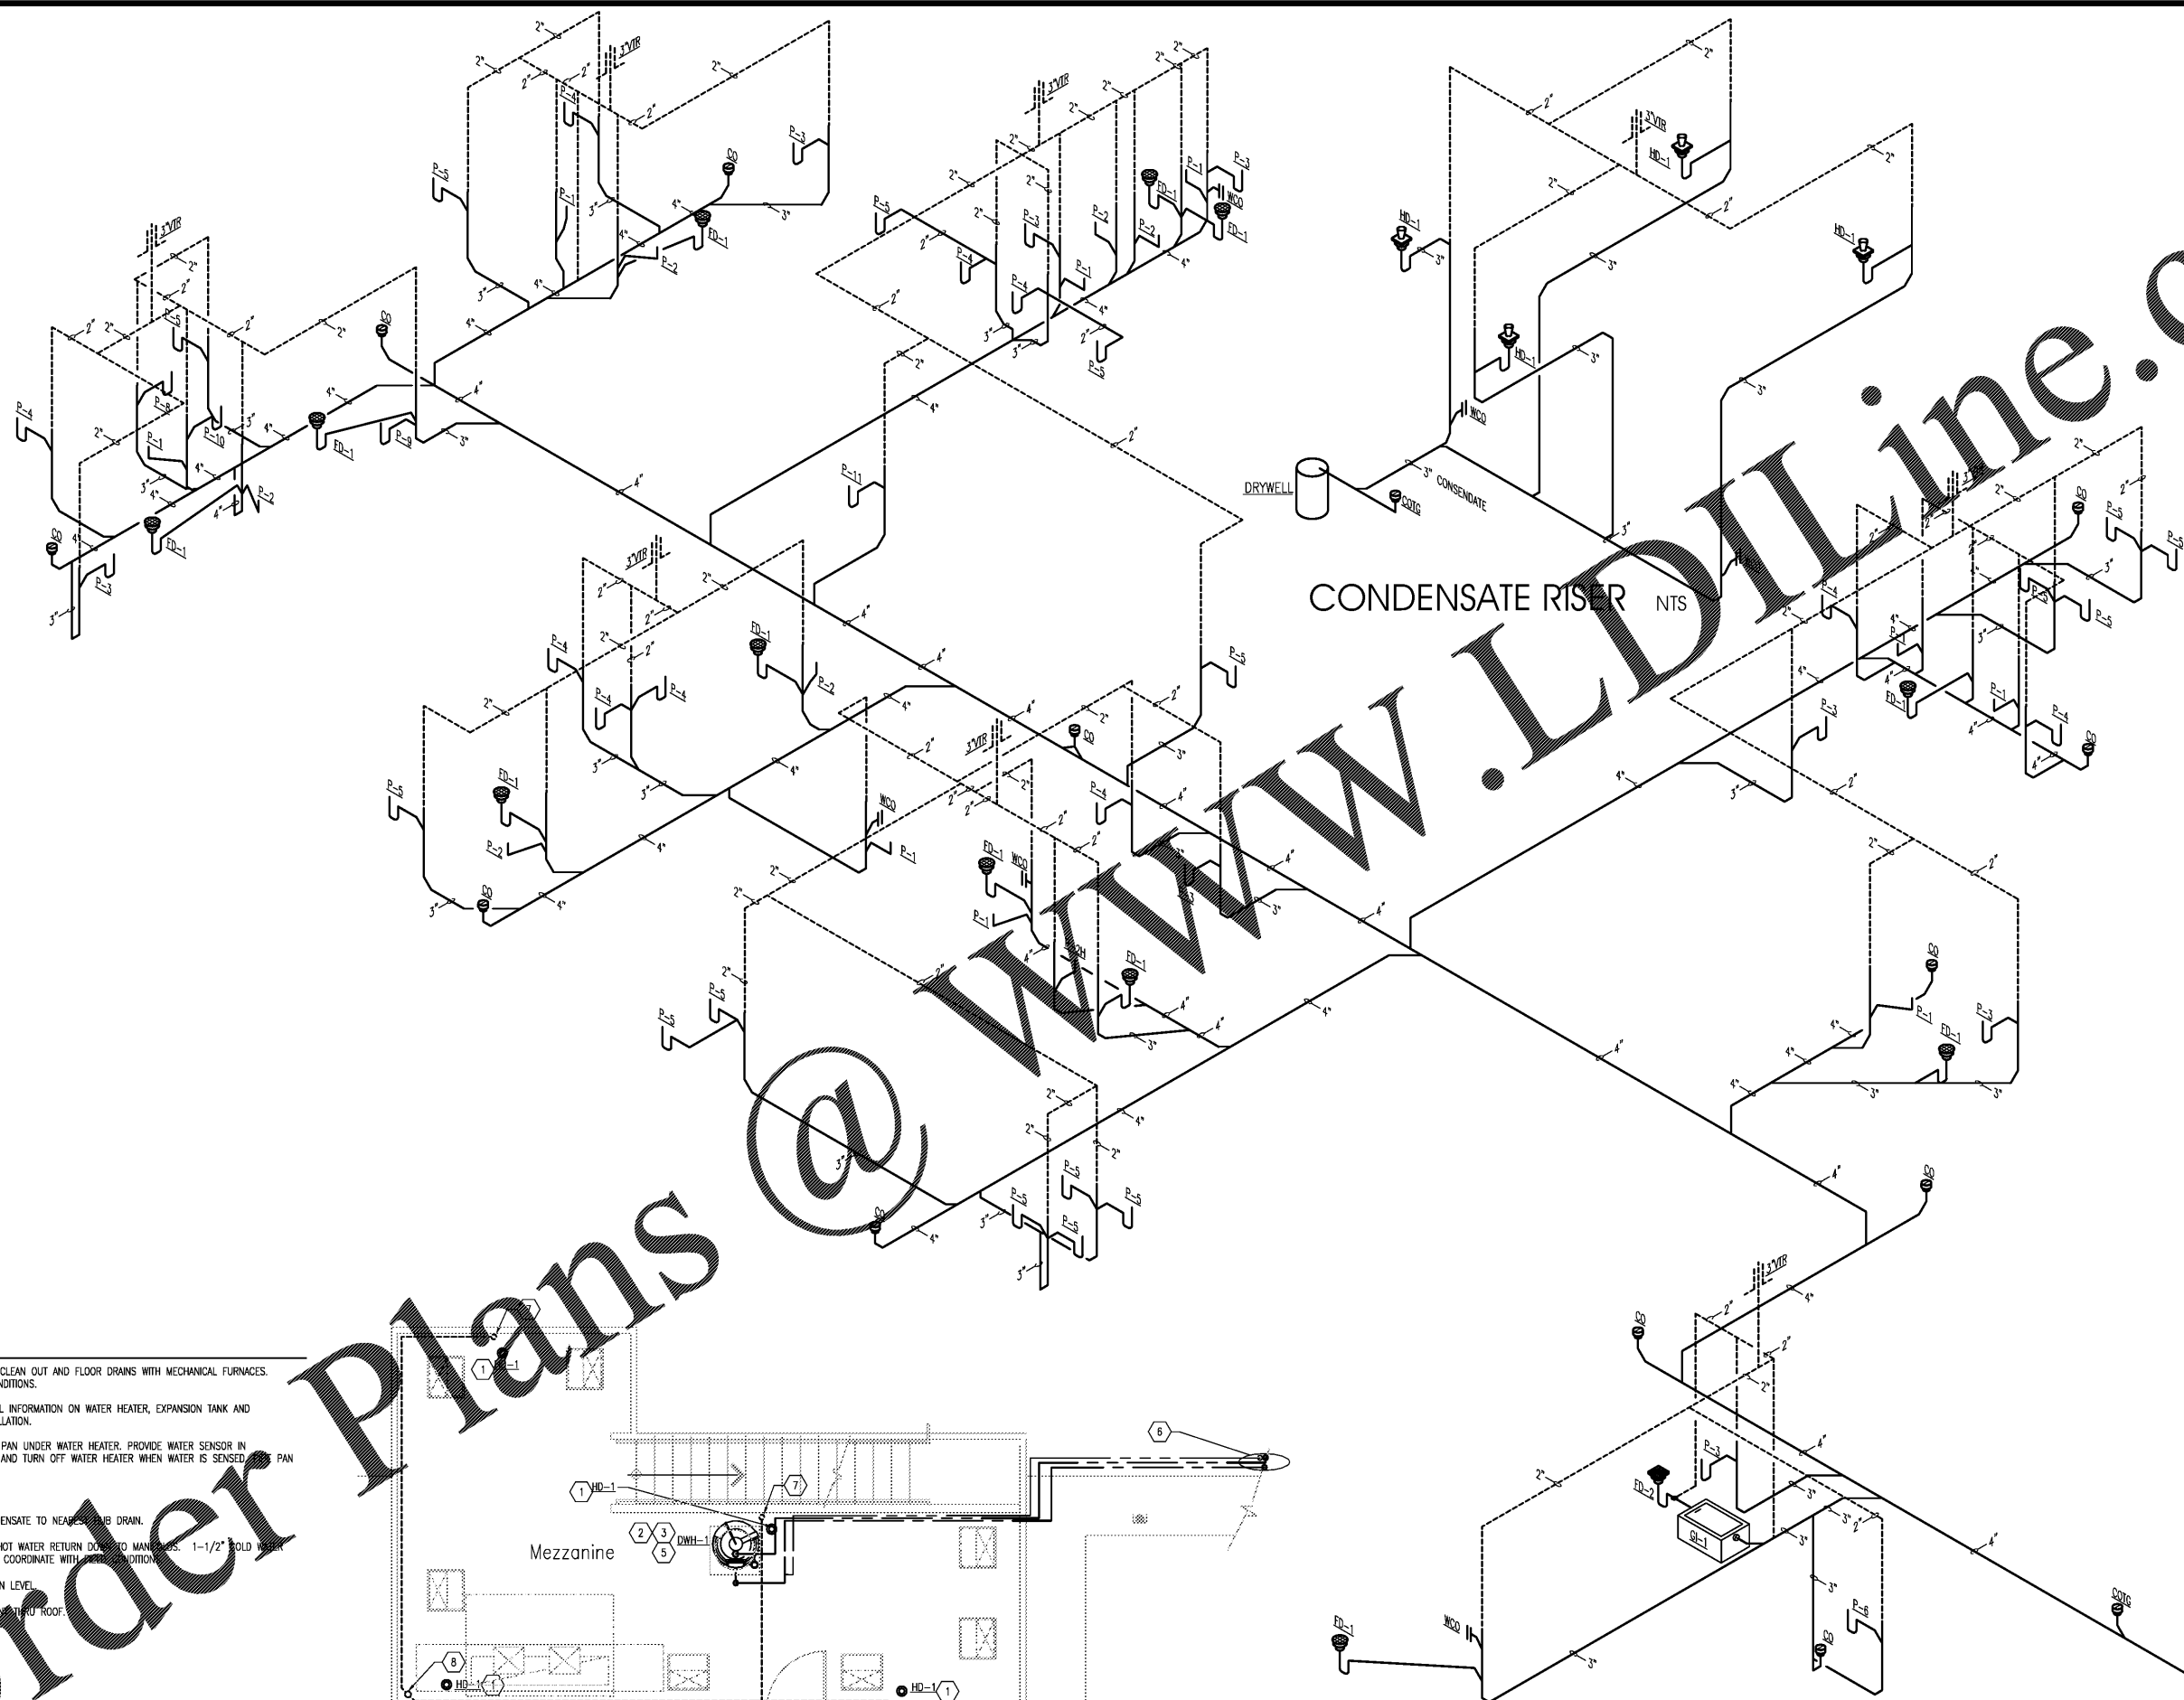

- KEY NOTES**
- COORDINATE LOCATIONS OF CLEAN OUT AND FLOOR DRAINS WITH MECHANICAL FURNACES. COORDINATE WITH FIELD CONDITIONS.
  - SEE DETAILS FOR ADDITIONAL INFORMATION ON WATER HEATER, EXPANSION TANK AND RECIRCULATING PUMP INSTALLATION.
  - PROVIDE SECONDARY DRAIN PAN UNDER WATER HEATER. PROVIDE WATER SENSOR IN SECONDARY PAN TO ALARM AND TURN OFF WATER HEATER WHEN WATER IS SENSED IN PAN TO FLOOR DRAIN.
  - NOT USED.
  - ROUTE WATER HEATER CONDENSATE TO NEAREST FLOOR DRAIN.
  - 1-1/2" HOT AND 1-1/4" HOT WATER RETURN DOWN TO MAIN FLOOR. 1-1/2" COLD WATER DOWN TO BELOW GROUND. COORDINATE WITH FIELD CONDITIONS.
  - 1-1/2" VENT DOWN TO MAIN LEVEL.
  - 1-1/2" VENT UP TO 3" VENT THROUGH ROOF.

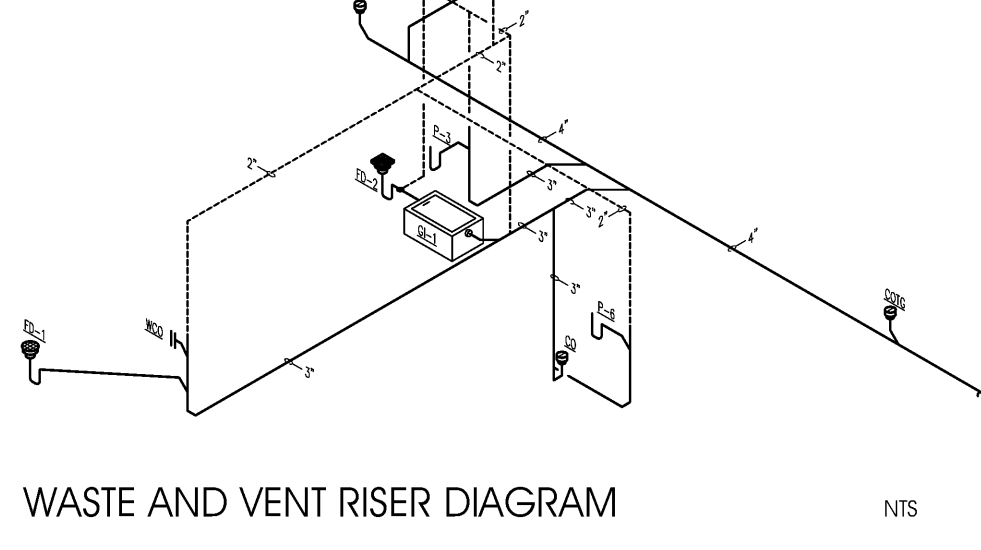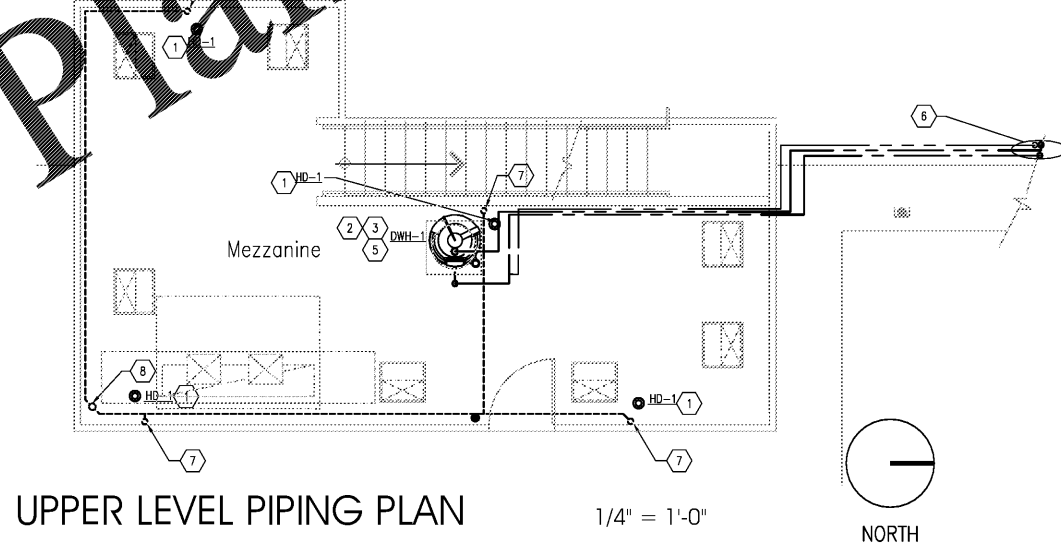

Order Plans @ [www.LDOnline.com](http://www.LDOnline.com)

COPYRIGHT © 2017 INTERPLAN, LLC. RESERVE COPYRIGHT & OTHER RIGHTS RESTRICTING THESE DOCUMENTS TO THE ORIGINAL SET OR PURPOSE FOR WHICH THEY WERE PREPARED. REPRODUCTIONS, CHANGES OR ASSIGNMENTS ARE PROHIBITED.