

SEAL:
THIS DOCUMENT IS NOT FOR CONSTRUCTION
UNLESS THE ARCHITECT OR ENGINEER'S
SIGNATURE AND SEAL APPEAR BELOW.

NOT FOR
CONSTRUCTION

BID SET
04-10-18

NO.	DATE	REVISIONS	REMARKS




RAINBOW CHILD CARE CENTER

C - PROTOTYPE
2609 W. LAKE MARY BLVD.
LAKE MARY, FL 32746

PROJECT NO: 2017.0250
DATE: 12.22.17

P.200
WASTE AND VENT RISER
DIAGRAM


CHECKED: ROH DRAWN: PH

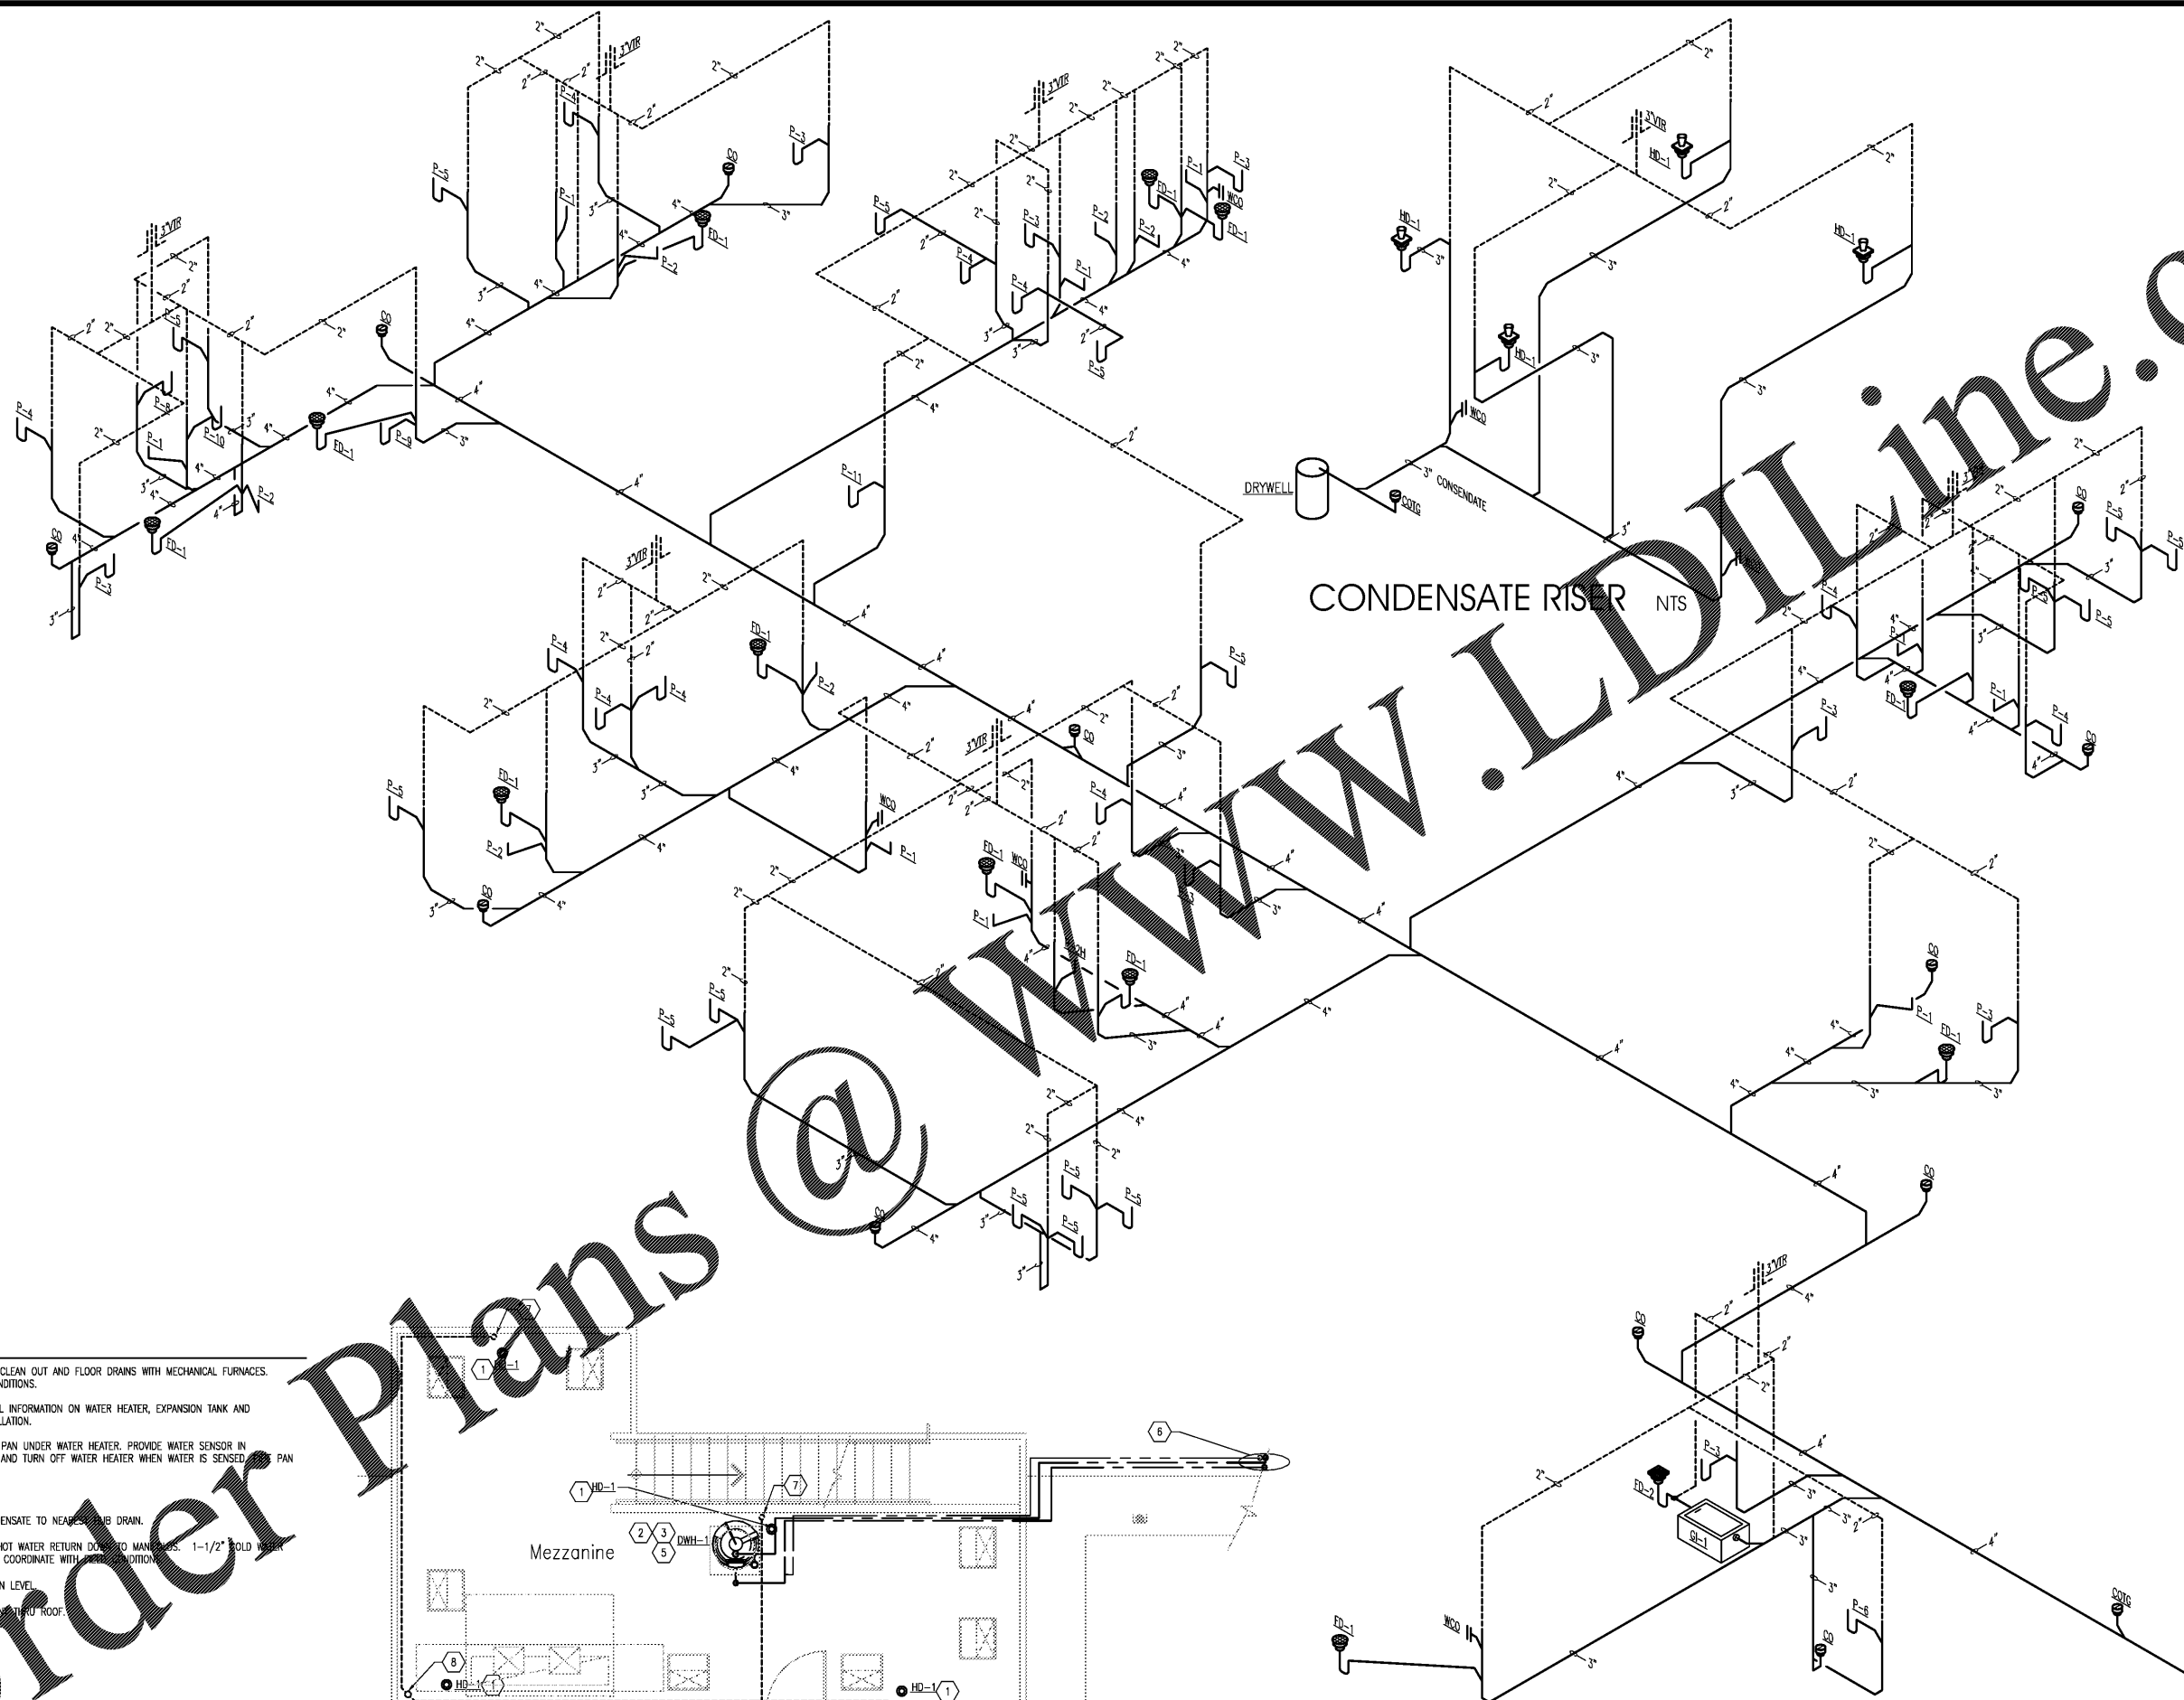

- KEY NOTES**
- COORDINATE LOCATIONS OF CLEAN OUT AND FLOOR DRAINS WITH MECHANICAL FURNACES. COORDINATE WITH FIELD CONDITIONS.
 - SEE DETAILS FOR ADDITIONAL INFORMATION ON WATER HEATER, EXPANSION TANK AND RECIRCULATING PUMP INSTALLATION.
 - PROVIDE SECONDARY DRAIN PAN UNDER WATER HEATER. PROVIDE WATER SENSOR IN SECONDARY PAN TO ALARM AND TURN OFF WATER HEATER WHEN WATER IS SENSED IN PAN TO FLOOR DRAIN.
 - NOT USED.
 - ROUTE WATER HEATER CONDENSATE TO NEAREST FLOOR DRAIN.
 - 1-1/2" HOT AND 1-1/4" HOT WATER RETURN DOWN TO MAIN FLOOR. 1-1/2" COLD WATER DOWN TO BELOW GROUND. COORDINATE WITH FIELD CONDITIONS.
 - 1-1/2" VENT DOWN TO MAIN LEVEL.
 - 1-1/2" VENT UP TO 3" VENT THROUGH ROOF.

UPPER LEVEL PIPING PLAN

1/4" = 1'-0"



WASTE AND VENT RISER DIAGRAM

NTS

Order Plans @ www.LDOnline.com

COPYRIGHT © 2017 INTERPLAN, LLC. RESERVE COPYRIGHT & OTHER RIGHTS RESTRICTING THESE DOCUMENTS TO THE ORIGINAL SET OR PURPOSE FOR WHICH THEY WERE PREPARED. REPRODUCTIONS, CHANGES OR ASSIGNMENTS ARE PROHIBITED.