

SEAL:  
THIS DOCUMENT IS NOT FOR CONSTRUCTION  
UNLESS THE ARCHITECT OR ENGINEER'S  
SIGNATURE AND SEAL APPEAR BELOW.

NOT FOR  
CONSTRUCTION


BID SET  
04-10-18

KEYED NOTES

1. PROVIDE SECONDARY CONDUITS FROM UTILITY TRANSFORMER TO CT/METER MOUNTED ON BUILDING EXTERIOR. VERIFY EXACT REQUIREMENTS WITH LOCAL UTILITY COMPANY PRIOR TO INSTALLATION.
2. PROVIDE METER ON BUILDING EXTERIOR PER LOCAL UTILITY COMPANY REQUIREMENTS.
3. SEE POLE BASE DETAIL THIS SHEET. ALL SITE LIGHTING CONDUIT IS TO BE UNDERGROUND.
4. PROVIDE ONE 4" UNDERGROUND PVC CONDUIT WITH PULL STRING PER TELEPHONE UTILITY COMPANY'S SPECIFICATIONS AND REQUIREMENTS FOR TELEPHONE SERVICE. COORDINATE EXACT ROUTING AND STUB-UP LOCATION WITH THE TELEPHONE UTILITY COMPANY AND CLEARLY MARK STUB-UP LOCATION. STUB-UP LOCATION INDICATED ARE BASED ON INFORMATION THAT WAS AVAILABLE DURING DESIGN. SUBMIT A LINEAL FOOT UNIT PRICE WITH THE BID FOR ADDITIONAL CONDUIT, OF EACH SIZE AND TYPE INDICATED, IN THE EVENT THE TELEPHONE UTILITY COMPANY DIRECTED STUB-UP LOCATION DIFFERS FROM WHAT IS INDICATED.
5. VERIFY EXACT LOCATION WITH OWNER MONUMENT SIGN. PROVIDE WEATHERPROOF JUNCTION BOX AND 20 AMP SINGLE SWITCH 18" AFG FOR MAINTENANCE DISCONNECT SWITCH FOR METER.
6. PROVIDE GFCI TYPE WEATHERPROOF RECEPTACLE MOUNTED ON MAIN SIGN SUPPORT 4' TO 6'. THIS RECEPTACLE SHALL NOT BE SWITCHED. (BYPASS THE FACTOR TO SIGN'S DISCONNECT SWITCH.)


LAKE MARY BLVD

FIFTH STREET

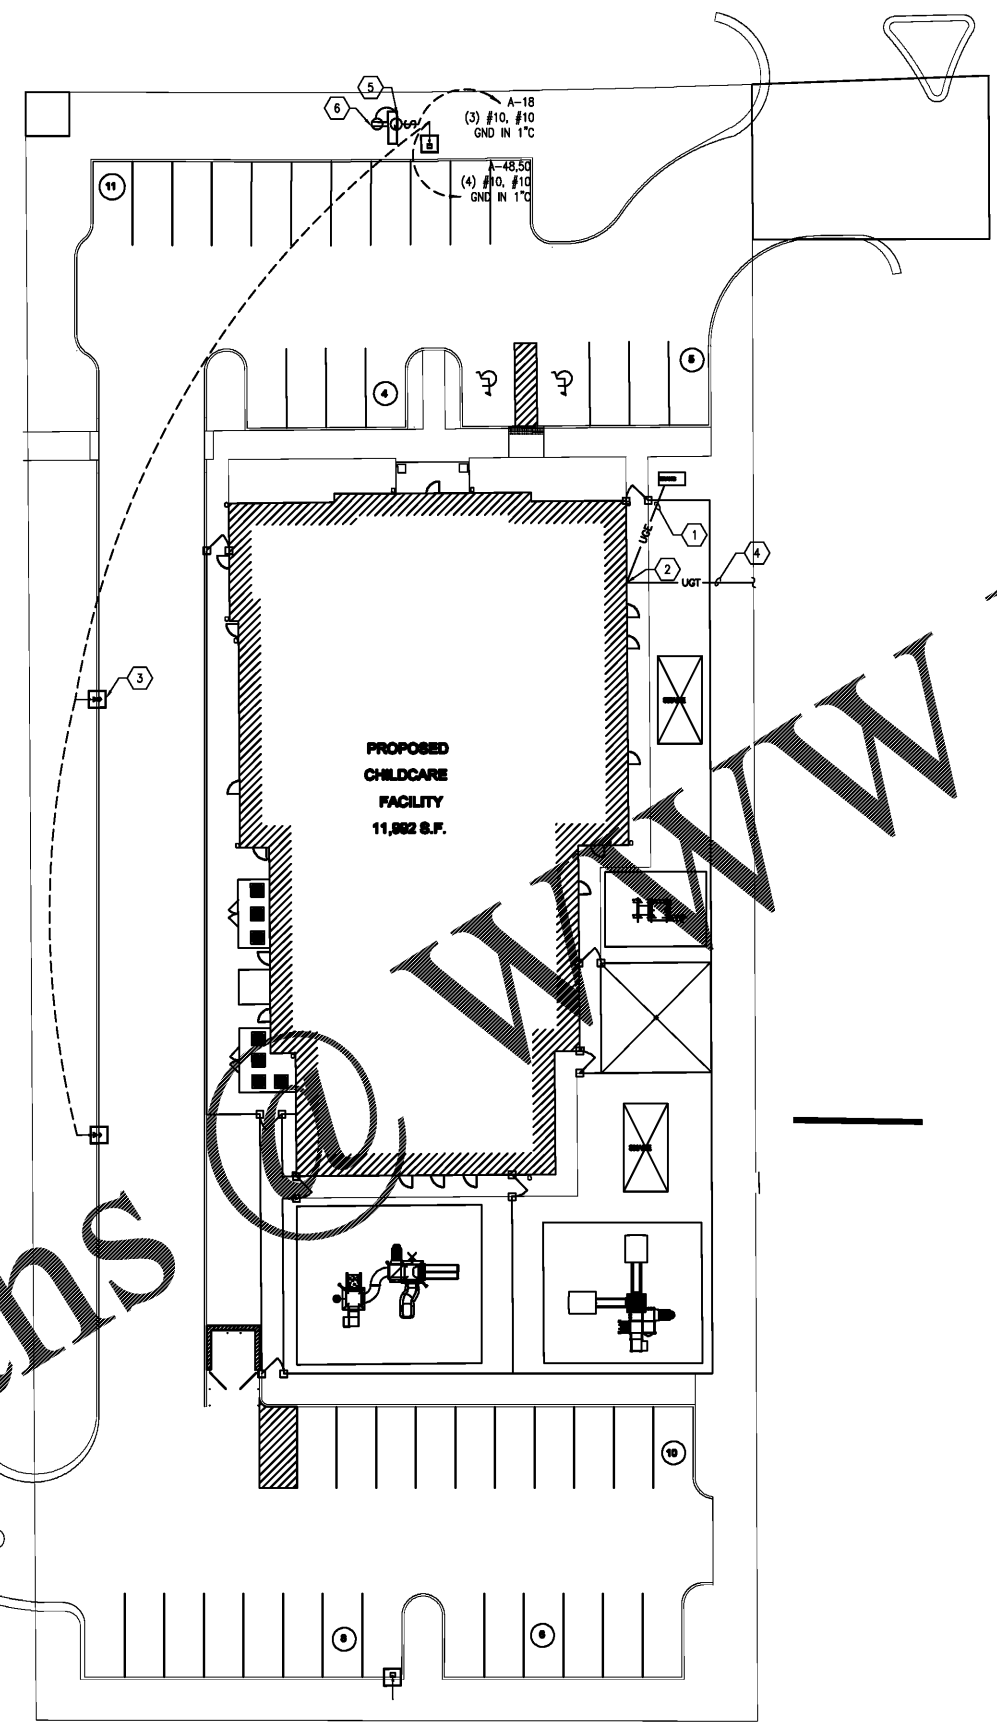

PROPOSED  
CHILDCARE  
FACILITY  
11,882 S.F.

WWW.LDILine.com

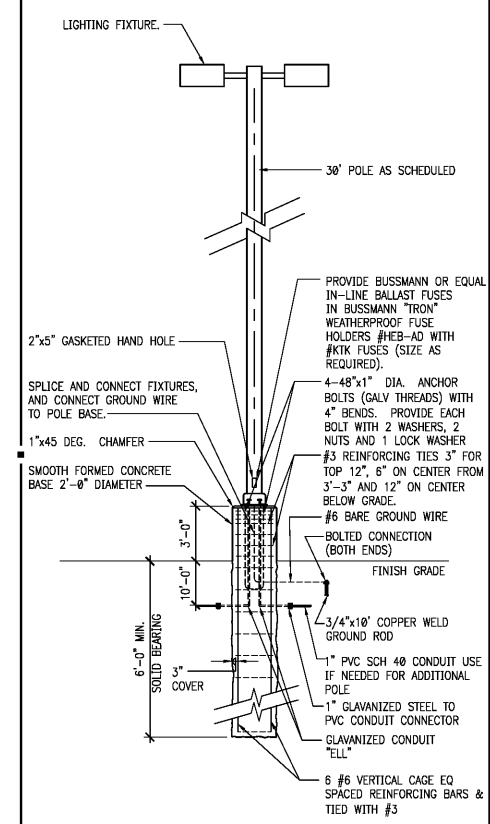

1 DETAIL - POLE BASE

NO.	DATE	REMARKS



**RAINBOW CHILD CARE CENTER**  
C - PROTOTYPE  
2609 W. LAKE MARY BLVD.  
LAKE MARY, FL 32746

PROJECT NO: 2017.0250  
DATE: 12.22.17

**E.010**  
ELECTRICAL SITE PLAN

CHECKED: AG DRAWN: DMS

Order Plans

ELECTRICAL SITE PLAN

1" = 20'



INTERPLAN ENGINEERING ARCHITECTURE INTERIOR DESIGN PROJECT MANAGEMENT 604 COURTLAND STREET SUITE 100 ORLANDO, FLORIDA 32804 PH 407.645.5008 FX 407.629.9124