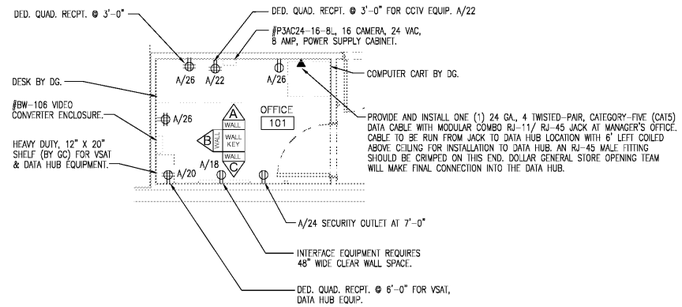

1 ENLARGED OFFICE POWER PLAN

SCALE 1/4" = 1'-0"

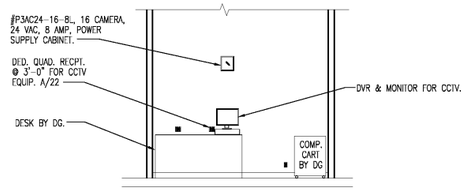

WALL "A"

SCALE : NTS

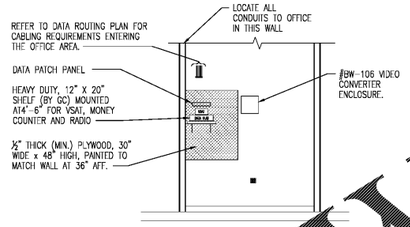

WALL "B"

SCALE : NTS

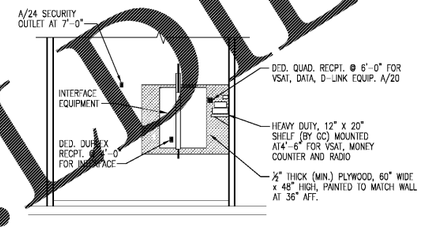

WALL "C"

SCALE : NTS

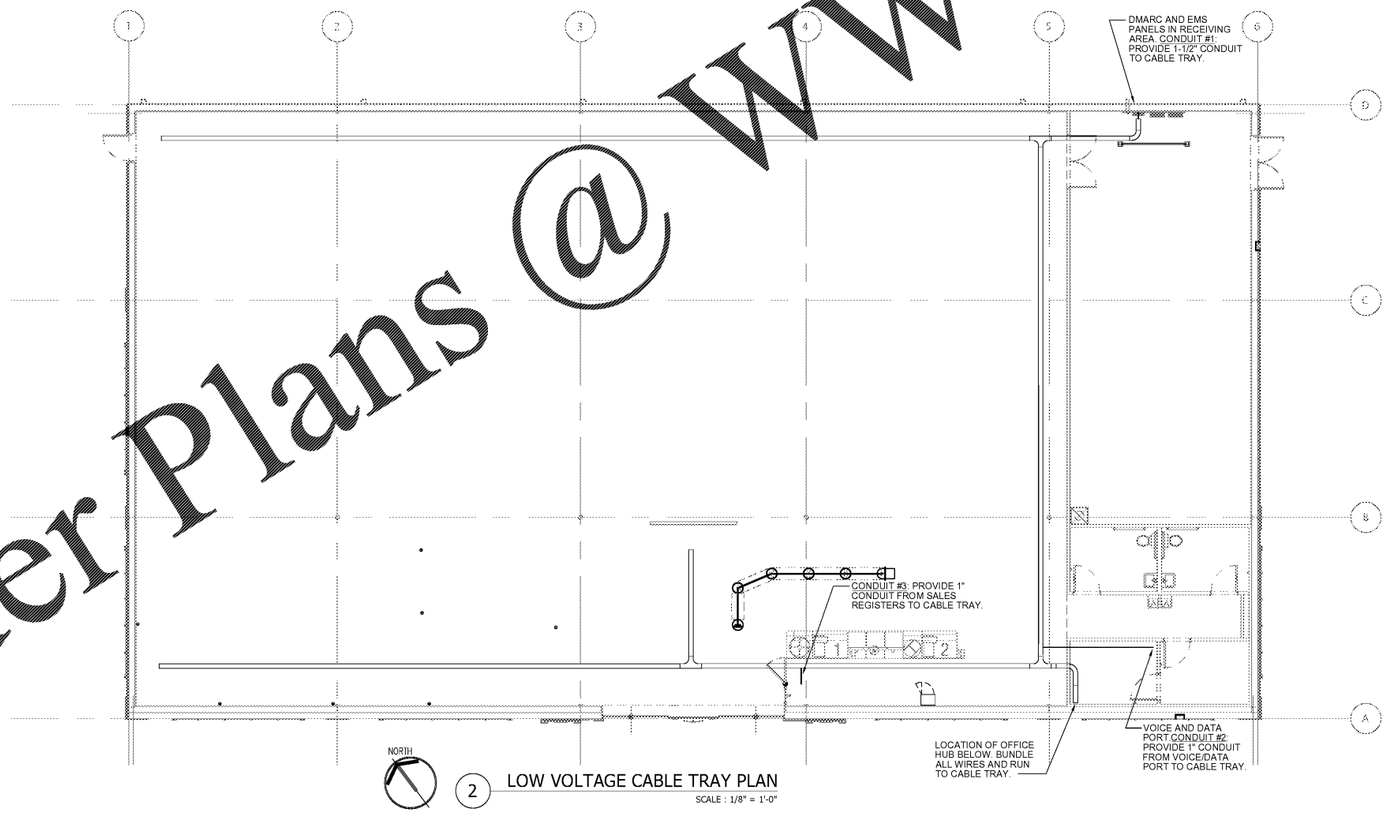

2 LOW VOLTAGE CABLE TRAY PLAN

SCALE : 1/8" = 1'-0"

NOTES:

1) CABLE TRAY SHALL BE MOUNTED SUCH THAT THE BOTTOM OF THE TRAY IS AT 11'-0" AFF.

2) CABLE TRAY SYSTEM SHALL BE INSTALLED USING FULL LENGTH SECTIONS WITH MINIMAL CUTTING OF SECTIONS.

3. PROVIDE ALL CONNECTIONS TO ATTACH CABLE TRAY TO STRUCTURE ABOVE PER MANUFACTURER'S INSTRUCTIONS.

Order Plans @ www.IDILine.com

Florida Business License: AA26001620

NORR

CONSULTANT:

SEAL: HENRY D MONTAGUE, PE 78172

THIS DRAWING SHALL NOT BE USED FOR CONSTRUCTION PURPOSES UNTIL THE SEAL AND SIGNATURE OF THE RESPONSIBLE REGISTRANT APPEARS ON THE DRAWING, AND PROPER PERMIT FORMS AND RELATED FEES ARE TRANSMITTED BY THE OWNER, OWNER'S AGENT OR CONTRACTOR TO THE AUTHORITY HAVING JURISDICTION.

DATE	ISSUED FOR	REV
01/17/2018	PEMB COORDINATION	
01/17/2018	PERMIT SUBMITTAL	

Project Manager B.COLBURN	**Drawn** G. COLLINS
Project Leader B.COLBURN	**Checked** M. GOOD
Date 11/20/2017	**Dept Mgr Approval** M. GOOD

Client

Palmetto - Spring Hill Forest Rd., LLC.

P.O. BOX 1615
THOMASVILLE, GA 31792
Office: (229) 226-1177

Contact: Jeff Lazenby

Project

DOLLAR GENERAL

US 19 & Pine Forest Dr.
Spring Hill (Hernando County), FL

Drawing Title

OFFICE DETAILS AND CABLE TRAY LAYOUT PLAN

DO NOT SCALE DRAWING

Project No.	Drawing No.
JCDT17.0325.00	E5