



CONSULTANT:

SEAL: HENRY D. MONTAGUE, PE 78172

THIS DRAWING SHALL NOT BE USED FOR CONSTRUCTION PURPOSES UNTIL THE SEAL AND SIGNATURE OF THE RESPONSIBLE REGISTRANT APPEARS ON THE DRAWING, AND PROPER PERMIT FORMS AND RELATED FEES ARE TRANSMITTED BY THE OWNER, OWNER'S AGENT OR CONTRACTOR TO THE AUTHORITY HAVING JURISDICTION.

DATE	ISSUED FOR	REV
01/17/2018	PEMB COORDINATION	
01/17/2018	PERMIT SUBMITTAL	

Project Manager B. COLBURN	Drawn G. COLLINS
Project Leader B. COLBURN	Checked M. GOOD
Date 11/20/2017	Dept Mgr Approval M. GOOD

Client
Palmetto - Spring Hill
Forest Rd., LLC.
P.O. BOX 1615
THOMASVILLE, GA 31792
Office: (229) 226-1177
Contact: Jeff Zelenby

Project
DOLLAR GENERAL
US 19 & Pine Forest Dr.
Spring Hill (Hernando County), FL

Drawing Title
CPU TREMINAL DIAGRAM


DO NOT SCALE DRAWING

Project No. JCDT17.0325.00	Drawing No. EMS2
--------------------------------------	----------------------------




GENERAL CONTRACTOR TO ENSURE THAT THE BATTERY ENABLE IS SWITCHED TO THE 'ON' POSITION

CPU TERMINAL DIAGRAM
Scale: NTS

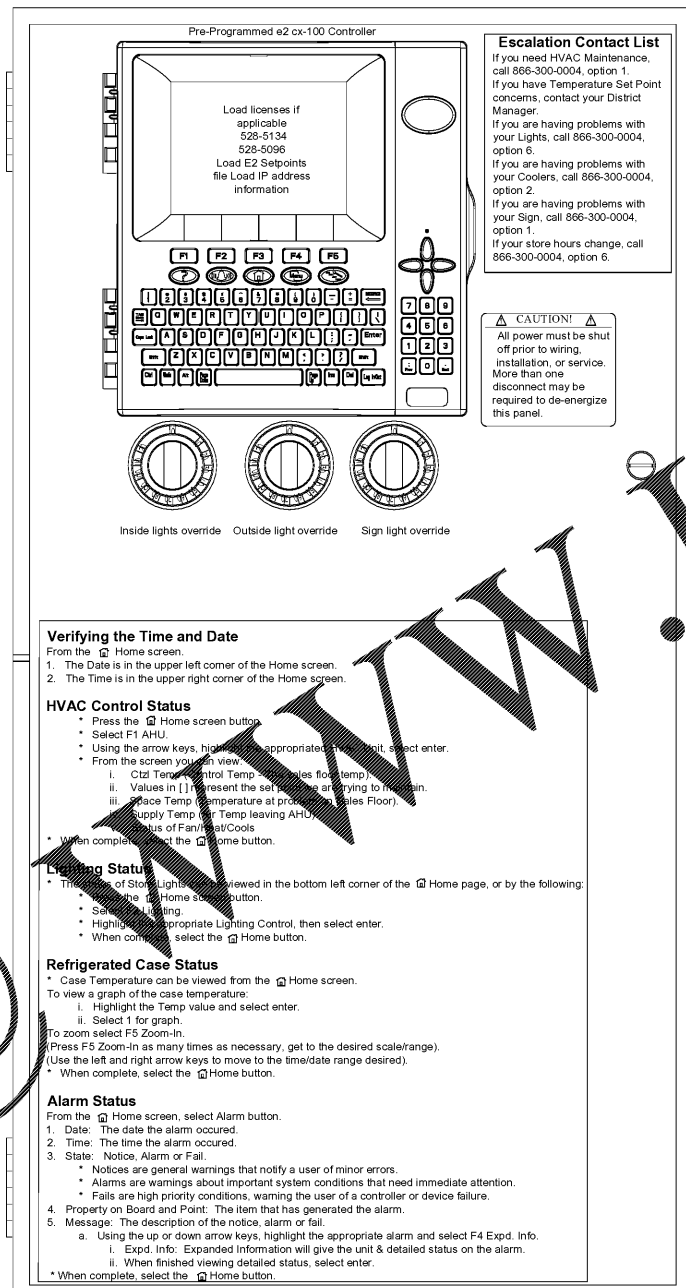

NOTE:
EMS SYSTEM SHOULD BE TESTED FOR HVAC OPERATION, INTERIOR LIGHTING, EXTERIOR LIGHTING AND SIGN LIGHTING PRIOR TO CONTRACTOR'S ELECTRICAL POSSESSION DATE. USE OUTSIDE LIGHT AND SIGN LIGHT OVERRIDE FOR EXTERIOR TESTING.

2 PROGRAMMER CONTROLLER
Scale: NTS

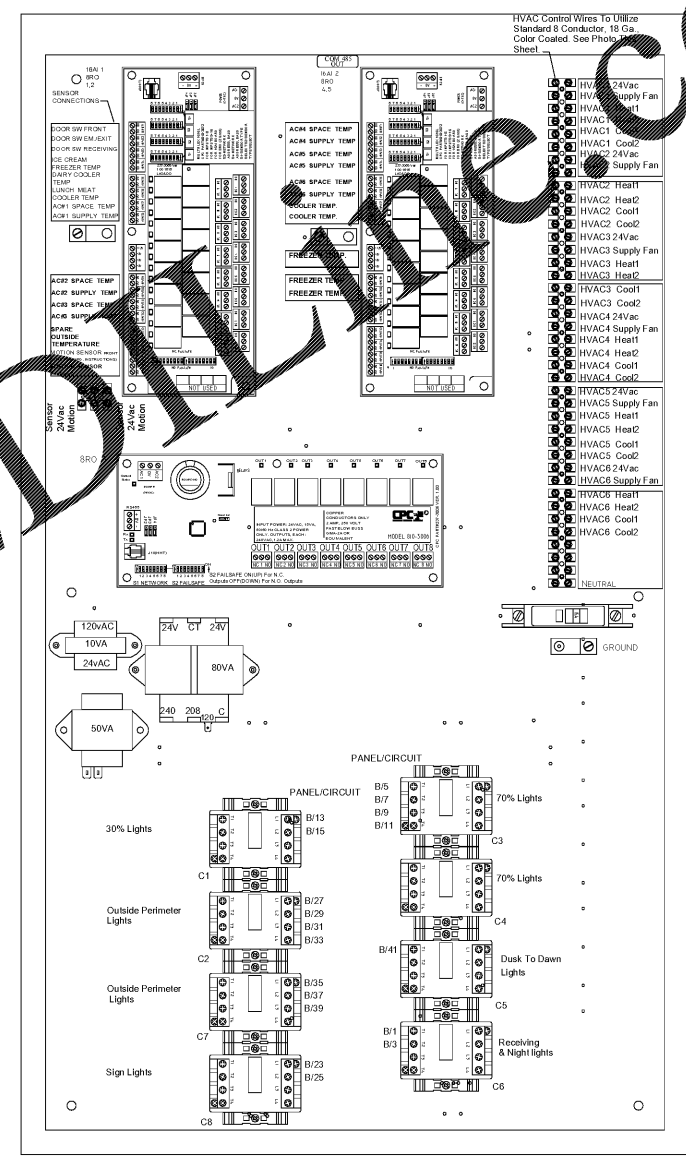

3 CONTROL WIRING DIAGRAM
Scale: NTS

Order Plans