
DOUBLE HEAD LED PARKING LOT FIXTURES, TWIN MOUNTING, TECHLIGHT LIGHTING: MLSBT-1C-8-T3F-1-1R-LBZ FULL CUTOFF, WITH TYPE 3 ROTATED OPTICS, DARK BRONZE FINISH, MOUNT ON 25 POLE, TECHLIGHT KSSP-25-4-TSZ-FOR DOUBLE MOUNTED LUMINARIES. NOTE - POLE TO BE EITHER FACTORY CUT AT 24 WITH PRE-DRILLED HOLES OR FILED CUT WITH FOLES DRILLED AS REQUIRED TO MEET CALCULATED PHOTOMETRIC VALUES AT 26 USING A 2-0* POLE BASE


	LIGHT FIXTURE DESCRIPTION			
	TYPE	DESCRIPTION	COUNT	
	HP	SINGLE HEAD LED PARKING LOT FIXTURES, TECHLIGHT LIGHTING: #LSBT-1C-8-T3-F-1-RU-BZ FULL CUTOFF, WITH TYPE 3 OPTICS, DARK BRONZE FINISH, MOUNT ON 25' POLE. TECHLIGHT #SSP-25-4-7BZ FOR SINGLE MOUNTED LUMINARIE. NOTE - POLE TO BE EITHER FACTORY CUT AT 24' WITH PRE-DRILLED HOLES OR FILED CUT WITH HOLES DRILLED AS REQUIRED TO MEET CALCULATED PHOTOMETRIC VALUES AT 26' USING A 2'-0" POLE BASE	1	
	HP2	DOUBLE HEAD LED PARKING LOT FIXTURE. TWIN MOUNTING, TECHLIGHT LIGHTING: #L.SBT-1C-8-T3-F-1-RU-BZ FULL CUTOFF, WITH TYPE 3 ROTATED OPTICS, DARK BRONZE FINISH. MOUNT ON 25' POLE. TECHLIGHT #SSP-25-4-TSZ FOR DOUBLE MOUNTED LUMINARIES. NOTE - POLE TO BE EITHER FACTORY CUT AT 24' WITH PRE-DRILLED HOLES OR FILED CUT WITH HOLES DRILLED AS REQUIRED TO MEET CALCULATED PHOTOMETRIC VALUES AT 26' USING A 2-0" POLE BASE	2	


SITE LIGHTING - GENERAL NOTES

1. FINAL SIGN CONNECTION AND UNDERGROUND CONDUIT IS LANDLORD RESPONSIBILITY. PROVIDE CONDUIT FROM THE ELECTRICAL PANEL TO LOCATION OF THE PYLON SIGN BASE BURY CONDUIT UNDER PARKING AREA. THE CONDUIT IS TO BE! "AND HAVE ONE SETTO 10/2 WRIEW WITH GROUND AND A 20-AMP TWO POLE BREAKER AT THE PANEL. A TEMPORARY 3" TALL STAKE SHALL BE PROVIDED TO DESIGNATE THE PYLON SIGN LOCATION UNTIL THE SIGN IS PERMANENTLY INSTALLED. REMOVE POST AFTER SIGN IS INSTALLED.

2. SEE SHEET E2 FOR BUILDING MOUNTED LIGHTS INFORMATION.

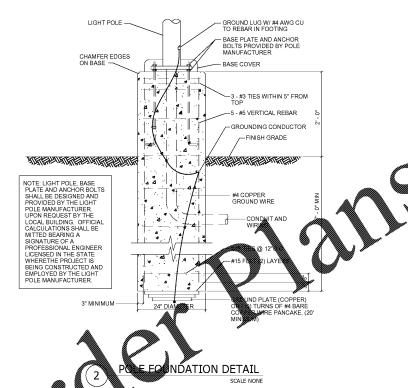

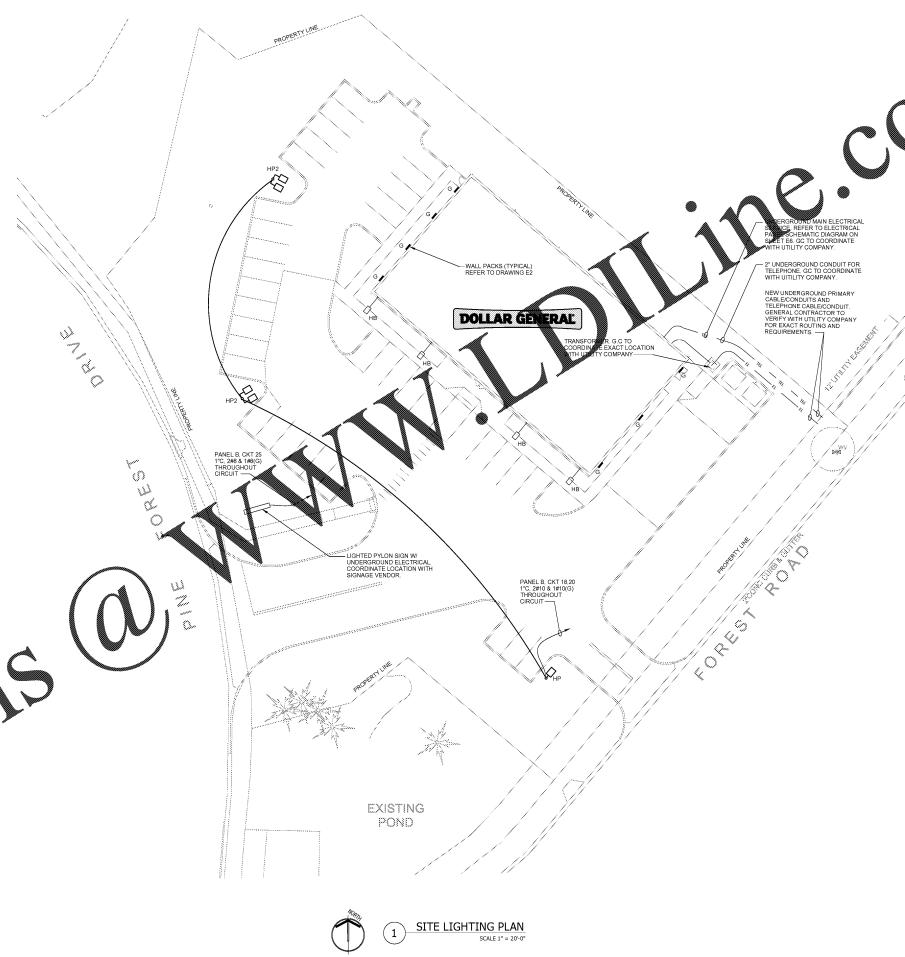



Florida Business License: AA26001620

SEAL: HENRY D MONTAGUE, PE 78172

THIS DRAWING SHALL NOT BE USED FOR CONSTRUCTION PURPOSES UNTIL. THE SEAL AND SIGNATURE OF THE RESPONSIBLE RECISTANTAL PRESS ON THE DRAWING, AND PROPER FROM FORMS AND BELATED FEES ARE TRANSMITTED BY THE OWNER, OWNERS AGENT OR CONTRACTOR TO THE AUTHORITY HAVING JURISDICTION.

DATE	ISSUED FOR	REV
01/17/2018	PEMB COORDINATION	
01/17/2018	PERMIT SUBMITTAL	
		_

- 1	Project Manager	Drawn
	B.COLBURN	G. COLLINS
	Project Leader B.COLBURN	Checked M. GOOD
	Date 11/20/2017	Dept Mgr Approval M. GOOD

Client

Project

Palmetto - Spring Hill Forest Rd., LLC.

P.O. BOX 1615 THOMASVILLE, GA 31792 Office: (229) 226-1177

DOLLAR GENERAL

US 19 & Pine Forest Dr. Spring Hill (Hernando County), FL

Drawing Title

SITE LIGHTING PLAN

DO NOT SCALE DRAWING

 Project No.
 Drawing No.

 JCDT17.0325.00
 ES1