
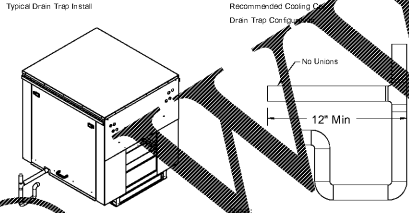


- FAN #5 A2-D 250-200-MPU - HEATER (MAU 1)
 1. DIRECT GAS FIRED HEATED MAKE UP AIR UNIT WITH 20" DIRECT DRIVE FAN
 2. INTAKE HOOD WITH EZ FILTERS
 3. DOWN DISCHARGE - AIR FLOW RIGHT > LEFT
 4. COOLING INTERLOCK RELAY, 24VAC COIL, 120V CONTACTS. LOCKS OUT BURNER CIRCUIT WHEN AC IS ENERGIZED.
 5. MOTORIZED BACK DRAFT DAMPER 22 7/8" X 24" FOR SIZE 2 STANDARD & MODULAR HEATER UNITS W/EXTENDED SHAFT.
 STANDARD GALVANIZED CONSTRUCTION, 3/4" REAR FLANGE, LF120S ACTUATOR INCLUDED
 6. LOW FIRE START - ALLOWS THE BURNER CIRCUIT TO ENERGIZE WHEN THE MODULATION CONTROL IS IN A LOW FIRE POSITION.
 7. GAS PRESSURE GAUGE, 0-35", 2.5" DIAMETER, 1/4" THREAD SIZE
 8. GAS PRESSURE GAUGE, -5 TO +15 INCHES WC, 2.5" DIAMETER, 1/4" THREAD SIZE
 9. DX COOLING INTAKE AIR THERMOSTAT AND RELAYS MOUNTED IN UNIT - SET POINT FOR THERMOSTAT SHOULD BE 85°F.
 10. 7.5 TON DUAL CIRCUIT (2.5/5) MODULAR PACKAGED COOLING OPTION FOR SIZE 2 MODULAR PACKAGED UNIT. INCLUDES CONDENSER, DX COIL, FILTER/DRYER KIT, THERMAL EXPANSION VALVE, R410A REFRIGERANT, AND REFRIGERANT PIPING. (2,700 TO 4,500 CFM) NOT BUILT WITH OPPOSITE SIDE CONTROLS OR OPPOSITE AIRFLOW DIRECTION. CONDENSERS REQUIRE SEPARATE 208V, 3 PHASE POWER SUPPLY. COIL = 3E21101C
 11. DOWNTURN PLENUM FOR SIZE 2 COOLING COIL MODULE - REQUIRED FOR DOWN DISCHARGE COOLING COIL APPLICATIONS
 12. SEPARATE 120VAC WIRING PACKAGE FOR MAKE-UP AIR UNITS. OPTION MUST BE SELECTED WHEN MOUNTING VFD IN PREWIRE PANEL OR WITH DCV PACKAGE. PROVIDES SEPARATE 120VAC INPUT TO SUPPLY FAN. THIS 120V SIGNAL MUST BE RUN BY ELECTRICIAN FROM DCV TO MUA SWITCH.




NOTE: SUPPLY DUCT MUST BE INSTALLED TO MEET SMACNA STANDARDS. A MINIMUM STRAIGHT DUCT LENGTH EQUAL TO THREE TIMES THE SUPPLY DUCT EQUIVALENT DIAMETER MUST BE MAINTAINED DOWNSTREAM OF UNIT DISCHARGE UNLESS OTHERWISE SPECIFIED. DO NOT RELY ON UNIT TO SUPPORT DUCT IN ANY WAY.

SUPPLY SIDE HEATER INFORMATION:

WINTER TEMPERATURE = 18°F. TEMP. RISE = 57°F.
 BTUs CALCULATED OFF STANDARD AIR DENSITY
 OUTPUT BTUs AT ALTITUDE OF 0.0 ft = 242177
 INPUT BTUs AT ALTITUDE OF 0.0 ft = 263236

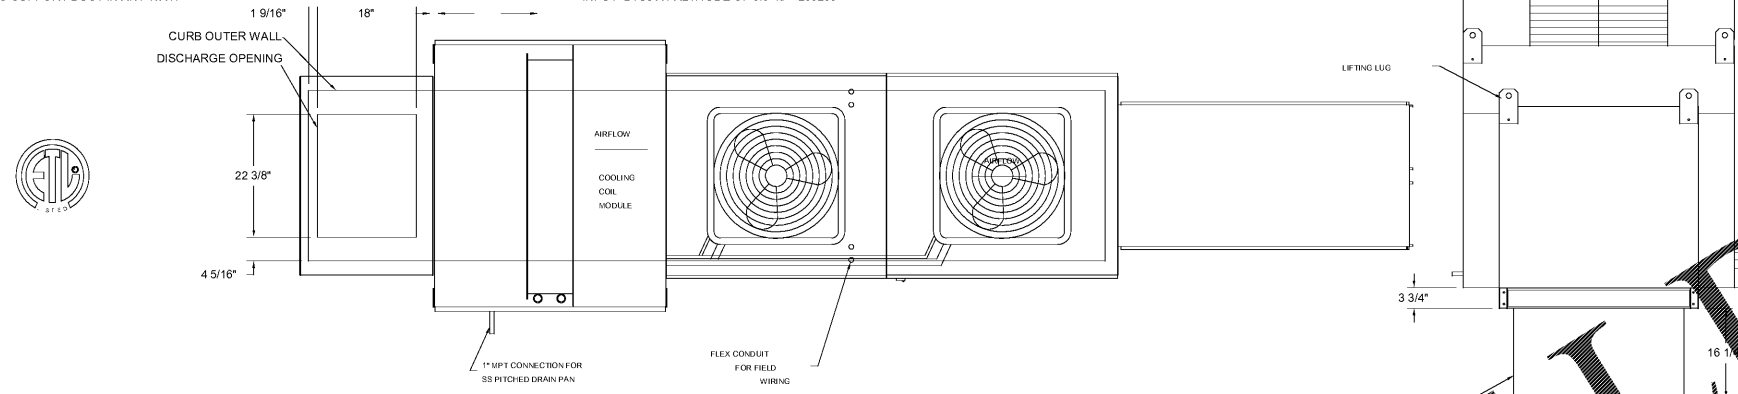

Direct Fired (DF) Profile Plate Assembly
Direct Fired Profile Plate Specifications:
 Description:
 Direct fired burners shall have patented (US Patent No. 11566962R2) self-activating profile plates designed to ensure oroner air velocity and pressure drop across the burner. Profile plates shall allow burners to achieve clean combustion for limited burner-out failure to a maximum of 5ppm of carbon monoxide (CO), and 0.5ppm of nitrogen dioxide (NO2).
 Application:
 Self-activating burner profile plates are engineered to automatically react to the momentum of a fresh air stream without the need for any motors or actuators. In mechanically adjust them. With this feature, all DF units are designed for demand control ventilation (DCV) requirements.
 Certifications:
 All profile plate assemblies shall be included in the DF (infr. FT) listing and comply with combined safety standards ANSI Z63.4 and CSA 3.7 (non-recirculating DF heaters) and ANSI Z83.16 (recirculating DF heaters).
 General Construction:
 Profile plates shall be formed from G90 galvanized steel.
 Profile plates shall use in size per unit.
 Profile plates shall be mounted along the same plane as the discharge of the burner.
 Design shall incorporate non-ferrous formed, permanently mounted spring hinges.
 Spring hinges shall be made from plated steel.

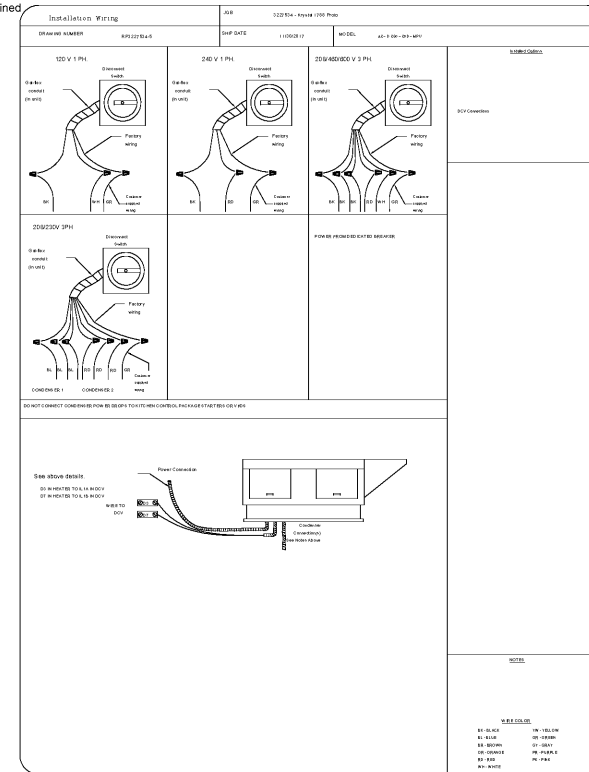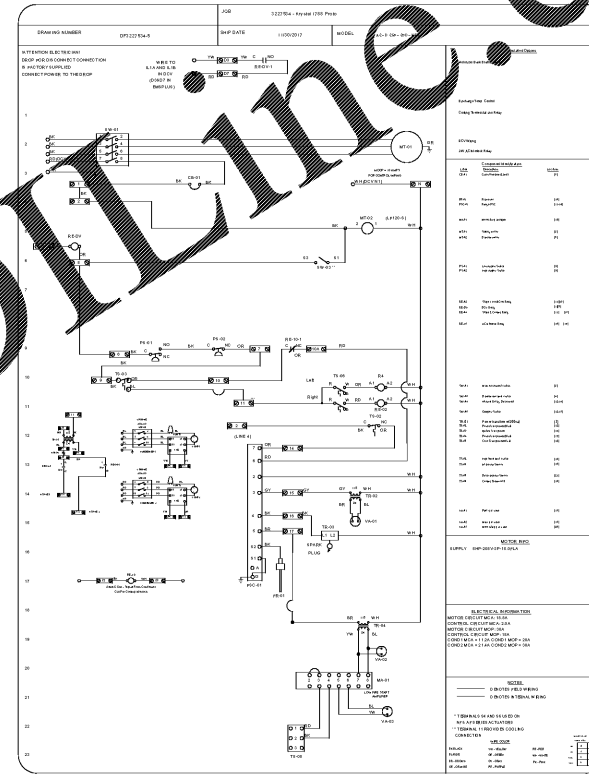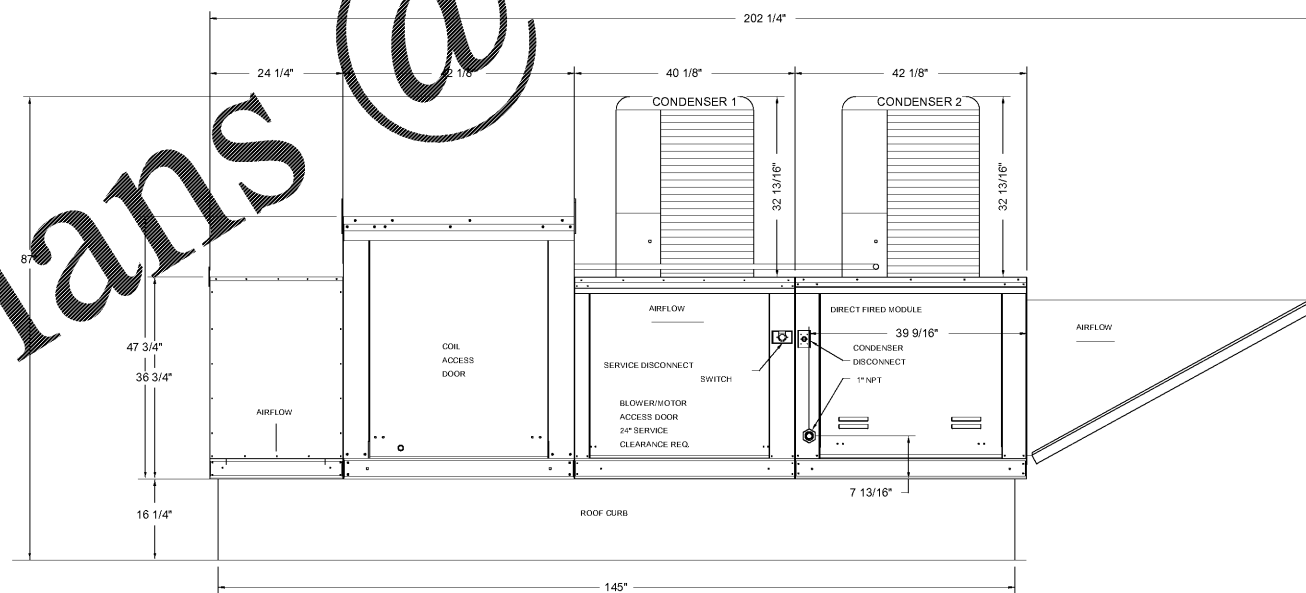

RAD
 Ragona Architecture & Design, PLLC
 1447 Highway 138, Conyers, GA 30012
 706-236-7728
 rad@rad-arch.com

WAVE ENGINEERING
 122 W. BLAND ST. SUITE C
 CONYERS, GA 30012
 706-236-7728
 info@wave-engineering.com
 WAVE PROJECT # 18028

#ATL034
 CONYERS, GA



ISSUED FOR CONSTRUCTION
 1447 Highway 138
 Conyers, Georgia 30012
 Rockdale County, Georgia

Revisions		
#	Date	Description

Project Number: 18028
 Issued for: CONSTRUCTION
 Issue Date: 03/22/18

DRAWING TITLE
MAU SELECTION

SHEET NUMBER
M103

Order Plans @