



Order Plans @ WWW.LDILINE.COM

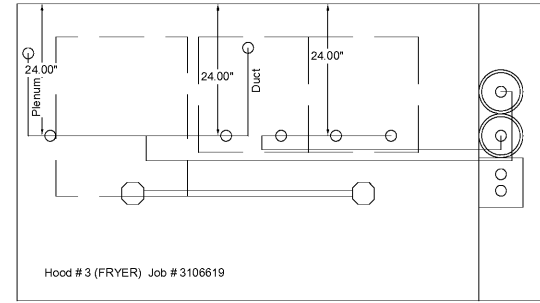

Job # 3106619
 Job Name: Krystal Cordova TN
 Drawn By:
 System Size: ANSUL-3.0/3.0 Total FP required: 15
 Hood # 3 7'0.00" Long x 54" Wide x 24" High
 Riser # 1 Size: 12" Dia
 Hood # 3 Metal Blow-Off Caps included.

- NOTES
- FIELD PIPE DROPS AS SHOWN
 - SLEEVING, ELBOWS, TEES, AND NOZZLES SUPPLIED BY GAS
 - RELOCATE NOZZLES IF FLOW PATTERN IS BLOCKED BY SHELVING, SALAMANDERS, ETC.
 - MAXIMUM 9 ELBOWS IN SUPPLY LINE
 - MINIMUM 72 INCHES OF AGENT LINE FROM TANK TO FIRST NOZZLE
 - IF APPLICABLE, PRE-PIPED CHARBROILER DROPS ARE SHIPPED LOOSE
 - FACTORY PIPING EXTENDS A MAXIMUM OF 10' ABOVE THE TOP OF THE
 - APPLIANCE DIMENSIONS LISTED REPRESENT THE COOKING SURFACE SIZE, NOT THE OVERALL APPLIANCE SIZE
 - THIS FIRE SYSTEM COMPLIES WITH 2010 REQUIREMENTS

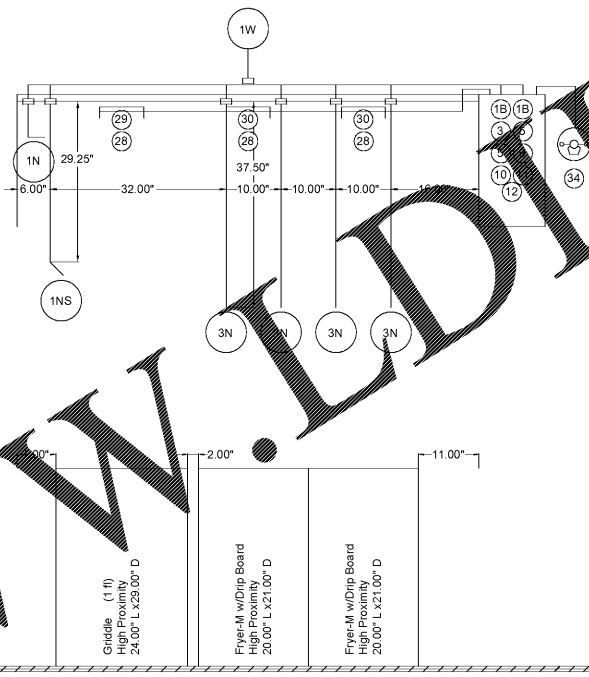

- LEGEND - FIRE CABINET ANSUL SYSTEM
- 1.5 GALLON TANK
 - 3 GALLON TANK
 - 2 OEM AUTOMAN RELEASE
 - 3 OEM REGULATED RELEASE
 - 4 OEM REGULATED ACTUATOR
 - 5 ANSULEX LIQUID AGENT (3 GAL.)
 - 6 ANSULEX LIQUID AGENT (1.5 GAL.)
 - 7 CARTRIDGE (101-20)
 - 8 CARTRIDGE (101-10)
 - 9 CARTRIDGE (101-30)
 - 9A CARTRIDGE (LT-A-101-30)
 - 9B DOUBLE TANK CARTRIDGE
 - 10 TEST LINK
 - 11 DOUBLE MICROSWITCH
 - 12 HOSE ASSEMBLY
 - 1100 DUCT NOZZLE (430913)
 - 2W DUCT NOZZLE (419337)
 - 1W NOZZLE ASSEMBLY (419336)
 - NOZZLE ASSEMBLY (419333)
 - 1F NOZZLE ASSEMBLY (419335)
 - 1/2N NOZZLE ASSEMBLY (419334)
 - 3N NOZZLE ASSEMBLY (419338)
 - 245 NOZZLE ASSEMBLY (419340)
 - 230 NOZZLE ASSEMBLY (419339)
 - 2120 NOZZLE ASSEMBLY (419343)
 - 290 NOZZLE ASSEMBLY (419342)
 - 260 NOZZLE ASSEMBLY (419341)
 - 28 DETECTOR BRACKET
 - 29 LOW TEMP FUSIBLE LINK
 - 30 HIGH TEMP FUSIBLE LINK
 - MGV MECHANICAL GAS VALVE
 - EGV ELECTRICAL GAS VALVE
 - 34 REMOTE MANUAL PULL STATION
 - S SWIVEL ADAPTOR

INCLUDES: FIELD INSTALLATION AND HOOKUP DURING NORMAL BUSINESS HOURS BY CERTIFIED INSTALLERS ONLY IN THE LOCATION NOTED ABOVE. TWO SITE VISITS ONLY (ONE VISIT TO SET PULL STATION & SYSTEM HOOKUP AND ONE VISIT FOR ONE TEST; ADDITIONAL VISITS WILL RESULT IN ADDITIONAL CHARGES). ONE MECHANICAL GAS VALVE PER SYSTEM AT A MAXIMUM SIZE OF 2" PERMIT, AND SYSTEM TEST
 EXCLUDES: UNION LABOR & PREVAILING WAGE (LABOR & WAGES WILL BE ADDED IF APPLICABLE), GAS VALVE INSTALLATION, ELECTRICAL HOOKUP AND CONNECTIONS, HANGING OF FIRE CABINET, SHUNT TRIP, HANDHELD EXTINGUISHER(S), ON-SITE RE-PIPING DUE TO EQUIPMENT LAYOUT CHANGES.

RAD
 Ragona Architecture & Design, PLLC
 1447 Highway 138, Conyers, GA 30012
 706-226-1728
 INFO@WAVEENGINEERING.COM
 WAVE PROJECT # 18028

#ATL034
 CONYERS, GA

Krystal



3/22/18
ISSUED FOR CONSTRUCTION
 1447 Highway 138
 Conyers, Georgia 30012
 Rockdale County, Georgia

Revisions		
#	Date	Description

Project Number: 18028
 Issued for: CONSTRUCTION
 Issue Date: 03/22/18

DRAWING TITLE
HOOD DRAWINGS

SHEET NUMBER
M304