



LIGHTING CONTROL

LIGHTING CONTROL SYSTEM SCHEMATIC:



LIGHTING CONTROL SYSTEM SCHEMATIC PLAN NOTES:


- 1 MASTER LIGHTING CONTROL PANEL. SEE PLANS FOR EXACT LOCATION. REFER TO MASTER LIGHTING CONTROL PANEL SCHEDULE FOR MORE INFORMATION. PROVIDE 120V POWER AS REQUIRED. DO NOT USE LIGHTING BRANCH CIRCUIT FOR CONTROL PANEL POWER.

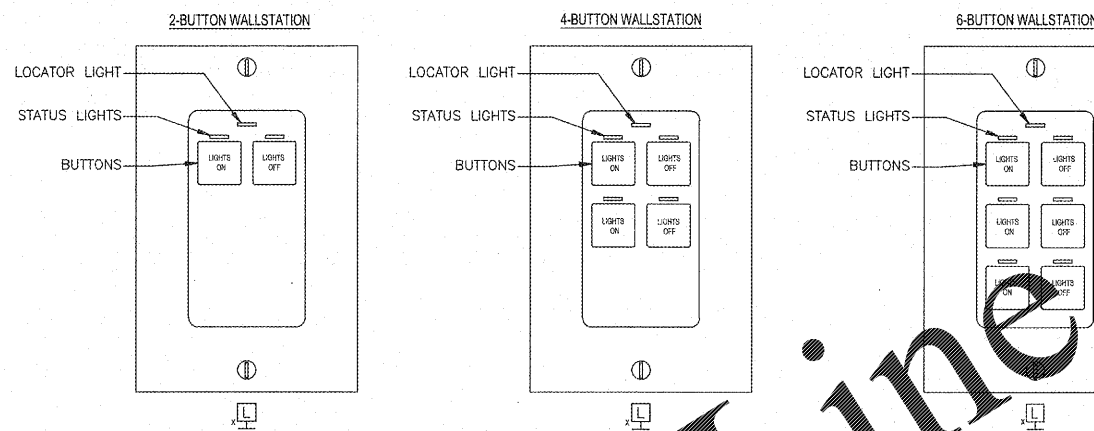

VERRIDE AND LOCAL SWITCH FACEPLATE DETAIL NOTES:

- 1. STANDARD OVERRIDE SWITCH FACEPLATES/BUTTONS SHALL BE ACUITY BRIGHTON DIGITAL SWITCHES.
- 2. CATALOG NUMBERS AS FOLLOWS:  
 2-BUTTON - BR2 BWH PWH  
 4-BUTTON - BR4 BWH PWH  
 6-BUTTON - BR6 BWH PWH
- 3. SUBSCRIPT INDICATES SWITCH LEG.
- 4. CONNECT DIGITAL SWITCHES TO BLUE BOX VIA CAT5 PATCH CABLE WITH RJ45 CONNECTORS.

DIGITAL SWITCH DETAIL

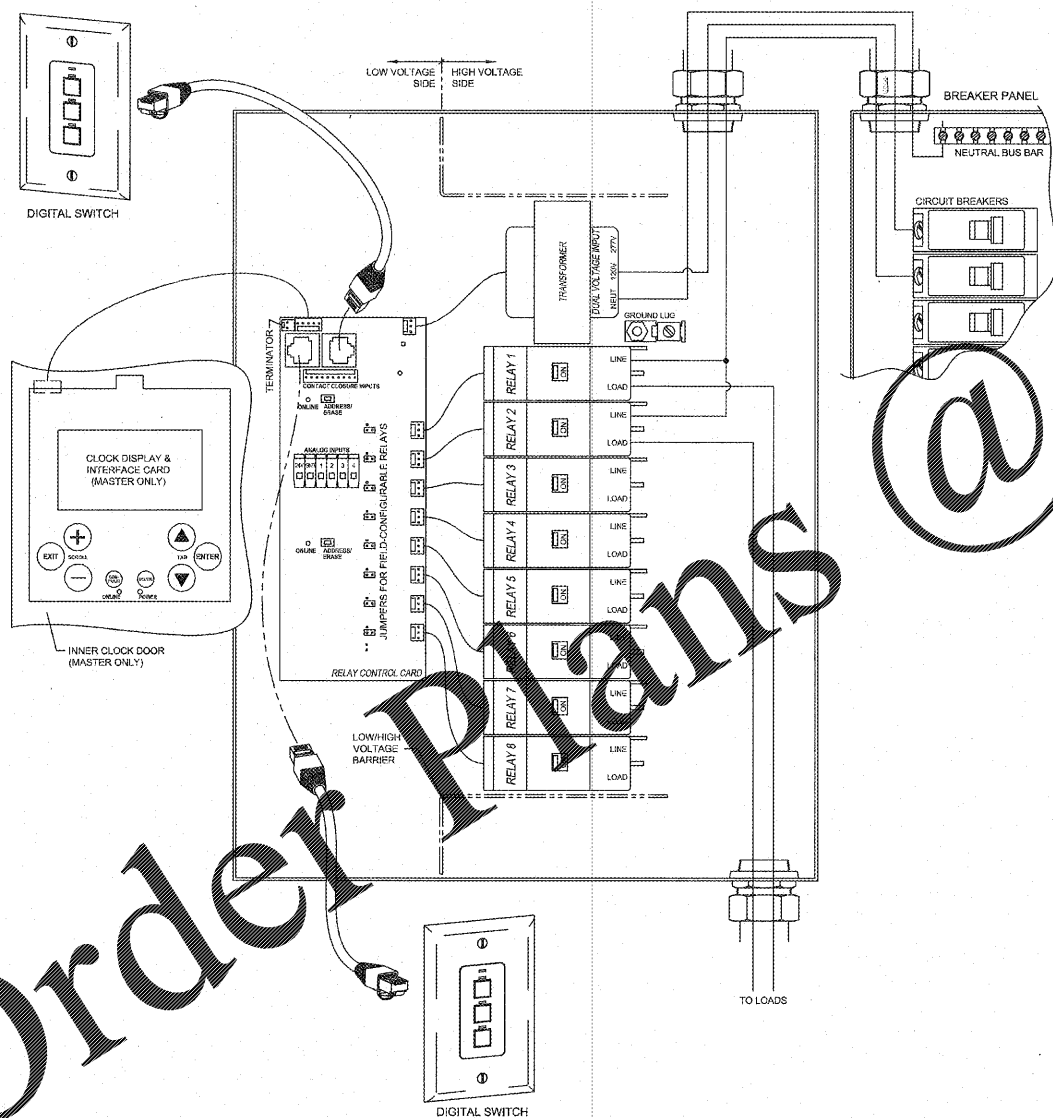

LIGHTING CONTROL PANEL SCHEDULE - LCP

INSTALLATION	EXTERIOR PHOTO CELL	COMM. MEDIA	DPCS / IDCS INTERFACE	BMS INTERFACE	NETWORK INTERFACE	MODEM	AVAILABLE FAULT CURRENT SEE FAULT CURRENT NOTE ON SHEET E-4.0	REMARKS			
	YES	COPPER	-	-	-	-	ACUITY BLUE BOX SFR418 LT				
PANEL #	CKT #	RELAY	DESCRIPTION	LOCAL SWITCH	OVERRIDE SWITCH	ZONE NUMBER	MISCELLANEOUS				
A	2	1	Lighting - Dining - Track and Pendant	-	-	a	-				
A	2 / 6	2	Lighting - Dining - 2x2 Fixtures	-	-	b	-				
A	2	3	Lighting - POS Sales	-	-	c	-				
D	40	4	Digital Menu Boards	-	-	c	-				
EXISTING	EXISTING	5	Show Window Receptacles	-	-	c	-				
A	38	6	Restroom Exhaust Fan	-	-	c	-				
A	4	7	Lighting - Back of House	-	-	d	-				
EXISTING	EXISTING	8	Lighting - Exterior	-	-	e	-				
EXISTING	EXISTING	9	Lighting - Exterior	-	-	f	-				
EXISTING	EXISTING	10	Lighting - Exterior	-	-	g	-				
A	20 / 23	11	Lighting - Building Signs	-	-	h	-				
EXISTING	EXISTING	12	Lighting - Parking Lot and Directional	-	-	i	-				
B	31	13	Drive Through Menu Canopy	-	-	j	-				
-	-	14	Spare	-	-	-	-				
-	-	15	Spare	-	-	-	-				
-	-	16	Spare	-	-	-	-				
ZONE NUMBER	TIME ON	TIME OFF	PHOTO ON	PHOTO OFF	DESCRIPTION	ZONE NUMBER	TIME ON	TIME OFF	PHOTO ON	PHOTO OFF	DESCRIPTION
1	-	-	-	-	-	5	-	-	-	-	-
2	-	-	-	-	-	6	-	-	-	-	-
3	-	-	-	-	-	7	-	-	-	-	-

BLUE BOX LIGHTING CONTROL PANEL SHALL BE PROVIDED BY NATIONAL ACCT. WITH VILLA LIGHTING, UON CONTACT DEANNA MCCLANAHAN AT 314-633-0508 OR DEANNA.MCCLANAHAN@VILLALIGHTING.COM

THESE PLANS ARE CONFIDENTIAL PROPERTY OF DUNKIN' BRANDS, INC. UNLESS OTHERWISE INDICATED. NO OTHER RESTRICTED ACCESS.

**dunkin'** brands

PROJECT NO.: 17229

**NRD** national restaurant architects & engineers  
 3005 Carrington Mill Blvd., Morrisville, NC 27560  
 ph: 919 544 7251 fax: 919 544 9399  
 A Division of LMHT Associates

REGISTERED PROFESSIONAL ENGINEER  
 RESIDUAL REGISTERED ARCHITECT  
 STATE OF NORTH CAROLINA  
 No. 022828  
 PROFESSIONAL SEAL

NO	DESCRIPTION	DATE	SCALE	DRAWN	CKD	APPD
3-18-18						

DD FRESH BREW 1.0  
 DUNKIN DESIGN GUIDELINES

ELECTRICAL  
 AUTOMATIC CONTROL PANEL

PC NUMBER

E-5.0

NOTE: DRAWINGS ARE NOT TO SCALE IF SHEET IS PLOTTED ON 11" x 17"