


PLOTTED: 5/11/2018 10:49 AM

GENERAL LIGHTING NOTES:

1. ALL HEIGHT DIMENSIONS (e.g. +8'-6") ARE FROM THE FINISHED FLOOR TO THE CENTERLINE OF THE DEVICE.
2. REFER TO ARCHITECTURAL REFLECTED CEILING PLAN FOR COORDINATION OF LUMINAIRES WITH CEILING GRID.
3. REFER TO SHEET E-001 FOR THE ELECTRICAL MATERIAL LIST AND GENERAL INSTALLATION NOTES.
4. REFER TO DETAIL D1/E-102 FOR LIGHTING CONTROL AND WIRING DIAGRAM.
5. REFER TO SHEET E-401 FOR SCHEDULE OF CIRCUITS FOR PANEL 'L'.
6. REFER TO DRAWINGS E-102 FOR LIGHTING LUMINAIRE SCHEDULE.
7. IN AREAS WHERE NO CEILING IS INSTALLED, CONDUIT SHALL BE RUN JUST BELOW ROOF DECK, AT BOTTOM OF UPPER CHORD OF ROOF JOISTS.
8. EXIT LIGHTING FIXTURES SHALL BE CONNECTED TO THE NIGHT LIGHTING BRANCH CIRCUIT 'L1-1'. FIXTURES SHALL NOT BE SWITCHED.
9. EMERGENCY FIXTURES (EM) HAVE EMERGENCY BATTERY BALLAST FACTORY INSTALLED. VERIFY FIXTURE COUNTS AND PLACEMENT OF EMERGENCY FIXTURES PRIOR TO INSTALLATION. NOTIFY ALDI REP OF ANY DISCREPANCIES.

LIGHTING PLAN KEYNOTES:

- (L1) ROUTE CONDUIT FROM PANEL 'L1' TO EXTERIOR BUILDING SITE LIGHTING AND SIGN POWER BELOW SLAB. MINIMUM 1 1/2" CONDUIT SHALL BE USED AND CONDUIT SHALL HAVE PROPER LISTINGS FOR LOCATION ACCORDING TO ALL LOCAL CODES AND CURRENT EDITION OF N.E.C. REFER TO KEYNOTES L2 AND L3.
- (L2) MINIMUM 1-1/2" SCHEDULE 40 PVC CONDUIT. INSTALL MINIMUM OF 24" BELOW GRADE TO MONUMENT/PYLON SIGN. REFER TO DETAIL FOR CONDUIT TERMINATION AT SIGN. FIELD VERIFY ENTRANCE LOCATION INTO BUILDING TO KEEP RUN AS SHORT AS POSSIBLE.
- (L3) MINIMUM 1-1/2" SCHEDULE 40 PVC CONDUIT. INSTALL MINIMUM OF 24" BELOW GRADE TO NEW PARKING LOT LUMINAIRE. REFER TO SEE ELECTRICAL PLAN FOR LOCATION. FIELD VERIFY ENTRANCE LOCATION INTO BUILDING TO KEEP RUN AS SHORT AS POSSIBLE.
- (L4) VERIFY LOCATION OF CONNECTION TO DOOR LIGHT WITH REFRIGERATION CONTRACTOR.
- (L5) VERIFY LOCATION OF JUNCTION BOX WITH REFRIGERATION CONTRACTOR. CONDUIT AND WIRING CONNECTIONS AND INSTALLATION OF REFRIGERATION INSIDE COOLER AND FREEZER BY REFRIGERATION CONTRACTOR. REFER TO KEYNOTE 'L6'
- (L6) FIXTURES SHOWN IN WALK-IN COOLER AND FREEZER SHALL BE FURNISHED BY ELECTRICAL CONTRACTOR AND TURNED OVER TO REFRIGERATION CONTRACTOR FOR INSTALLATION. OCCUPANCY SENSORS FURNISHED AND INSTALLED BY REFRIGERATION CONTRACTOR.
- (L7) REFER TO INSTALLATION AND WIRING GUIDE PROVIDED BY NORDEON LIGHTING FOR SALES AREA TRUNKING. EACH TRUNK FOR THE MAIN STORE AISLES IS SERVED BY THREE (3) CIRCUITS ORIGINATING FROM THE SAME BRANCH CIRCUIT.
  - CONTROL CIRCUIT #1 IS FROM "STOCKING" CONTACTORS OPERATING FIXTURES THAT HAVE LETTER DESIGNATION 'a'
  - CONTROL CIRCUIT #2 IS FROM "SALES" CONTACTORS OPERATING FIXTURES THAT HAVE LETTER DESIGNATION 'b'
  - CIRCUIT #3 IS UN-SWITCHED AND REFERENCE VOLTAGE FOR EMERGENCY FIXTURES AND CONNECTED SUCH THAT IN THE EVENT OF A LOSS OF NORMAL POWER THE EMERGENCY FIXTURE ILLUMINATES. NIGHT LIGHTING FIXTURES (NL) FACTORY WIRED FOR 24/7 ILLUMINATION.
- (L8) INSTALL LUMINAIRES, CONDUIT AND WIRING TO CLEAR OVERHEAD DOOR IN THE OPEN POSITION.
- (L9) RECEPTACLE FOR DOCK LIGHT SHALL BE SWITCHED WITH BACKROOM LIGHTS. PROVIDE WOOD BLOCKING BETWEEN STUDS TO SECURELY MOUNT FIXTURE.
- (L10) EXTEND CIRCUIT TO EXHAUST FAN EF-1. REFER TO E-301 FOR CONTINUATION.
- (L11) CPC SYSTEM REFER TO DETAIL D1/E-102 FOR LIGHTING CONTROL DIAGRAM.
- (L12) PROVIDE EXTERIOR EMERGENCY FIXTURE NEAR DOOR FOR EXIT DISCHARGE LIGHTING. REFER TO ARCHITECTURAL ELEVATIONS FOR LOCATIONS.
- (L13) PROVIDE DUPLEX RECEPTACLES FOR LED BACKLIT GRAPHIC FRAMES. COORDINATE RECEPTACLE LOCATIONS WITH SIGN VENDOR, G.C. AND ALDI REP. PRIOR TO ROUGH-IN. RECEPTACLES SHALL BE CONNECTED TO CIRCUITS AS INDICATED. REFER TO LIGHTING CONTROL DIAGRAM D1/E-102.
- (L14) INSTALL 2" LOW-PROFILE LINEAR COVE FIXTURES FACING UP TO LIGHT BACK WALL GRAPHICS ON TOP OF MDU. SECURE FIXTURES TO GC INSTALLED LIGHT GAUGE HAT CHANNEL WITH FURNISHED MOUNTING CLIPS. REFER TO ARCHITECTURAL SECTION DRAWINGS FOR FIXTURE PLACEMENT. VERIFY QUANTITY OF FIXTURES REQUIRED FOR CONTINUOUS ROW WALL TO WALL.
- (L15) PROVIDE CONNECTION OF PRE-FABRICATED HANGING LIGHTED SIGNS TO SALES FLOOR LIGHTING BRANCH CIRCUIT AS INDICATED. COORDINATE LOCATION OF JUNCTION BOX WITH SIGN INSTALLER PRIOR TO ROUGH-IN.
- (L16) PROVIDE RECEPTACLES AS NOTED FOR GONDOLA ACCENT LIGHTING. REFER TO ARCHITECTURAL INTERIOR ELEVATIONS FOR RECEPTACLE LOCATIONS AND COORDINATE WITH G.C. PRIOR TO ROUGH-IN. REFER TO LIGHTING CONTROL DIAGRAM D1/E-102.
- (L17) MOUNT PRODUCE LIGHTING ASSEMBLY AT 12'-0" A.F.F. TO BUILDING STRUCTURE PER MANUFACTURER'S INSTRUCTIONS USING SAMMYS SCREW AND AIRCRAFT CABLE SUPPORT KIT PROVIDED WITH FIXTURES. LIGHTING ASSEMBLY SHALL BE MOUNTED TO AVOID ALL OBSTRUCTIONS. REFER TO REFLECTED CEILING PLAN FOR LOCATIONS.
- (L18) PROVIDE HUBBELL DUPLEX RECEPTACLE POWER POLE #HBLPxxAAL FOR WINE AREA GONDOLA LIGHTING. COORDINATE LOCATION WITH OPERATIONS PLAN AND ALDI REP. PRIOR TO ROUGH-IN.

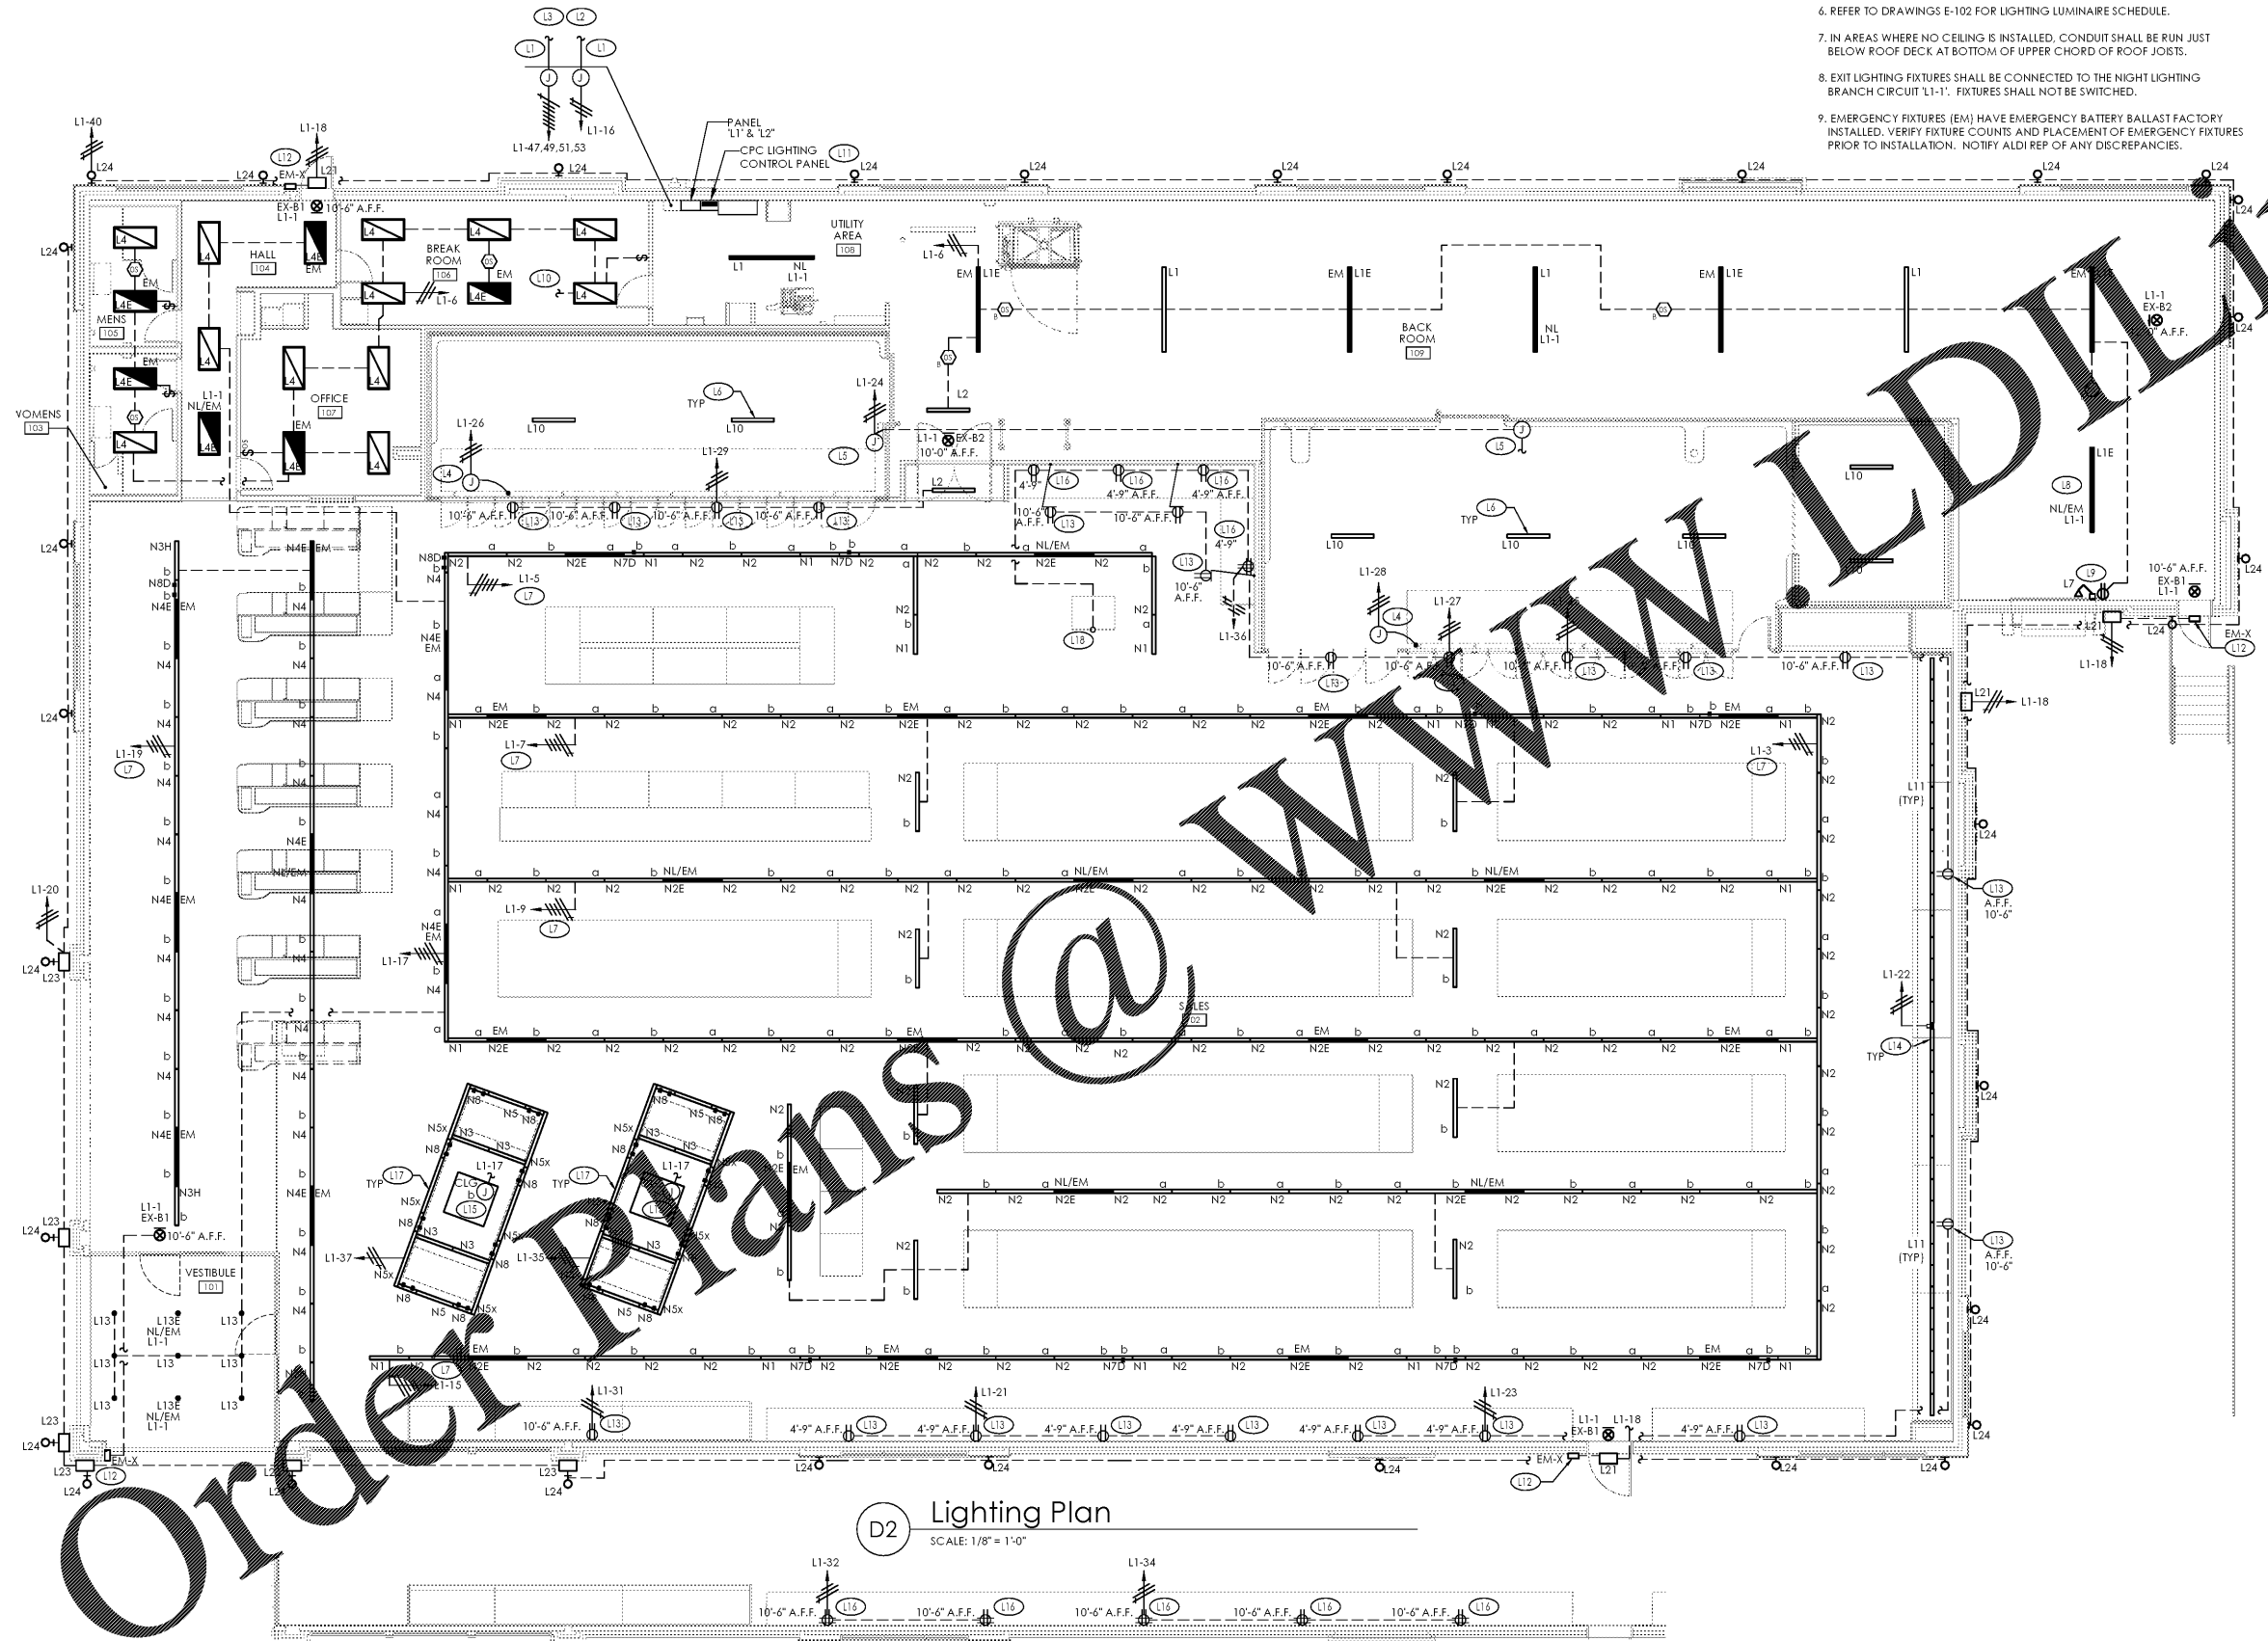

D2 Lighting Plan SCALE: 1/8" = 1'-0"

D1 Partial Plan (Gondola Lighting Receptacles) SCALE: 1/8" = 1'-0"



Issued:	Date:
A Permit Set	12/05/17
B Client Review Set	05/03/18
C Bid Set	05/11/18
D	

Revisions:	Date:
1	
2	
3	
4	
5	
6	
7	
8	
9	

**DO NOT SCALE PLANS**  
 Copying, Printing, Software and other processes required to produce these prints on stretch or shrink the actual paper or layout. Therefore, scaling of this drawing may be inaccurate. Contact msc consultants with any need for additional dimensions or clarifications.

DRAWN BY: MEM  
 REVIEWED BY: KFF



ALDI Inc. Store #: 65  
 Charlotte, NC  
 6113 Idlewild Road  
 Charlotte, NC 28212  
 Mecklenburg County  
 Project Name & Location:

Lighting Plan	
Drawing Name:	
Prototype Rls. 09/07/17	Project No. 40452-13
Type: LHSD-V8	
	E-101
Scale: As Noted	Drawing No.