



SEALS
© COPYRIGHT 2017 ROSENBLUM COE ARCHITECTS, INC.
THIS DRAWING HAS BEEN PREPARED BY ROSENBLUM COE ARCHITECTS, INC. FOR THE PROJECT INDICATED. NO PART OF THIS DRAWING SHALL BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, WITHOUT THE WRITTEN PERMISSION OF ROSENBLUM COE ARCHITECTS, INC.

- NOTES
- 1 DEMOLISH WALL MOUNTED RETURN AIR GRILL AND ASSOCIATED DUCTWORK.
 - 2 TEMPORARILY PATCH DIFFUSERS FROM STRUCTURE TO ALLOW FOR NEW CEILING INSTALLATION.
 - 3 DEMOLISH VAV BOX AND DOWNSTREAM DUCTWORK.
 - 4 DIFFUSERS TO BE RELOCATED. SEE M101 FOR FURTHER INFORMATION.
 - 5 DEMOLISH HEATING HOT WATER SUPPLY AND RETURN AS INDICATED. GAP TEMPORARILY. SEE M101 FOR FURTHER INFORMATION.
 - 6 DEMOLISH DIFFUSER, FLEXIBLE DUCTWORK AND DUCTWORK TAP. PATCH DUCTWORK AND INSULATE TO MATCH EXISTING.
 - 7 PRIOR TO ANY WORK BEING PERFORMED THE CONTRACTOR SHALL PERFORM A BASELINE AIR AND PRESSURE READING AT THIS POINT. THE BASELINE AIR READINGS SHALL BE COMPILED INTO A REPORT AND SUBMITTED TO THE OWNER AND ENGINEER OF RECORD FOR REVIEW.
 - 8 PRIOR TO ANY WORK BEING PERFORMED THE CONTRACTOR SHALL PERFORM A BASELINE AIR AND PRESSURE READING ON VAV BOX TO ENSURE EXISTING VAV BOX IS CAPABLE OF 400 CFM. THE CONTRACTOR SHALL FORCE THE VAV BOX INTO ITS FULLY OPEN POSITION TO OBTAIN REQUIRED FLOW READINGS. IF NECESSARY, IF VAV BOX TOTAL AIRFLOW IS INSUFFICIENT, CONTRACTOR SHALL CLEAN AND MAINTAIN THE VAV BOX TO OPTIMAL CONDITIONS PRIOR TO RETESTING. IMMEDIATELY NOTIFY THE OWNER, ARCHITECT AND ENGINEER IF AIRFLOWS ARE INSUFFICIENT. THE VAV BOX AIR READINGS SHALL BE COMPILED INTO A REPORT AND SUBMITTED TO THE OWNER AND ENGINEER OF RECORD FOR REVIEW.
 - 9 PRIOR TO ANY WORK BEING PERFORMED THE CONTRACTOR SHALL PERFORM A BASELINE AIR AND PRESSURE READING ON VAV BOX TO ENSURE EXISTING VAV BOX IS CAPABLE OF 1100 CFM. THE CONTRACTOR SHALL FORCE THE VAV BOX INTO ITS FULLY OPEN POSITION TO OBTAIN REQUIRED FLOW READINGS. IF NECESSARY, IF VAV BOX TOTAL AIRFLOW IS INSUFFICIENT, CONTRACTOR SHALL CLEAN AND MAINTAIN THE VAV BOX TO OPTIMAL CONDITIONS PRIOR TO RETESTING. IMMEDIATELY NOTIFY THE OWNER, ARCHITECT AND ENGINEER IF AIRFLOWS ARE INSUFFICIENT. THE VAV BOX AIR READINGS SHALL BE COMPILED INTO A REPORT AND SUBMITTED TO THE OWNER AND ENGINEER OF RECORD FOR REVIEW.

- GENERAL NOTES
1. REFER TO M101 FOR GENERAL NOTES.
 2. ONE COPY OF THE PRE-TAB REPORT SHALL REMAIN WITH THE CONTRACTOR ON SITE FOR THE DURATION OF THE PROJECT.

MUSC
MEDICAL UNIVERSITY
of SOUTH CAROLINA
PROJECT NUMBER: H51-50068
DHEC PROJECT NUMBER: 580145

CONSTRUCTION DOCUMENTS


**STORM EYE INSTITUTE
OPTICAL SHOP
H51-50068**
167 ASHLEY AVE
CHARLESTON, SC 29425

**ROSENBLUM COE
ARCHITECTS,
INC.**
1643 MEANS STREET
CHARLESTON, SC 29412
843.577.6073

MECHANICAL DEMOLITION FIRST FLOOR PLAN

SHEET NAME	
PROJECT NUMBER	17016
DRAWN BY	TSN
CHECKED BY	CRB
DATE	05/09/2018
SCALE	1/4" = 1'-0"

MD101

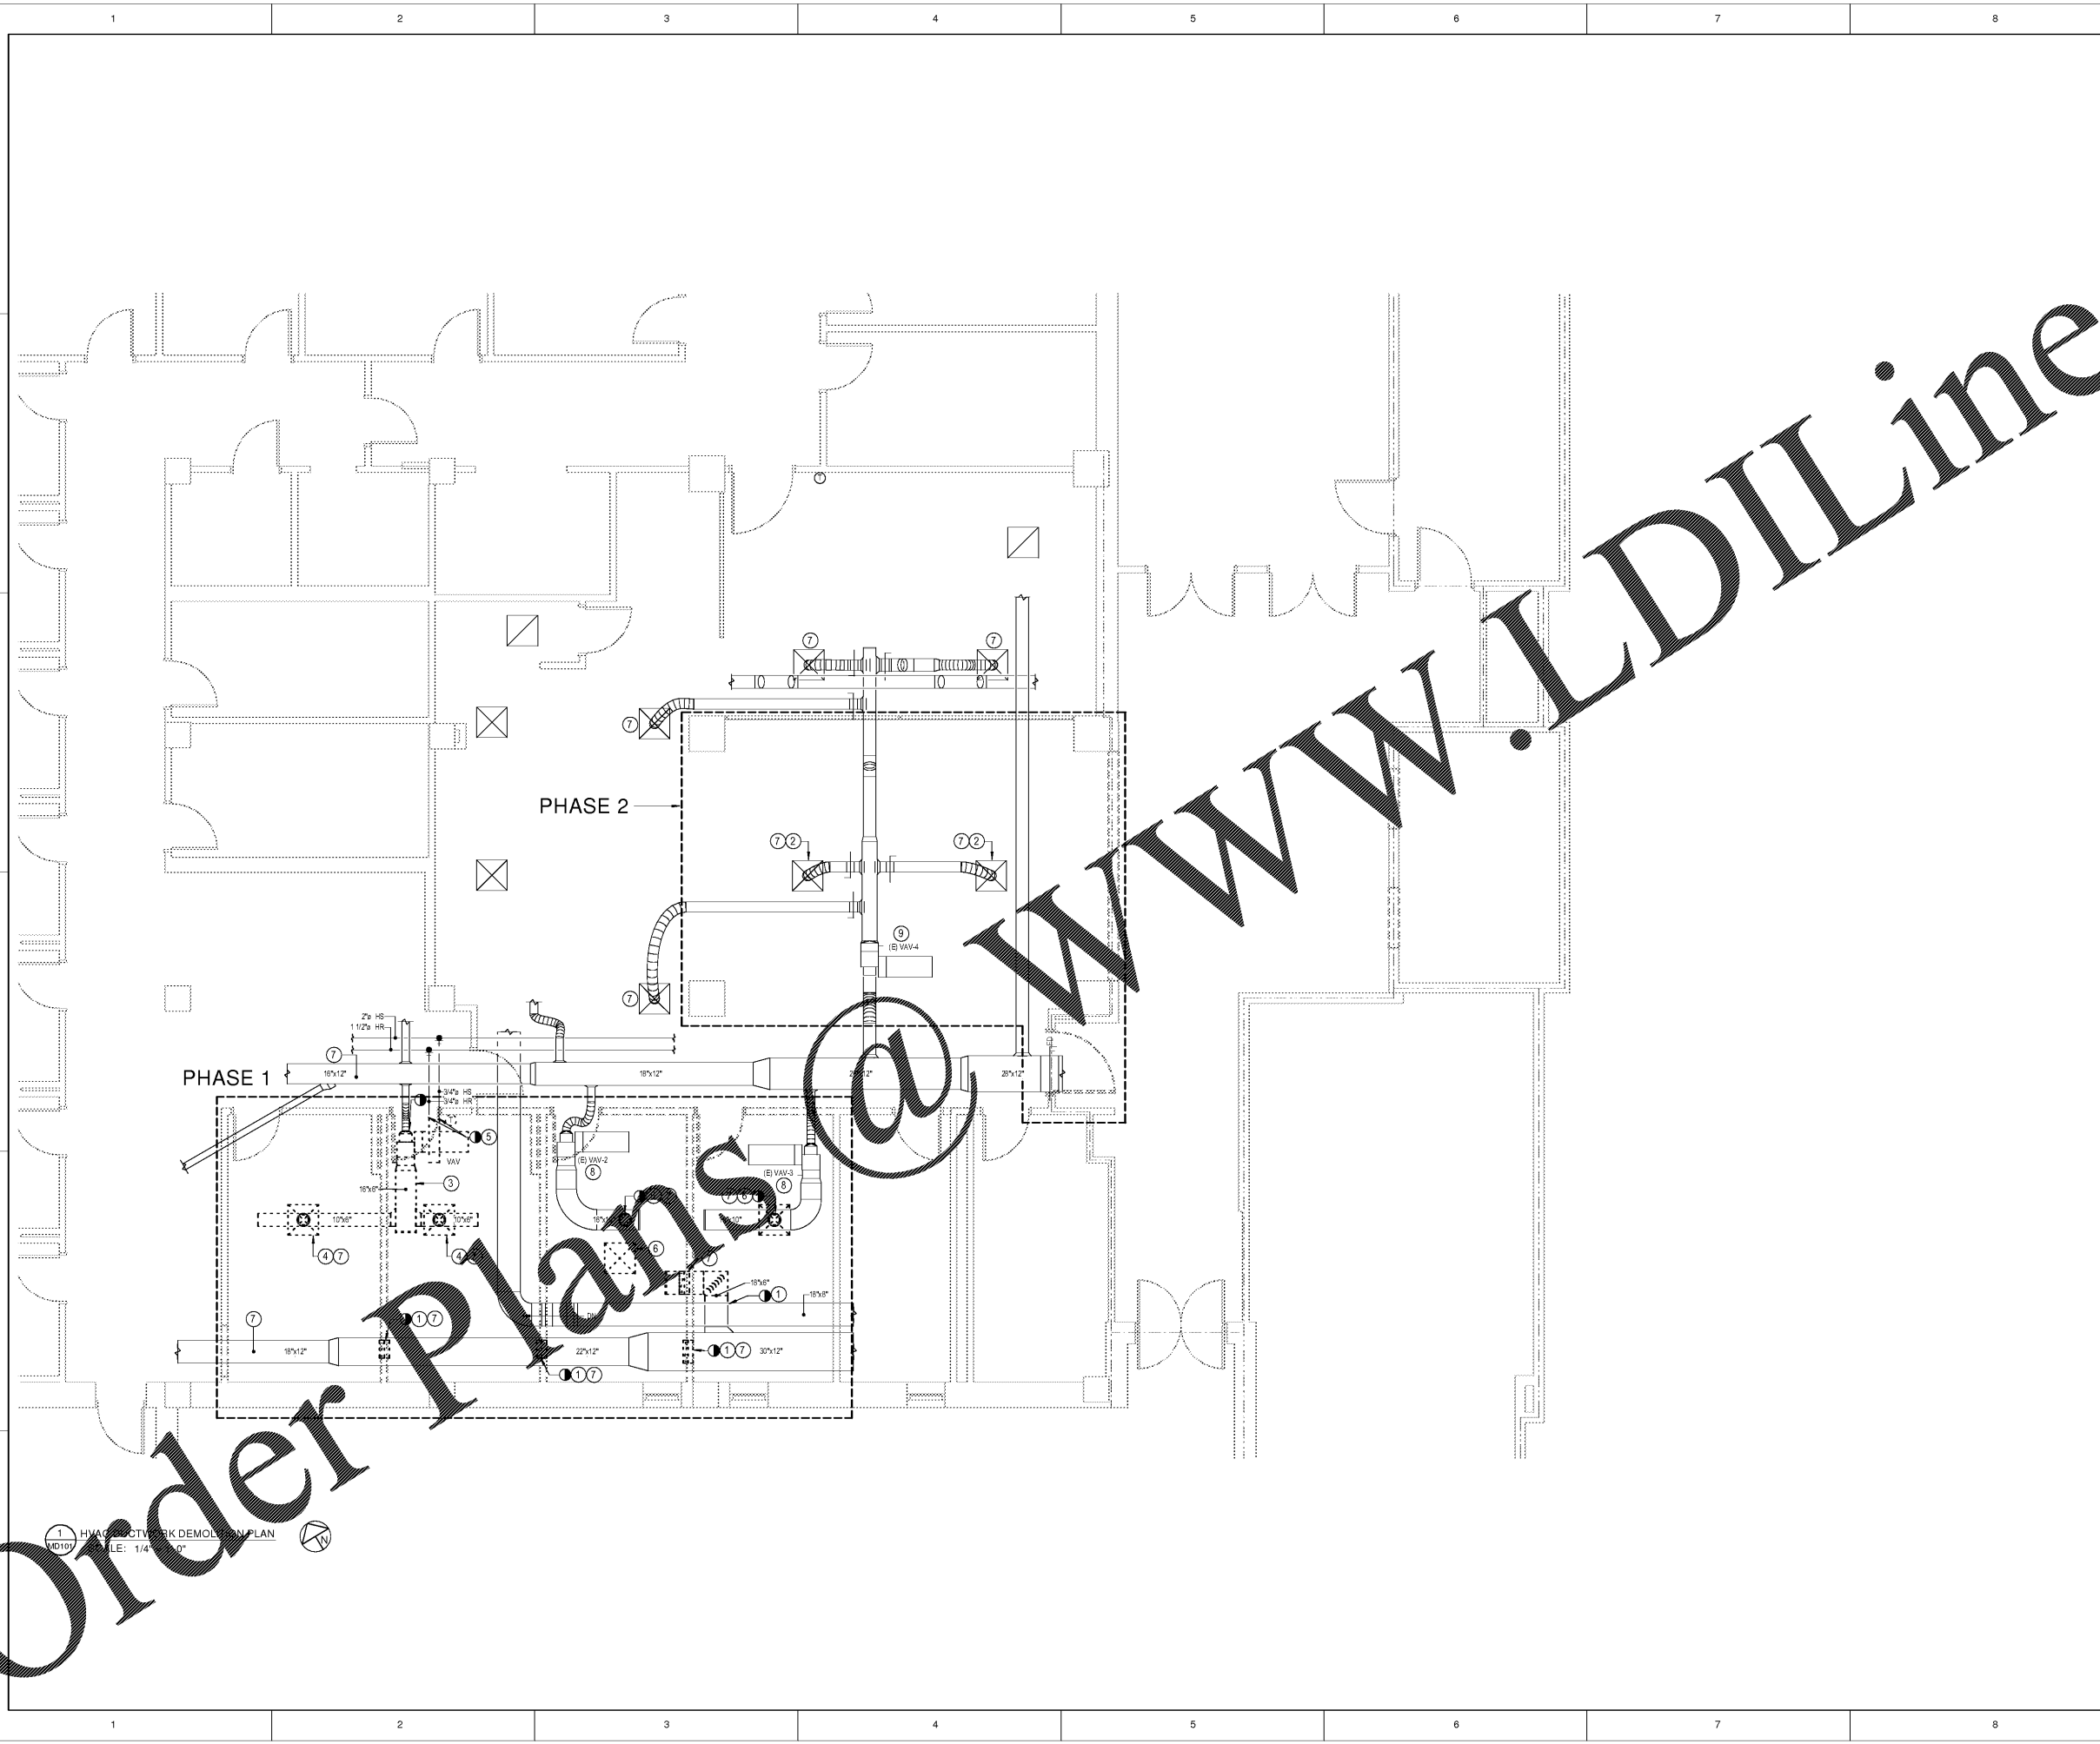

Order Plans @ www.LDILine.com

1 HVAC DUCTWORK DEMOLITION PLAN
MD101
SCALE: 1/4" = 1'-0"