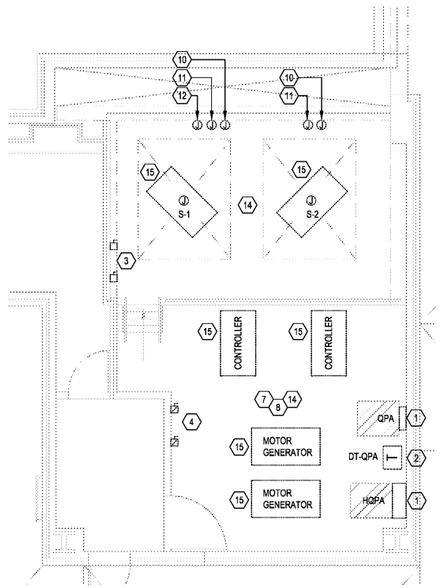

1 DEMOLITION PLAN - BUILDING A - PENTHOUSE
1/4" = 1'-0"

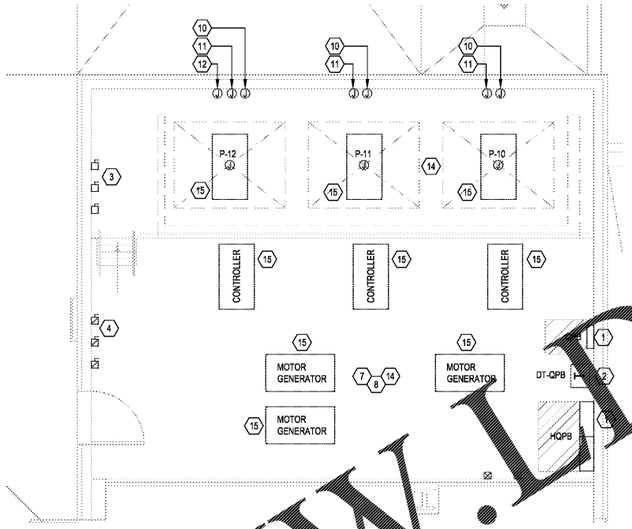

2 DEMOLITION PLAN - BUILDING A - PENTHOUSE
1/4" = 1'-0"

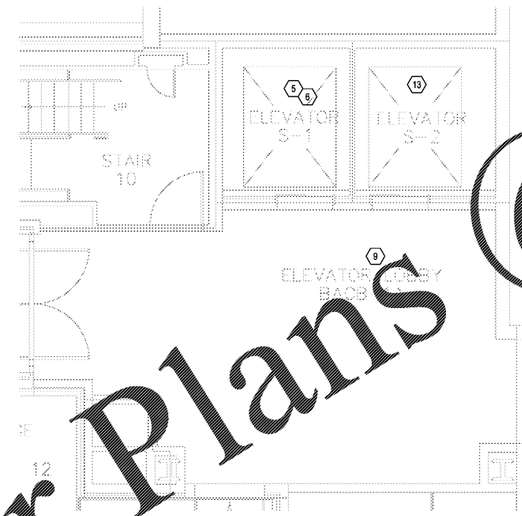

3 DEMOLITION PLAN - BUILDING A - BASEMENT
1/4" = 1'-0"

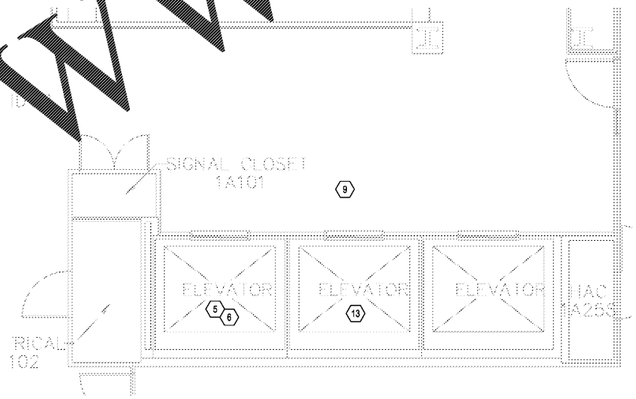

4 DEMOLITION PLAN - BUILDING A - GROUND FLOOR
1/4" = 1'-0"

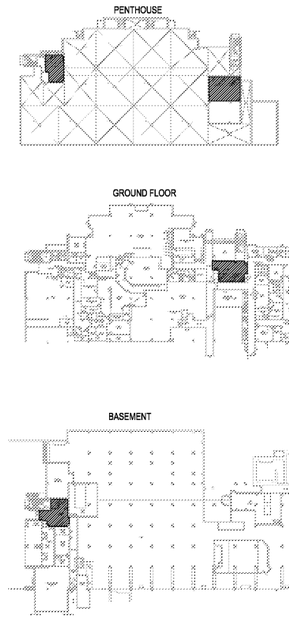

3 KEY PLAN
1/64" = 1'-0"

GRAPHIC LEGEND

INDICATES EXISTING TO BE DEMOLISHED

INDICATES EXISTING TO REMAIN

DEMOLITION NOTES

1. EXISTING PANELBOARD TO BE DEMOLISHED. REMOVE EXISTING CIRCUIT BREAKERS SERVING ELEVATOR EQUIPMENT BEING DEMOLISHED. ALL EXISTING FEEDS AND CONDUIT ARE TO REMAIN AND SHALL REMAIN PROTECTED DURING CONSTRUCTION AND DEMOLITION.
2. EXISTING 30 kVA TRANSFORMER TO REMAIN.
3. EXISTING EQUIPMENT DISCONNECTS TO BE DEMOLISHED. ALL CIRCUITS AND CONDUITS SHALL BE DEMOLISHED BACK TO THE SOURCE.
4. EXISTING EQUIPMENT FUSED DISCONNECTS TO BE DEMOLISHED. ALL CABLING AND CONDUITS SHALL BE DEMOLISHED BACK TO THE SOURCE.
5. DEMOLISH ALL ELEVATOR PIT/MACHINE LIGHTING FIXTURES AND DEVICES. DEMOLISH ALL CONDUIT AND CABLING BACK TO SOURCE.
6. DEMOLISH ALL ELEVATOR PIT RECEPTACLES. DEMOLISH ALL CONDUIT AND CABLING BACK TO SOURCE.
7. ALL LIGHTING FIXTURES, DEVICES, CONDUIT, AND WIRE SERVING THIS SPACE IS EXISTING TO REMAIN. LIGHTING SHOULD REMAIN PROTECTED DURING THE DEMOLITION PHASE OF CONSTRUCTION. ANY DAMAGE DUE TO DEMOLITION SHALL BE REPAIRED TO PROPER WORKING ORDER.
8. ALL RECEPTACLE, CONDUIT, AND WIRE SERVING THIS SPACE IS EXISTING TO REMAIN. LIGHTING SHOULD REMAIN PROTECTED DURING THE DEMOLITION PHASE OF CONSTRUCTION. ANY DAMAGE DUE TO DEMOLITION SHALL BE REPAIRED TO PROPER WORKING ORDER.
9. ALL FIRE ALARM DEVICES SHALL REMAIN INTACT. ALL FIRE ALARM CABLING, DEVICES, ACCESSORIES, AND CONDUIT SHALL REMAIN IN TACT FOR INSTALLATION OF NEW DEVICES TYING INTO EXISTING NAC/SLC FIRE ALARM CIRCUITS.
10. DEMOLISH EXISTING CONNECTION TO ELEVATOR CAB LIGHTING. ALL CONDUIT AND WIRING SHALL BE REMOVED BACK TO SOURCE.
11. DEMOLISH CONNECTION TO ELEVATOR INTERCOM. EXISTING CONDUITS SHALL REMAIN WITH CABLING REMOVED TO ALLOW REWIRING OF NEW INTERCOM CABLING.
12. EXISTING CONNECTION TO AUTOMATIC TRANSFER SWITCH. ALL CONDUIT SHALL REMAIN INTACT WITH CABLING REMOVED TO ALLOW REWIRING OF NEW ELEVATOR CABLING.
13. EXISTING ELEVATOR PIT SUMP PUMPS TO REMAIN. ENSURE ALL CONDUIT, CABLES, DEVICES, AND ACCESSORIES ARE TO REMAIN PROTECTED DURING CONSTRUCTION.
14. ALL FIRE ALARM DEVICES IN THIS SPACE SHALL BE DEMOLISHED. ALL FIRE ALARM CABLING, DEVICES, ACCESSORIES, AND CONDUIT SHALL REMAIN IN TACT FOR INSTALLATION OF NEW DEVICES TYING INTO EXISTING NAC/SLC FIRE ALARM CIRCUITS.
15. EXISTING ELEVATOR EQUIPMENT TO BE DEMOLISHED. ALL EXISTING CONDUIT AND CABLING SHALL BE DEMOLISHED BACK TO SOURCE.

Order Plans @ www.LDLinc.com

CONSTRUCTION DOCUMENTS
FULLY SPRINKLERED

CONSULTANTS:	ARCHITECT/ENGINEERS: BES DESIGN/BUILD, LLC, 766 Middle St, Fairhope, AL 36532, Phone: 251.990.5778, Fax: 251.990.3716	Drawing Title: ELECTRICAL DEMOLITION PLAN - BUILDING A	Project Title: UPGRADE ELEVATORS BUILDINGS A, B, C, AND D
Revisions: / Date		Approved: Project Director	Location: ATLANTA VAMC 1670 CLAIRMONT ROAD, DECATUR, GA, 30033
			Date: 05/01/2017 · Drawn: KRW · Checked: MCE
			Project Number: 508-14-123 · Building Number: A · Drawing Number: ED101 · Dwg. 22 of 28
			ATLANTA VA MEDICAL CENTER · Department of Veterans Affairs

9/25/2017 2:02 PM
VA FORM 08-6231