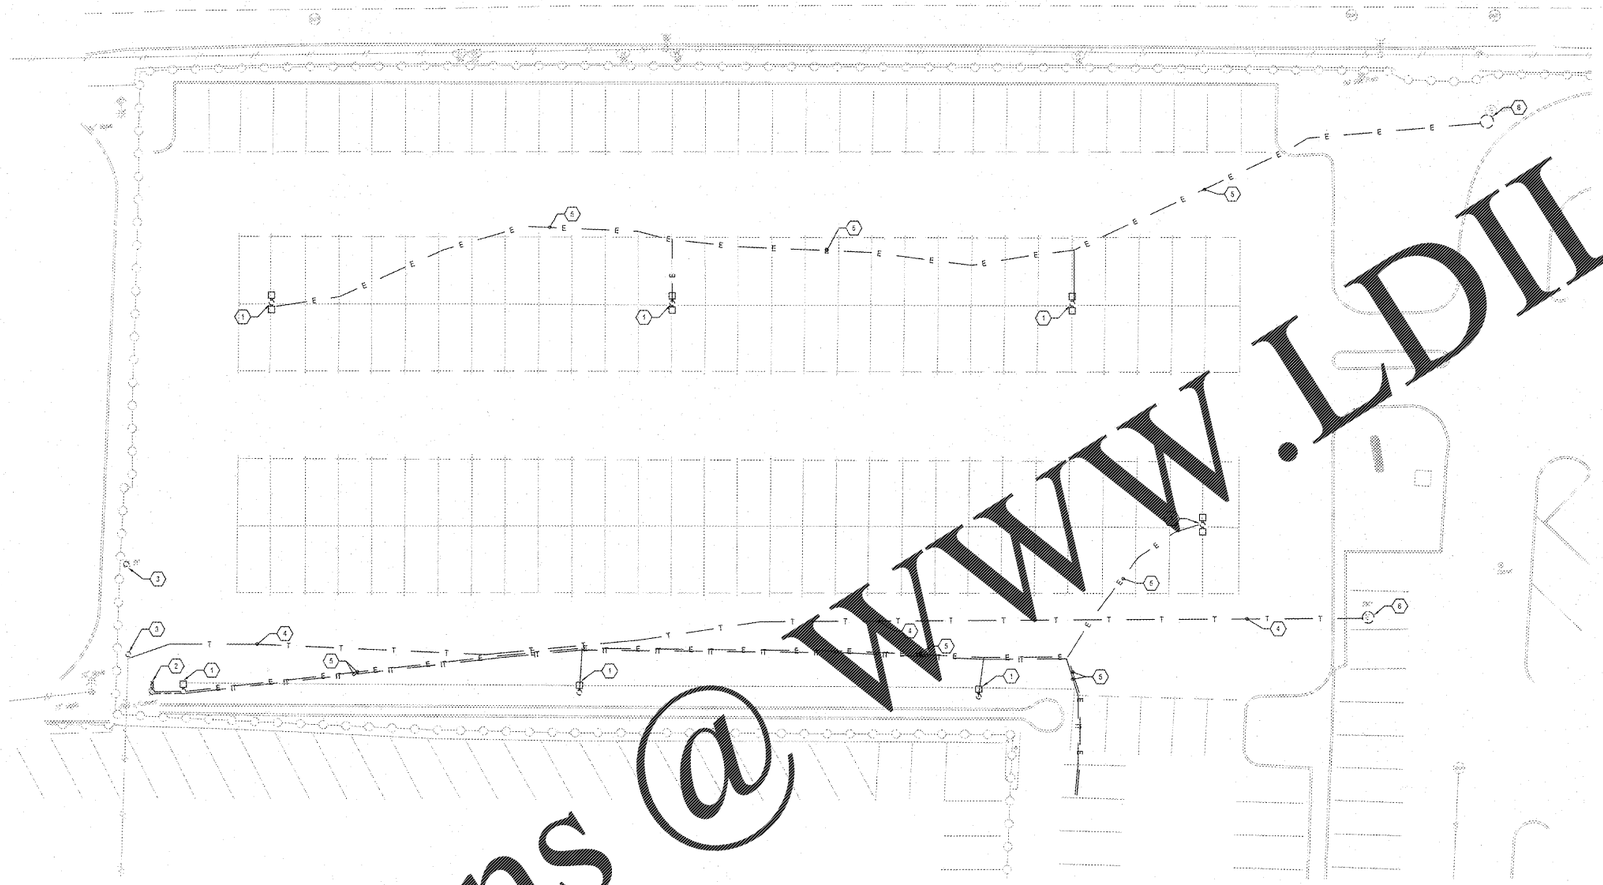

1 ELECTRICAL SITE DEMO PLAN
1" = 15'

GENERAL NOTES

1. UNDERGROUND CONDUIT MAY BE ABANDONED IN PLACE WHERE IT DOES NOT IMPEDE GARAGE CONSTRUCTION. ALL CONDUCTORS AND CABLING SHALL BE DEMOLISHED TO ITS SOURCE. NO CONDUCTORS OR CABLING MAY BE ABANDONED.
2. EXISTING LIGHTING, RECEPTACLES, AND CAM[illegible] CIRCUITED FROM ELECTRICAL ROOM EB111[illegible] [illegible]EAR [illegible] SOUTH WEST CORNER OF BUILDING [illegible] [illegible]ND FLOOR [illegible] PANEL LNG2 CIRCUITS 14,16,18,[illegible] [illegible]NEL RNG2 CIRCUITS 57, 59, 60, 62, 64 [illegible] CIRC[illegible] ALL DEVICES NOT LABELED FOR DEM[illegible] OR OUTS[illegible] [illegible]EA OF WORK SHALL REMAIN CIRC[illegible] [illegible]VIDE PANEL [illegible]DULES REFLECTING CIRCUITING [illegible]GES.
3. FOR [illegible] WIRING [illegible] DEMOLISHED [illegible] [illegible] AND [illegible] [illegible]ACH PU[illegible] OR MAN HO[illegible] VERIFY [illegible]ING HAS NO[illegible] [illegible]PLICED [illegible] OTHER DEVICES NOT TO BE DEMOLISHED.
4. [illegible] ALL UNDERGROU[illegible] WORK: [illegible]TE AND PROTECT ALL [illegible]NG UTILITIES. D[illegible]GE TO EXISTING UNDERGROUND C[illegible]CTION SHALL [illegible] REPAIRED AT NO ADDITIONAL CO[illegible]

KEYED NOTES

1. DEMO POLE, LIGHT AND APPURTENANCES.
2. DEMO POLE, CAMERA AND APPURTENANCES.
3. DEMO ABANDONED UTILITY POLE. COORDINATE WITH MLGW.
4. EXISTING DRAWINGS (LOCATED IN PIPE ON ABANDONED UTILITY POLE (KEYNOTE 3)) INDICATE BURIED TELEPHONE LINE WHICH PRE-DATES 1987. VERIFY LINE IS ABANDONED AND DEMO.
5. DEMO LIGHTING AND RECEPTACLE POWER CONDUCTORS AND CAMERA CABLES TO SOURCE.
6. AFTER DEMOLITION OF WIRING/CABLING, VERIFY THAT NO OTHER WIRING OR CABLING IS PRESENT AND IN-USE WITHIN MANHOLE AND DEMO MANHOLE.

Order Plans @ WWW.LDILine.com

Revisions:	Date

VA U.S. Department of Veterans Affairs
MEMPHIS VAMC
1030 JEFFERSON AVE MEMPHIS, TN 38104

ARCHITECT/ENGINEERS:

PROJECT LEAD
Architect, Structural Engineer, Civil Engineer
GUIDON DESIGN
905 N. CAPITOL AVE. SUITE 100 INDIANAPOLIS, IN 46204
317.800.6388 WWW.GUIDONDESIGN.COM
SUSTAINABLE ARCHITECTURE + ENGINEERING

MEP Engineer
APOGEE CONSULTING GROUP
1151 Kildaire Farm Rd.
Suite 120
Cary, NC 27511
Tele: 919-858-7420

Functional Design
CARL WALKER INC.
3211 Internet Blvd., Suite 220
Frisco, TX 75034
Tele: 469-777-5143

BID SET

Drawing Title	Project Title	Project Number	
ELECTRICAL SITE DEMO PLAN	CONSTRUCT PARKING GARAGE ON WEST LOT	15-412	OFFICE OF FACILITIES MANAGEMENT
		Building Number	
Approved for Design Concept: FACILITY MANAGEMENT DIVISION MANAGER	Location: MEMPHIS, TN	Drawing Number: EE101	VA Project Number: 614-319
	Date: 11/14/2016 · Checked By: JKM · Drawn By: SCB		VA U.S. Department of Veterans Affairs