


GENERAL NOTES


- FOR ALL UNDERGROUND WORK: LOCATE AND PROTECT ALL EXISTING UTILITIES. DAMAGE TO EXISTING UNDERGROUND CONSTRUCTION SHALL BE REPAIRED AT NO ADDITIONAL COST.
- PROVIDE POLE BASES PER DETAIL 12EE502

KEY NOTES

1. 2" x 2" CONCRETE SECTIONAL BORE FOR IT CABLING. DETERMINE EXACT ROUTE WITH GROUND PENETRATING RADAR OR OTHER SUBSURFACE UTILITY ENGINEERING METHODS AS NECESSARY. CONTENTS PER DETAIL 11EE502.
2. 1" CONCRETE-ENCASED DUCTBANK PER DETAIL 4EE502
3. MIN 35"x30" POLYMER CONCRETE HAND HOLE PER DETAIL 13EE502
4. PROPOSED LOCATION OF OVERHEAD UTILITY TRANSFORMER. COORDINATE WITH 14E.09V.
5. SERVICE LATERALS PER SINGLE-LINE DIAGRAM, E8901, ENCASED IN 2" CONCRETE ON ALL SIDES OF CONDUIT.
6. STUB-UP IN IT ROOM BENEATH BACKBOARD AS SHOWN ON PLANS.
7. SEE 4EE103 FOR ENTRY INTO AND ROUTING THROUGH HOSPITAL TO BUILDING 6.
8. POLE LIGHTING CIRCUIT, 2-12 AWG, 12 AWG EQ. 1" C. CIRCUIT PER PANEL SCHEDULE.

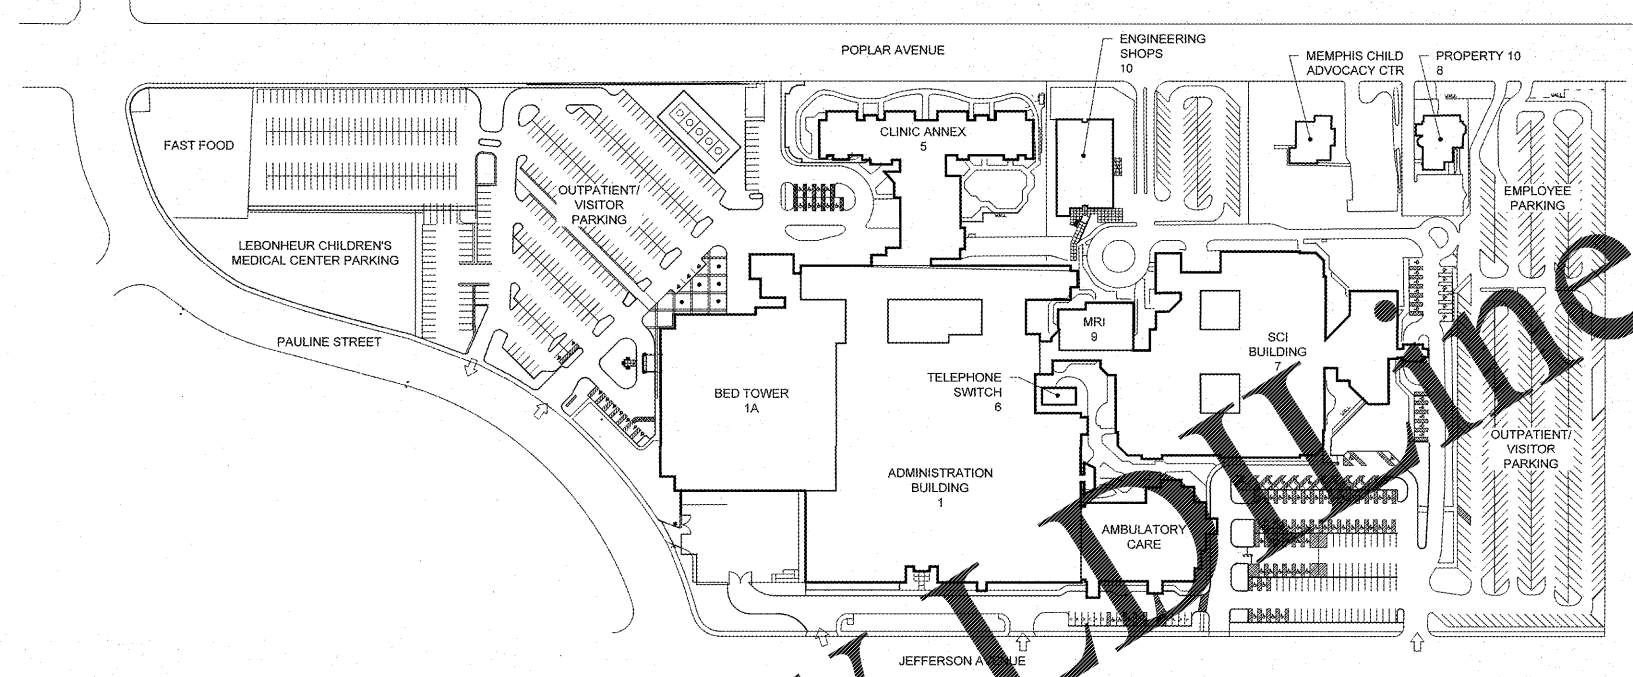

2 EXISTING CAMPUS MAP (REFERENCE ONLY)
1" = 100'

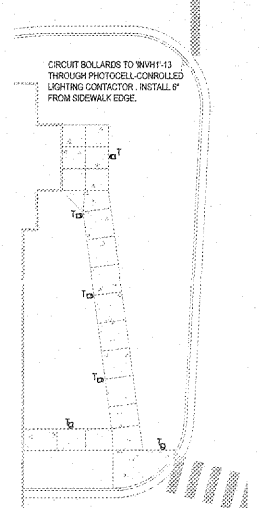

3 BOLLARD LIGHTING
1" = 10'



1 ELECTRICAL SITE PLAN
1" = 30'

1/8" = 1'-0" (SEE DETAIL 12EE502)
 1/4" = 1'-0" (SEE DETAIL 12EE502)
 1/2" = 1'-0" (SEE DETAIL 12EE502)
 3/4" = 1'-0" (SEE DETAIL 12EE502)
 1" = 1'-0" (SEE DETAIL 12EE502)
 1 1/4" = 1'-0" (SEE DETAIL 12EE502)
 1 1/2" = 1'-0" (SEE DETAIL 12EE502)
 1 3/4" = 1'-0" (SEE DETAIL 12EE502)
 2" = 1'-0" (SEE DETAIL 12EE502)
 2 1/4" = 1'-0" (SEE DETAIL 12EE502)
 2 1/2" = 1'-0" (SEE DETAIL 12EE502)
 2 3/4" = 1'-0" (SEE DETAIL 12EE502)
 3" = 1'-0" (SEE DETAIL 12EE502)
 3 1/4" = 1'-0" (SEE DETAIL 12EE502)
 3 1/2" = 1'-0" (SEE DETAIL 12EE502)
 3 3/4" = 1'-0" (SEE DETAIL 12EE502)
 4" = 1'-0" (SEE DETAIL 12EE502)
 4 1/4" = 1'-0" (SEE DETAIL 12EE502)
 4 1/2" = 1'-0" (SEE DETAIL 12EE502)
 4 3/4" = 1'-0" (SEE DETAIL 12EE502)
 5" = 1'-0" (SEE DETAIL 12EE502)
 5 1/4" = 1'-0" (SEE DETAIL 12EE502)
 5 1/2" = 1'-0" (SEE DETAIL 12EE502)
 5 3/4" = 1'-0" (SEE DETAIL 12EE502)
 6" = 1'-0" (SEE DETAIL 12EE502)
 6 1/4" = 1'-0" (SEE DETAIL 12EE502)
 6 1/2" = 1'-0" (SEE DETAIL 12EE502)
 6 3/4" = 1'-0" (SEE DETAIL 12EE502)
 7" = 1'-0" (SEE DETAIL 12EE502)
 7 1/4" = 1'-0" (SEE DETAIL 12EE502)
 7 1/2" = 1'-0" (SEE DETAIL 12EE502)
 7 3/4" = 1'-0" (SEE DETAIL 12EE502)
 8" = 1'-0" (SEE DETAIL 12EE502)
 8 1/4" = 1'-0" (SEE DETAIL 12EE502)
 8 1/2" = 1'-0" (SEE DETAIL 12EE502)
 8 3/4" = 1'-0" (SEE DETAIL 12EE502)
 9" = 1'-0" (SEE DETAIL 12EE502)
 9 1/4" = 1'-0" (SEE DETAIL 12EE502)
 9 1/2" = 1'-0" (SEE DETAIL 12EE502)
 9 3/4" = 1'-0" (SEE DETAIL 12EE502)
 10" = 1'-0" (SEE DETAIL 12EE502)

1/8" = 1'-0" (SEE DETAIL 12EE502)
 1/4" = 1'-0" (SEE DETAIL 12EE502)
 1/2" = 1'-0" (SEE DETAIL 12EE502)
 3/4" = 1'-0" (SEE DETAIL 12EE502)
 1" = 1'-0" (SEE DETAIL 12EE502)
 1 1/4" = 1'-0" (SEE DETAIL 12EE502)
 1 1/2" = 1'-0" (SEE DETAIL 12EE502)
 1 3/4" = 1'-0" (SEE DETAIL 12EE502)
 2" = 1'-0" (SEE DETAIL 12EE502)
 2 1/4" = 1'-0" (SEE DETAIL 12EE502)
 2 1/2" = 1'-0" (SEE DETAIL 12EE502)
 2 3/4" = 1'-0" (SEE DETAIL 12EE502)
 3" = 1'-0" (SEE DETAIL 12EE502)
 3 1/4" = 1'-0" (SEE DETAIL 12EE502)
 3 1/2" = 1'-0" (SEE DETAIL 12EE502)
 3 3/4" = 1'-0" (SEE DETAIL 12EE502)
 4" = 1'-0" (SEE DETAIL 12EE502)
 4 1/4" = 1'-0" (SEE DETAIL 12EE502)
 4 1/2" = 1'-0" (SEE DETAIL 12EE502)
 4 3/4" = 1'-0" (SEE DETAIL 12EE502)
 5" = 1'-0" (SEE DETAIL 12EE502)
 5 1/4" = 1'-0" (SEE DETAIL 12EE502)
 5 1/2" = 1'-0" (SEE DETAIL 12EE502)
 5 3/4" = 1'-0" (SEE DETAIL 12EE502)
 6" = 1'-0" (SEE DETAIL 12EE502)
 6 1/4" = 1'-0" (SEE DETAIL 12EE502)
 6 1/2" = 1'-0" (SEE DETAIL 12EE502)
 6 3/4" = 1'-0" (SEE DETAIL 12EE502)
 7" = 1'-0" (SEE DETAIL 12EE502)
 7 1/4" = 1'-0" (SEE DETAIL 12EE502)
 7 1/2" = 1'-0" (SEE DETAIL 12EE502)
 7 3/4" = 1'-0" (SEE DETAIL 12EE502)
 8" = 1'-0" (SEE DETAIL 12EE502)
 8 1/4" = 1'-0" (SEE DETAIL 12EE502)
 8 1/2" = 1'-0" (SEE DETAIL 12EE502)
 8 3/4" = 1'-0" (SEE DETAIL 12EE502)
 9" = 1'-0" (SEE DETAIL 12EE502)
 9 1/4" = 1'-0" (SEE DETAIL 12EE502)
 9 1/2" = 1'-0" (SEE DETAIL 12EE502)
 9 3/4" = 1'-0" (SEE DETAIL 12EE502)
 10" = 1'-0" (SEE DETAIL 12EE502)

Revisions:	Date:

VA U.S. Department of Veterans Affairs
MEMPHIS VAMC
1030 JEFFERSON AVE MEMPHIS, TN 38104

ARCHITECT/ENGINEERS:
PROJECT LEAD Architect, Structural Engineer, Civil Engineer
GUIDON DESIGN
905 N. CAPITOL AVE., SUITE 100 INDIANAPOLIS, IN 46204
317.690.9388 WWW.GUIDONDESIGN.COM
SUSTAINABLE ARCHITECTURE + ENGINEERING

MEP Engineer APOGEE CONSULTING GROUP
1151 Kildaire Farm Rd. Suite 120 Cary, NC 27511
Tele: 919-858-7420

Functional Design CARL WALKER INC.
3211 Internet Blvd., Suite 220 Frisco, TX 75034
Tele: 469-777-5143

BID SET			
Drawing Title ELECTRICAL SITE PLAN	Project Title CONSTRUCT PARKING GARAGE ON WEST LOT	Project Number 15-412 Building Number	OFFICE OF FACILITIES MANAGEMENT
Approved for Design Concept: FACILITY MANAGEMENT DIVISION MANAGER	Location MEMPHIS, TN	Drawing Number EE102	VA Project Number 614-319
Date 11/14/2016	Checked By: JKM	Drawn By: SCB	VA U.S. Department of Veterans Affairs