

HVAC GENERAL NOTES:

HVAC GENERAL REQUIREMENTS:

- PROVIDE MATERIALS AND EQUIPMENT AND EXECUTE THE WORK, INCLUDING ALL TESTING AND INSPECTIONS, IN COMPLIANCE WITH THE APPLICABLE PROVISIONS OF FEDERAL, STATE AND LOCAL GOVERNMENT LAWS, ORDINANCES, REFERENCED CODES AND STANDARDS CURRENT AS OF THE ISSUE DATE OF THESE DRAWINGS. ALL MORE STRINGENT REQUIREMENTS OF THE CONTRACT DOCUMENTS SHALL MODIFY, SUPPLEMENT AND SUPERSEDE APPLICABLE PORTIONS OF GOVERNING LAWS, ORDINANCES, CODES AND STANDARDS.
- CONTRACTOR SHALL PRESENT CERTIFICATE TO THE TENANT AND LANDLORD THAT ALL APPLICABLE BUILDING PERMITS HAVE BEEN SECURED PRIOR TO STARTING ANY WORK, AND PROVIDE THE TENANT AND LANDLORD WITH ALL REQUIRED CERTIFICATES OF FINAL APPROVAL FROM THE GOVERNING JURISDICTIONS AT COMPLETION OF THE WORK. PROVIDE ALL SHOP DRAWINGS AS REQUIRED IN FOLLOWING SECTIONS.
- COORDINATE EXACT LOCATION OF CONSTRUCTION TO PRECLUDE ANY INTERFERENCES BETWEEN PIPING, WIRING, LIGHTING FIXTURES, DUCTWORK, BUILDING EQUIPMENT, PROCESS EQUIPMENT AND OTHER CONSTRUCTION.
- PROVIDE LABOR, INCLUDING FIELD ERECTION AND SUPERVISION, MATERIALS, EQUIPMENT AND ANCILLARIES, AND COORDINATE, PROCURE, FABRICATE, DELIVER, ERECT OR INSTALL, INTERFACE WITH EXISTING WORK, START, DEBUG AND TEST ALL SYSTEMS AS NECESSARY TO PROVIDE THE OWNER WITH A COMPLETE, OPERATING FACILITY IN CONFORMANCE WITH THE CONSTRUCTION BID DOCUMENTS.
- ALL CUTTING AND PATCHING THAT MAY BE NECESSARY FOR THE INSTALLATION OF THE MECHANICAL CONTRACTOR'S WORK SHALL BE PERFORMED AND REPAIRED BY THE TRADE WHOM NORMALLY PERFORMS THAT WORK AND PAID FOR BY THE MECHANICAL CONTRACTOR. NO CUTTING / ALTERATION OF THE BUILDING STRUCTURAL SYSTEM SHALL BE PERFORMED WITHOUT THE WRITTEN CONSENT OF THE LANDLORD AFTER ARCHITECT HAS APPROVED AND SIGNED OFF.
- THE MECHANICAL CONTRACTOR SHALL VISIT THE SITE PRIOR TO SUBMITTING HIS BID TO FAMILIARIZE HIMSELF WITH THE ACTUAL PROJECT CONDITIONS AND TO CHECK FOR ANY INTERFERENCES BETWEEN HIS WORK AND THAT OF THE OTHER TRADES, AND/OR ANY APPARENT VIOLATIONS OF LOCAL OR STATE CODES, LAWS, ORDINANCES AND REGULATIONS. SHOULD ANY VIOLATIONS OR INTERFERENCES APPEAR AND DEPARTURE FROM THE DESIGN INTENT OF THE CONTRACT DOCUMENTS IS REQUIRED, THE CONTRACTOR SHALL NOTIFY THE ARCHITECT PRIOR TO ENTERING INTO A CONTRACT WITH THE OWNER. FAILURE TO PROVIDE THE ARCHITECT WITH THE FOREMENTIONED NOTIFICATION SHALL RESULT IN THE CONTRACTOR BEING HELD RESPONSIBLE TO COMPLETE ALL WORK TO MEET THE INTENT OF THE CONTRACT DOCUMENTS WITH NO ADDITIONAL EXPENSES BEING INCURRED BY THE OWNER.
- THE DRAWINGS ARE DIAGRAMMATIC AND SHOW GENERAL LOCATIONS AND ARRANGEMENTS OF ALL THE EQUIPMENT AND PIPING. THE DRAWINGS SHALL BE FOLLOWED AS CLOSELY AS BUILDING CONSTRUCTION AND ALL OTHER WORK WILL PERMIT. DO NOT SCALE DRAWINGS FOR EXACT MEASUREMENTS.
- SHOULD THE CONTRACTOR SUBMIT ANY SHOP DRAWINGS FOR REVIEW THAT VARY FROM WHAT THE CONSTRUCTION BID DOCUMENTS INDICATE, THE CONTRACTOR SHALL PAY THE ENGINEER FOR REVIEWING HIS SUBMISSION.

GENERAL NOTES: PIPING

- ALL PIPING SHALL BE CONCEALED UNLESS OTHERWISE NOTED. EXPOSING OF ANY PIPING MUST HAVE APPROVAL OF THE ARCHITECT.
- THE PIPING SYSTEMS SHALL BE INSTALLED IN STRICT ACCORDANCE WITH ALL STATE AND LOCAL CODES. THE PIPING CONTRACTOR SHALL OBTAIN ALL PERMITS, PAY FOR ALL FEES, AND ARRANGE FOR ALL INSPECTIONS FOR HIS WORK. AT THE COMPLETION OF THE PROJECT, THE PLUMBING CONTRACTOR SHALL FURNISH THE OWNER WITH CERTIFICATES OF FINAL INSPECTIONS AND APPROVALS.
- PIPING SHALL BE AS FOLLOWS:
 - GAS PIPING:**
 - GAS PIPING SHALL BE SCHEDULE 40, BLACK STEEL WITH THREADED OR WELDED FITTINGS AS REQUIRED. PROVIDE SHUT-OFF COCKS ON ALL OUTLETS WHERE SHOWN.
 - VALVES SHALL NOT BE LOCATED IN ANY AIR PLENUM. PORTIONS OF A GAS PIPING SYSTEM INSTALLED IN CONCEALED LOCATIONS SHALL NOT HAVE UNIONS, TUBE FITTINGS, OR RUNNING THREADS.
 - PAINT ALL NATURAL GAS PIPING ON ROOF YELLOW. PAINT ALL VERTICAL PIPING ON EXTERIOR WALL TO MATCH BUILDING COLOR.
 - VALVES:**
 - GAS VALVE SHALL BE LUBRICATED TYPE CAST IRON OR U.L. LISTED TWO PIECE BRONZE BALL VALVE WITH RPTFE SEALS AND SEAT.
- PIPING SHALL BE SUPPORTED FROM HANGERS AT AN ADEQUATE DISTANCE WITH SUPPORTING HANGER RODS FASTENED TO THE BUILDING FRAMING WHENEVER POSSIBLE.
- ISOLATE PIPING AND EQUIPMENT FROM THE BUILDING STRUCTURE WITH INSULATING HANGERS AND FITTINGS AS REQUIRED TO PREVENT GALVANIC CORROSION OF THE BUILDING PIPING SYSTEMS.
- ALL SERVICES SHALL BE PROPERLY SLEEVED WHEN ROUTED THROUGH FLOORS AND WALLS. CONTRACTOR TO PROVIDE FIRE RESISTANT ROPE PACKING FOR ALL PIPES PENETRATING FIRE RATED WALLS. CONTRACTOR SHALL OBTAIN A COPY OF THE ARCHITECTURAL DRAWINGS TO IDENTIFY FIRE RATED WALLS.
- THE PIPING CONTRACTOR SHALL VERIFY EXACT LOCATIONS AND PROVIDE ROUTINGS FOR ALL EQUIPMENT FURNISHED BY OTHER CONTRACTORS. IF ALL EQUIPMENT HAS BEEN INSTALLED BY OTHER CONTRACTORS, THE PIPING CONTRACTOR SHALL MAKE ALL FINAL CONNECTIONS AND SHALL INCLUDE IN HIS BASE SHALL INCLUDE ALL VALVE UNIONS, SPLININGS, ETC. THAT ARE REQUIRED TO MAKE FINAL CONNECTIONS.
- THE PIPING CONTRACTOR SHALL OBTAIN OTHER TRADES DRAWINGS AND COORDINATE HIS WORK WITH THE TOTAL PROJECT AS IT RELATES TO ALL TRADES AND VISIT THE PROJECT SITE PRIOR TO SUBMITTING HIS BID TO FAMILIARIZE HIMSELF WITH THE ACTUAL PROJECT CONDITIONS AND TO CHECK FOR ANY INTERFERENCES BETWEEN HIS SCOPE OF WORK AND THAT OF THE OTHER TRADES, AND/OR ANY APPARENT VIOLATIONS OF LOCAL OR STATE BUILDING CODES, LAWS, ORDINANCES AND REGULATIONS. SHOULD ANY INTERFERENCES OR VIOLATIONS APPEAR AND DEPARTURE FROM THE INITIAL DESIGN INTENT OF THE CONSTRUCTION BID DOCUMENTS IS REQUIRED, THE CONTRACTOR SHALL NOTIFY THE ARCHITECT PRIOR TO ENTERING INTO A CONTRACT WITH THE OWNER. FAILURE TO PROVIDE THE ARCHITECT WITH THE FOREMENTIONED NOTIFICATION SHALL RESULT IN THE CONTRACTOR BEING HELD RESPONSIBLE TO COMPLETE ALL WORK TO MEET THE INTENT OF THE CONSTRUCTION BID DOCUMENTS WITH NO ADDITIONAL COSTS BEING INCURRED BY THE OWNER.
- THE CONTRACTOR SHALL SUBMIT EQUIPMENT SHOP DRAWINGS TO THE ARCHITECT FOR REVIEW PRIOR TO INSTALLATION OF ANY OF THE FOLLOWING EQUIPMENT:
 - GAS PIPING AND FITTINGS**
 THE CONTRACTOR SHALL GUARANTEE ALL WORK INSTALLED UNDER THIS CONTRACT TO BE FREE FROM DEFECTIVE WORKMANSHIP AND MATERIALS FOR A PERIOD OF ONE YEAR AFTER THE ACCEPTANCE OF THE BUILDING BY THE OWNER, AND SHOULD DEFECTS OCCUR WITHIN THIS PERIOD, REPAIR AND/OR REPLACE DEFECTIVE ITEMS AND ANY DAMAGE RESULTING FROM FAILURE OF THESE ITEMS, AT NO EXPENSE TO THE OWNER.
- PROVIDE PRE-MANUFACTURED SUPPORTS EQUAL TO MIRO INDUSTRIES 3-R, SPACED 10'-0" ON CENTER AND AT ALL FITTINGS FOR SUPPORT OF ALL GAS PIPING RUN ON ROOF. FASTEN GAS PIPING SECURELY TO EACH SUPPORT AND PROVIDE SPACERS AS REQUIRED TO ADJUST FOR ROOF SLOPE WITHOUT STRESSING THE PIPING.

- THE CONTRACTOR SHALL COORDINATE LOCATIONS OF HIS EQUIPMENT AND WORK WITH OTHER BUILDING TRADES TO AVOID ANY INTERFERENCES BETWEEN HIS WORK AND THE WORK OF OTHER TRADES.
- ANY CUTTING AND/OR PATCHING, THAT MAY BE REQUIRED FOR THE INSTALLATION OF THE PIPING SYSTEMS, SHALL BE PERFORMED BY THE ARCHITECTURAL TRADES AND PAID FOR BY THIS CONTRACTOR. NO CUTTING OF THE BUILDING STRUCTURAL SYSTEM SHALL BE PERFORMED WITHOUT WRITTEN APPROVAL OF THE ARCHITECT BEING OBTAINED.
- A SEPARATE REFRIGERATION CONTRACTOR SHALL INSTALL COOLER AND FREEZER REFRIGERATION SYSTEMS, COMPRESSORS, COILS, CONTROLS, AIR COOLED CONDENSING UNITS, AND VALVES SHALL BE FURNISHED BY THE REFRIGERATION EQUIPMENT SUPPLIER. THIS CONTRACTOR SHALL INCLUDE PROVIDING REFRIGERATION LINES, NECESSARY FITTINGS, CHARGING SYSTEM WITH REFRIGERANT, INSULATION, AND CONNECTIONS TO COMPRESSORS AND COILS.
- THE CONTRACTOR SHALL COORDINATE HIS ROUGH-IN WORK WITH THE DIMENSIONED DRAWINGS FURNISHED BY THE FOOD SERVICE EQUIPMENT CONTRACTOR.

HVAC SYSTEM SPECIFICATIONS:

- SHEET METAL DUCTWORK CONSTRUCTION SHALL BE IN ACCORDANCE WITH THE LATEST EDITION OF "SMACNA" STANDARDS, NFPA 90A AND 96, AND THE LATEST EDITION OF THE ASHRAE GUIDE AND DATA BOOKS. ALL DUCTWORK SIZES INDICATED ON THE PLANS ARE THE INTERNAL DIMENSIONS AND DUCTWORK SIZES SHALL BE INCREASED ACCORDING SHOULD DUCTWORK BE INTERNALLY LINED WITH INSULATION. ALL DUCTWORK SHALL BE SEALED AIR TIGHT AND SHALL NOT ALLOW MORE THAN 10% AIR LEAKAGE THROUGHOUT THE ENTIRE SYSTEM.
- PROVIDE VOLUME DAMPERS IN THE DUCT SYSTEMS WHERE SHOWN ON PLANS AND WHERE REQUIRED TO INSURE PROPER SYSTEM BALANCING. SPIN-IN FITTINGS WITH MANUAL VOLUME DAMPERS MAY BE USED.
- PROVIDE FLEXIBLE DUCT CONNECTORS ON ALL DUCT CONNECTIONS TO AIR HANDLING EQUIPMENT.
- THE CONTRACTOR SHALL SUBMIT TO THE ARCHITECT A COMPLETE AIR BALANCE REPORT OF ALL AIR HANDLING SYSTEMS. THE REPORT SHALL INCLUDE FAN RPM, TOTAL STATIC PRESSURE, MOTOR RATED CAPACITY, MOTOR OPERATING CAPACITY, ENTERING AND DISCHARGE AIR TEMPERATURES, AIR QUANTITIES AT ALL DIFFUSERS AND GRILLES, A DIAGRAM OF THE AIR HANDLING SYSTEM INSTALLED, AND RECOMMENDATIONS TO CORRECT ANY DEFICIENCIES. THE AIR BALANCE REPORT SHALL BE PERFORMED BY AN INDEPENDENT N.E.B.B. CERTIFIED AIR BALANCE CONTRACTOR.
- DUCTWORK INSULATION:
 - ALL CONCEALED SUPPLY AIR DUCTWORK INSIDE OF THE BUILDING SHALL BE INSULATED WITH DUCT WRAP OF 1" MINIMUM THICKNESS AND 1-1/2# DENSITY, WITH VAPOR BARRIER JOINTS SHALL BE STAPLED AND TAPED.
 - DUCTWORK INSULATION SHALL HAVE A FLAME SPREAD/SMOKE DENSITY RATING NOT EXCEEDING 25/50 PER NFPA PAMPHLET 90A.
- VIBRATION ABSORBING SUPPORTS SHALL BE INSTALLED ON ALL EQUIPMENT TO PREVENT TRANSMISSION OF VIBRATION AND NOISE TO THE STRUCTURE. PROVIDE VIBRATION ISOLATION PER ASHRAE STANDARDS.
- ALL MECHANICAL EQUIPMENT LOCATED ON THE ROOF SHALL BE PROPERLY SUPPORTED WITH PRE-FABRICATED CURBS, EQUIPMENT RAILS, OR OTHER MEANS AS APPROVED BY THE ARCHITECT.
- SMOKE DETECTORS AND/OR HEAT DETECTORS (SYSTEMS 2000 CFM AND OVER):
 - WHERE REQUIRED BY LOCAL CODE, FURNISH AND INSTALL IN THE MAIN RETURN AIR DUCT OF EACH AIR HANDLING UNIT, A SELF-CONTAINED, IONIZATION TYPE DUCT SMOKE DETECTOR DESIGNED TO MOUNT TO A DUCT USING SAMPLING TUBES. TO PASS THE DUCT TO SENSE THE AIR. UNIT SHALL BE MANUALLY RESET AND SHALL HAVE A SET OF CONTACTS FOR FAN SHUT DOWN AS WELL AS FOR REMOTE ALARM. SMOKE DETECTORS SHALL BE IN ACCORDANCE WITH THE LATEST EDITION OF NFPA 72 AND THE INTERNATIONAL MECHANICAL CODE.
 - SMOKE DETECTORS SHALL BE NATIONAL TIME & SIGNAL MODEL #3000 AND HAVE WITH SAMPLING TUBES AND AUXILIARY CONTACTS FOR FAN SHUT-DOWN. SMOKE DETECTORS SHALL BE SUPERVISORY TYPE AND CONNECTED TO THE BUILDING FIRE ALARM SYSTEM. IF ONE IS IN PLACE, IF NOT, THE DETECTOR SHALL BE PROVIDED WITH A VISIBLE AND AUDIBLE ENUNCIATOR LOCATED IN A CONSPICUOUSLY ATTENDED LOCATION. ACCESS SHALL BE PROVIDED TO SMOKE DETECTORS FOR INSPECTION AND MAINTENANCE.
- HEATING, VENTILATING, AND AIR CONDITIONING SYSTEMS ARE DESIGNED ON THE FOLLOWING CONDITIONS: (ATLANTA HARTSFIELD INTERNATIONAL AIRPORT)

WINTER: INSIDE TEMP. 69°F
OUTSIDE TEMP. 17°F

SUMMER: INSIDE TEMP. 76°F D.B. & 65°F R.H.
OUTSIDE TEMP. 93.8°F D.B. & 74.3°F W.B.
- SHEET METAL RUN OUTS AND FLEX DUCT CONNECTIONS TO AIR DISTRIBUTION DEVICES SHALL BE THE SAME SIZE AS THE DEVICE NECK, UNLESS OTHERWISE NOTED.
- DUCT CONNECTING TO HVAC EQUIPMENT SHALL BE THE SAME SIZE AS EQUIPMENT DUCT CONNECTION, UNLESS OTHERWISE NOTED.
- AIR DISTRIBUTION DEVICE LOCATIONS INDICATED ON THE PLANS ARE APPROXIMATE. THE CONTRACTOR SHALL VERIFY EXACT LOCATIONS OF ALL AIR DISTRIBUTION DEVICES WITH ARCHITECTURAL PLANS AND/OR ELECTRICAL PLANS PRIOR TO INSTALLATION. LIGHT FIXTURES AND SPRINKLER HEAD LOCATIONS SHALL TAKE PRECEDENCE OVER AIR DISTRIBUTION DEVICES, UNLESS OTHERWISE NOTED.
- THE CONTRACTOR SHALL SUBMIT EQUIPMENT SHOP DRAWINGS TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION OF ANY OF THE FOLLOWING:
 - PACKAGED GAS/ELECTRIC ROOFTOP UNITS
 - DUCTLESS SPLIT UNIT & ASSOCIATED HEAT PUMP
 - EXHAUST FANS
 - DUCTWORK & ACCESSORIES
 - AIR DISTRIBUTION DEVICES
 - GAS FIRED UNIT HEATER
 - DOOR AIR CURTAINS


APPROVAL OF SHOP DRAWINGS DOES NOT RELIEVE THE CONTRACTOR OF HIS RESPONSIBILITY TO CONFORM TO THE DESIGN INTENT OF THE BID DOCUMENTS.

APPROVAL OF SHOP DRAWINGS IS INTENDED TO BE FOR GENERAL CONFORMANCE WITH THE CONSTRUCTION DOCUMENTS ONLY. ANY EQUIPMENT THAT IS INSTALLED THAT WILL INVOLVE THE WORK OF OTHER TRADES SHALL BE COORDINATED WITH THOSE TRADES. REFER TO OTHER TRADES' BID DOCUMENTS.
- THE MECHANICAL CONTRACTOR SHALL BE RESPONSIBLE FOR ALL CONTROL AND INTERLOCK WIRING UNLESS OTHERWISE NOTED ON THE DRAWINGS. MECHANICAL CONTRACTOR SHALL PAY AND COORDINATE WITH THE ELECTRICAL CONTRACTOR ALL HIGH VOLTAGE WIRING THAT IS REQUIRED FOR INTERLOCKING OF CONTROLS.
- CONTRACTOR SHALL PROVIDE BUILDING OWNER WITH OPERATING AND MAINTENANCE MANUALS FOR ALL H.V.A.C. EQUIPMENT UPON COMPLETION OF PROJECT.
- MECHANICAL CONTRACTOR SHALL TEST ALL CONTROL ELEMENTS, VERIFY CALIBRATION OF ALL CONTROL DEVICES AND MAKE ADJUSTMENTS AS REQUIRED AT COMPLETION OF PROJECT.

HVAC GENERAL NOTES:


- COORDINATE NEW DUCTWORK WITH BUILDING STRUCTURAL CONDITIONS, EQUIPMENT MANUFACTURER RECOMMENDATIONS AND ALL OTHER TRADES TO AVOID INTERFERENCES.
- PROVIDE ACCESS AROUND ALL NEW EQUIPMENT PER MANUFACTURERS RECOMMENDATIONS.
- ALL MECHANICAL RELATED CORING THROUGH WALLS AND FLOORS SHALL BE BY MECHANICAL CONTRACTOR. SEAL ALL PENETRATIONS THROUGH RATED WALLS AND FLOORS WITH U.L. RATED CAULK SEALANT IN ACCORDANCE WITH THE SPECIFICATION REQUIREMENTS.
- ALL DUCTWORK SHALL BE ROUTED AS HIGH AS POSSIBLE IN EXPOSED CEILING AREAS OR AT ELEVATIONS LISTED ON DRAWINGS.
- COORDINATE ALL DUCTWORK ROUTING WITH ARCHITECTURAL AND STRUCTURAL TRADES TO AVOID INTERFERENCES.
- ALL NEW DUCT SIZES TO DIFFUSERS SHALL MATCH NECK SIZE OF DIFFUSER, REGISTER OR GRILLE.
- COORDINATE EXACT LOCATIONS OF DIFFUSERS AND RETURN AIR GRILLES WITH ARCHITECTURAL AND ELECTRICAL REFLECTED CEILING PLANS AND ARCHITECTURAL INTERIOR ELEVATIONS AND SECTIONS.
- COORDINATE ALL T-STAT AND REMOTE SENSOR HEIGHTS ABOVE FINISHED FLOOR WITH ARCHITECTURAL TRADES.
- BALANCE ALL AIR SYSTEMS TO VALUES INDICATED ON DRAWINGS.
- ALL FLEXIBLE DUCTWORK SHALL BE LIMITED TO 5'-0" MAXIMUM LENGTH FROM HARD DUCT CONNECTION TO ROUND NECK SUPPLY AIR DIFFUSERS. FLEX DUCT APPROVED ABOVE ACCESSIBLE CEILING AND ON SUPPLY AIR DUCT ONLY.

HVAC SYMBOLS

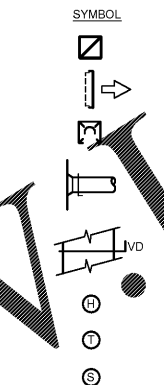


ABBREVIATIONS

A.F.F.	ABOVE FINISHED FLOOR
A.C.U.	ACOUSTIC DUCT LINER
B.O.D.	BOTTOM OF DUCT
CD-#	CEILING DIFFUSER
CFM	CUBIC FEET PER MINUTE
CL	CENTERLINE
CLG	CEILING
D.B.	DRY BULB TEMPERATURE
DIA / Ø	DIAMETER
DS-#	DUCTLESS SPLIT HEAT PUMP
(E)	EXISTING
E.A.	EXHAUST AIR
EF-#	EXHAUST FAN
EG-#	EXHAUST GRILLE
ERH-#	ELECTRIC RADIANT HEATER
EXH.	EXHAUST
EUH-#	ELECTRIC UNIT HEATER
F-DMPR	FIRE DAMPER
HP-#	HEAT PUMP
ID	INSIDE DIAMETER
N.T.S.	NOT TO SCALE
O.A.	OUTSIDE AIR
O.E.D.	OPEN ENDED DUCT
RA	RETURN AIR
RG-#	RETURN AIR GRILLE
R.H.	RELATIVE HUMIDITY
RPM	REVOLUTIONS PER MINUTE
RTU-#	ROOFTOP UNIT
SG-#	SUPPLY AIR GRILLE
S.A.	SUPPLY AIR
T.A.D.	TRANSFER AIR DUCT
TAG-#	TRANSFER AIR GRILLE
(TYP)	TYPICAL
VD	VOLUME DAMPER
W.B.	WET BULB TEMPERATURE

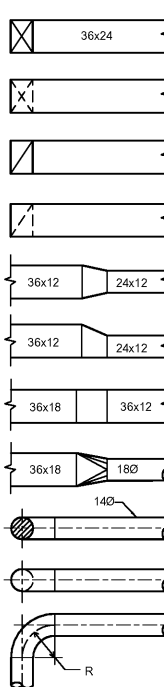

ORIGINALS @ WWW.WORLDLINE.COM



PARTNERS in Architecture, PLC
 65 MARKET STREET
 MOUNT CLEMENS, MI 48043
 P 586.469.3000
 F 586.469.3057


Statement of Intellectual Property
 The ideas, concepts, drawings and thoughts conveyed herein are the intellectual property of PARTNERS in Architecture, P.C., 65 Market Street, Mount Clemens, MI 48043 (P 586.469.3000). This set of drawings, in whole or in part, may not be reproduced, without the written consent of PARTNERS in Architecture, P.C. This information is protected under U.S. Copyright Law, all rights reserved.

© Copyright 2016

CONSULTANT



KEY PLAN



OWNER

Suwanee Grocery, LLC

8110 N. Saint Louis Avenue
 Skokie, IL 60076

PROJECT NAME

**Suwanee Grocery, LLC
 Building-B Build-Out**

3230 Caliber Street
 Suwanee, GA 30024

PROJECT NO.

16-177

ISSUES / REVISIONS

Bidding - Construction 04/30/18

DRAWN BY

WV

CHECKED BY

WV

APPROVED BY

JB

SHEET NAME

**HVAC - NOTES,
 SYMBOLS &
 ABBREVIATIONS**

SHEET NO.

M0-01