




CHAD E. GILLIAM
REGISTERED PROFESSIONAL ENGINEER
STATE OF GEORGIA
LICENSE NO. 10088
6817 ZANARDO ARCHITECTS

ISSUE RECORD
NO. DATE REVISION

DRAWING REVISION
NO. DATE REVISION

CREEKSIDE RETAIL
1211 FRIENDSHIP RD.
BRABELTON, GA


ZANARDO ARCHITECTS, P.C.
3675 CRESTWOOD PARKWAY
SUITE 520
DULUTH, GA 30096-1035



date 01/28/18
drawn STS
checked TG
proj# 1806

FOUNDATION PLAN

S1.1

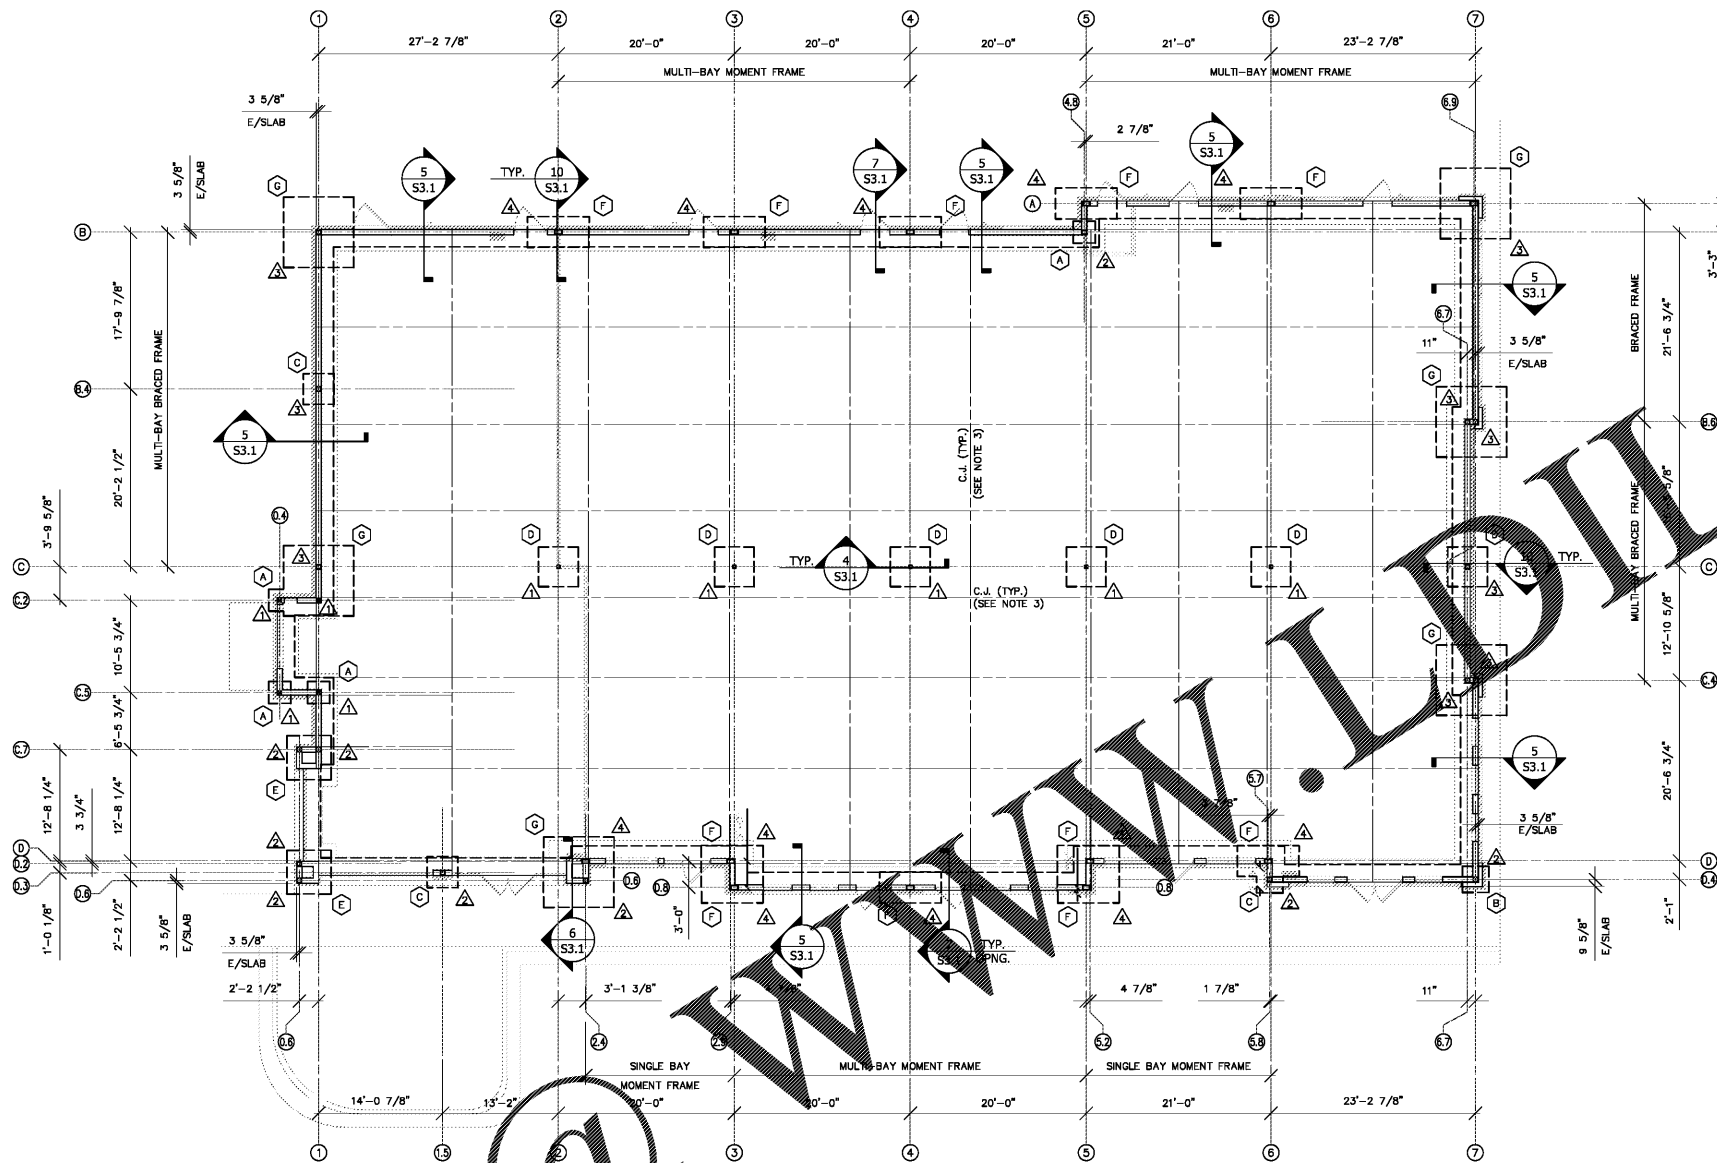

FOUNDATION PLAN

SCALE: 1/8" = 1'-0"

PLAN NOTES:

1. REFERENCE FINISHED FLOOR ELEVATION = 0'-0". TOP OF CONCRETE SHALL BE COORDINATED TO PROVIDE FINISHED FLOORS AS SHOWN ON THE ARCHITECTURAL DRAWINGS.
2. ALL GROUND FLOORS SHALL BE AS NOTED ON PLAN. SEE S3.1, GENERAL NOTES, AND SPECIFICATIONS FOR REINFORCEMENT AND ADDITIONAL INFORMATION. SEE CIVIL AND ARCHITECTURAL DRAWINGS FOR EXTERIOR PAVING AREAS.
3. C.J. INDICATES CONTROL JOINT. PROVIDE AT RE-ENTRANT CORNERS & AT 15'-0" MAX. IN BOTH DIRECTIONS.
4. T/FTG INDICATES TOP OF FOOTING ELEVATION RELATIVE TO REFERENCE FINISHED FLOOR ELEVATION = 0'-0".
EXTERIOR T/FTG. = (-) 1'-8", U.N.O.
INTERIOR T/FTG. = (-) 0'-8", U.N.O.
5. EDGE OF SLAB SHALL BE LOCATED 3 5/8" FROM OUTERMOST WOOD STUD WALL THAT PARALLELS THE SLAB, U.N.O.
6. Δ INDICATES FOOTING MARK. SEE FOOTING SCHEDULE FOR SIZE AND REINFORCEMENT.
7. \triangle INDICATES COLUMN MARK. SEE COLUMN SCHEDULE FOR SIZE.

FOOTING SCHEDULE

MARK	FOOTING SIZE	THICKNESS	REINFORCEMENT	TOP BARS BOT. BARS
A	2'-6"x2'-6"	16"	NOT REQUIRED	#5 @ 10" E.W.
B	3'-0"x3'-0"	16"	NOT REQUIRED	#5 @ 10" E.W.
C	3'-6"x3'-6"	16"	NOT REQUIRED	#5 @ 10" E.W.
D	4'-6"x4'-6"	16"	NOT REQUIRED	#5 @ 10" E.W.
E	5'-0"x5'-0"	16"	NOT REQUIRED	#5 @ 10" E.W.
F	7'-0"x3'-6"	24"	(5)-#6 TRANS./ (9)-#6 LONG.	#5 @ 10" E.W.
G	8'-0"x8'-0"	24"	NOT REQUIRED	#5 @ 10" E.W.

- NOTES:
1. WHERE FOOTINGS OVERLAP, COMBINE FOOTINGS AND PLACE MONOLITHICALLY. FOOTINGS SHALL BE LOCATED AS THEY NORMALLY WOULD (CENTERED ON THEIR OWN INDIVIDUAL COLUMNS) AND COMBINED WHERE THEY OVERLAP. EXTEND REINFORCEMENT TO REMAIN CONTINUOUS THROUGH COMBINED FOOTING.

COLUMN SCHEDULE

MARK	COLUMN SIZE	BASE PLATE	ANCHOR BOLTS
Δ	HSS4x4x1/4	3/4"x10"x0'-10"	(4)-3/4" BOLTS
\triangle	HSS6x6x1/4	3/4"x12"x1'-0"	(4)-3/4" BOLTS
\triangle	HSS6x6x1/4	1"x12"x1'-0"	(4)-1" BOLTS
\triangle	HSS10x6x3/8	1 1/4"x12"x1'-4"	(4)-1" BOLTS

- * ALL COLUMN BASE PLATES SHALL BE PLACED ON 1 1/2" NON-SHRINK GROUT
- COLUMN MARKS 3 & 4 SHALL OCCUR AT BRACED AND MOMENT FRAMES, SEE PLAN.

Order Plans @ www.LDOnline.com



GW Design Group, LLC
(770) 457-0065