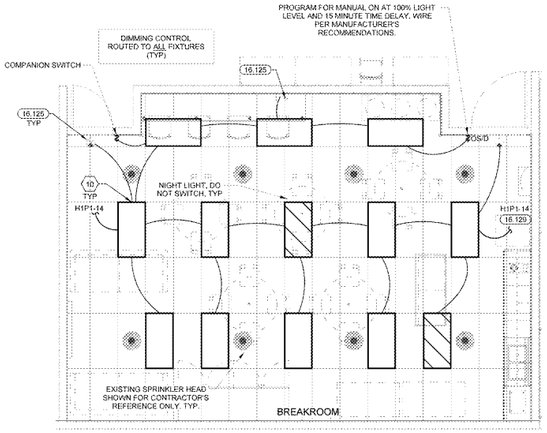

CONTRACTOR IS RESPONSIBLE FOR THE COMPLETE INSTALLATION OF THE LIGHTING SYSTEM AS INDICATED ON PLANS AND/OR AS MODIFIED TO ACCOMMODATE EXISTING OBSTRUCTIONS. IDENTIFY CONFLICTS PRIOR TO ROUGH-IN. WHERE CONFLICTS WITH EXISTING UTILITIES OCCUR ADJUST FIXTURE LOCATION AS REQUIRED. FIXTURES SHALL BE INSTALLED AS NEAR AS POSSIBLE TO LOCATIONS INDICATED ON PLANS WITH EVEN SPACING MAINTAINED.

6 BREAKROOM LIGHTING PLAN
1/4" = 1'-0"

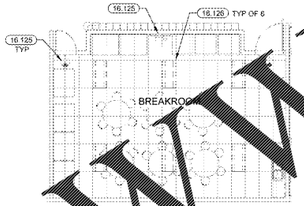

5 BREAKROOM LIGHTING DEMO PLAN
1/8" = 1'-0"

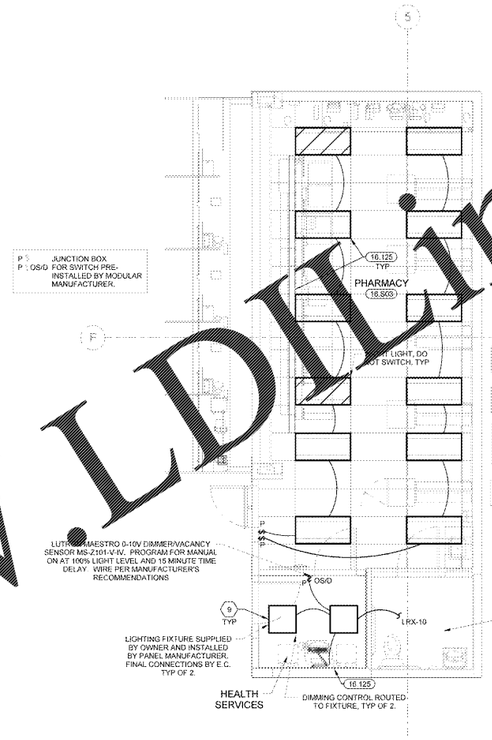

4 PHARMACY LIGHTING PLAN
1/4" = 1'-0"

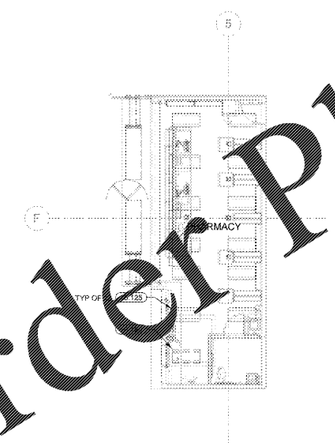

3 PHARMACY LIGHTING DEMO PLAN
1/8" = 1'-0"

OCCUPANCY SENSORS IN RESTROOMS SHALL BE PROGRAMMED FOR MAXIMUM TIME DELAY, TYP.

COORDINATE RESTROOM LIGHT FIXTURE LOCATIONS WITH CEILING STRUCTURE, DUCT WORK DIFFUSERS, SPRINKLERS AND GC. LIGHTING LAYOUT ADJUSTMENTS SHALL BE KEPT TO A MINIMUM. MAINTAIN LAYOUT AS CLOSLEY AS POSSIBLE.

PROVIDE STAINLESS STEEL COVER PLATES TYP IN RESTROOMS

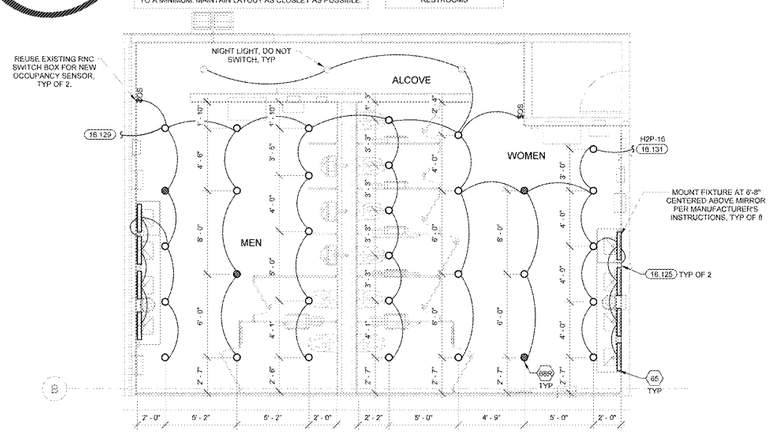

2 FRONT RESTROOM LIGHTING PLAN
1/4" = 1'-0"

REMOVE RESTROOM NEEDS CLEANING LIGHT SWITCHES TYPICAL AT RESTROOMS. PROVIDE STAINLESS STEEL BLANK COVER PLATE WITH TAMPER RESISTANT SCREWS AT OUTLETS. REMOVE RESTROOM NEEDS CLEANING SIGN FROM COURTESY DESK/CUSTOMER SERVICE/SITE TO STORE AREA(S). COORDINATE CEILING TILE REPLACEMENT WITH GC. IF WALL MOUNTED FIXTURE, PROVIDE COVER PLATE TO MATCH EXISTING ELECTRICAL DEVICES.

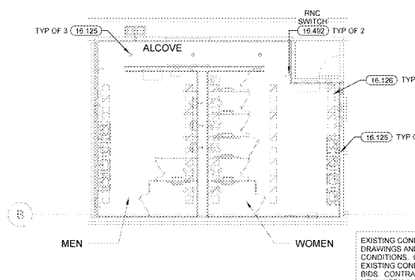

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELVES WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.

1 FRONT RESTROOM LIGHTING DEMO PLAN
1/8" = 1'-0"

KEYNOTES

16.125	EXISTING FIXTURES TO REMAIN UNLESS OTHERWISE NOTED.
16.126	EXISTING LIGHT FIXTURES TO BE DEMOLISHED.
16.129	CONNECT TO EXISTING CIRCUIT PREVIOUSLY SERVING AREA LIGHTING THAT WAS REMOVED. MAINTAIN EXISTING CIRCUIT CONTROL UNLESS NOTED OTHERWISE. PROVIDE CONSTANT HOT FOR EMERGENCY, EXIT, AND LOCALLY CONTROLLED LIGHT FIXTURES.
16.131	CONNECT TO EXISTING CIRCUIT. EC SHALL VERIFY PRIOR TO ROUGH-IN THAT EXISTING CIRCUIT HAS SPARE CAPACITY TO ACCOMMODATE ADDITIONAL LOAD.
16.402	EC SHALL COORDINATE WITH GENERAL CONTRACTOR AND ARCHITECTURAL DEMOLITION PLANS THE EXTENT OF ELECTRICAL DEMOLITION. REMOVE CONDUITS AND WIRING ALL THE WAY BACK TO ORIGINATING JUNCTION BOXES OR PANELBOARDS. DEMOLITION SHALL NOT AFFECT ACTIVE CIRCUITS. LOCATE DEMOLISHED CIRCUIT(S) IN PANELBOARD(S) AS "SPARE". COORDINATE EXACT REQUIREMENTS WITH EXISTING CONDITIONS PRIOR TO BID.
16.S03	REPLACE ALL LENS WITH NEW PRISMATIC ACRYLIC LENS IN ALL LAY-IN LIGHT FIXTURES IN THIS AREA.

RETAIL DESIGN COLLABORATIVE

Robert Dorn, LEED AP
(630) 530-7030
rdcollaborative.com

STIPULATION FOR REUSE

THIS DRAWING AND SPECIFICATION, AS AN INSTRUMENT OF SERVICE, IS AND SHALL REMAIN THE PROPERTY OF RDC; WHETHER THE PROJECT FOR WHICH IT IS PREPARED IS EXECUTED OR NOT. THE USE OF THIS DRAWING AND SPECIFICATION ON ANY OTHER PROJECT IS PROHIBITED EXCEPT BY AGREEMENT WITH RDC. VISUAL CONTACT WITH THESE DRAWINGS AND SPECIFICATIONS SHALL CONSTITUTE PRIMA FACIE EVIDENCE OF ACCEPTANCE OF THESE RESTRICTIONS. ALL REPRODUCTIONS SHALL BEAR THE NOTICE "NOT FOR CONSTRUCTION".

CONSULTANTS

Jason C. Adams P.E.
SUITE 8308 PH.678.999.3084 MOB.321.677.7772
3000 ATRIUM WAY JASON@JCADAMSPE.COM
ROGERS, AR 72756 DESIGNED BY: JC

Walmart

GORDONSVILLE, VA
164 CAMP CREEK PKWY, GORDONSVILLE, VA 22942
STORE # 4-1402-23 PROTO: 143 SGR-OR
17-127.25

Remodel Proto

JOB NUMBER:

ISSUE BLOCK

CHECKED BY:	SMD
DRAWN BY:	JRL
PROTO CYCLE:	02/23/18
DOCUMENT DATE:	041018
BG PROJECT NO:	19532

This document originally issued and sealed by Jason Christopher Adams, P.E. 0052432 on 04/09/2018. This document should not be considered a certified document.

NOT FOR CONSTRUCTION

ENLARGED LIGHTING PLANS

SHEET

E1.1

Order Plans @ WWW.LDIline.com