



Order Plans

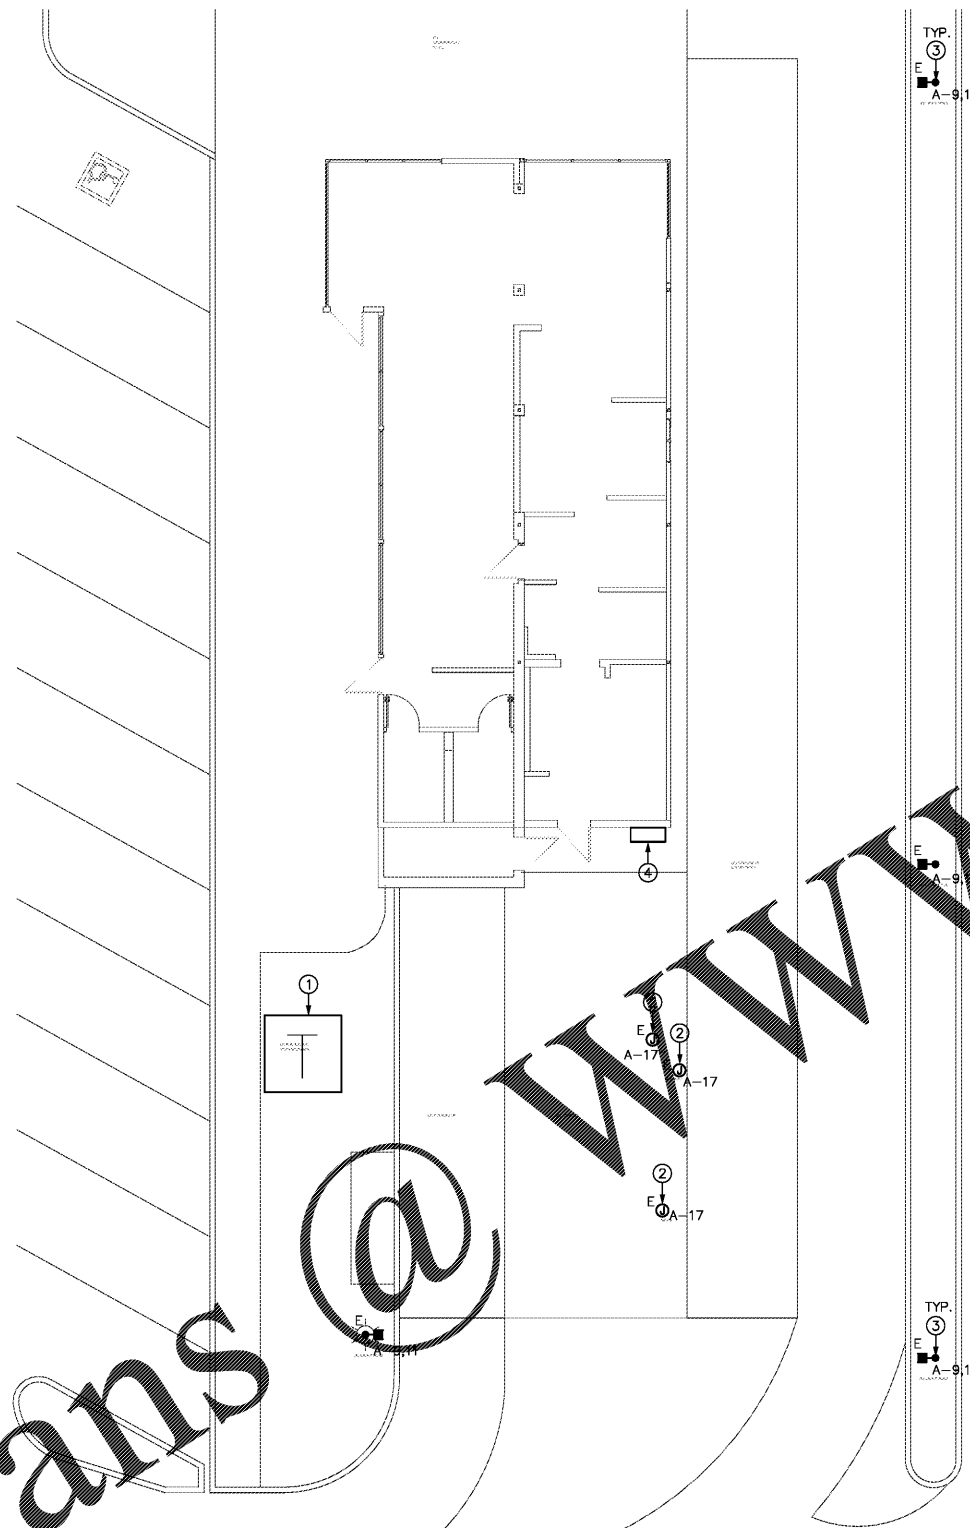

1 BUILDING SITE PLAN
SCALE: 1/8"=1'-0"

- GENERAL NOTES**
- ALL EXTERIOR LIGHT FIXTURES TO COMPLY WITH LOCAL NIGHT SKY ORDINANCE.
 - ALL EXTERIOR LIGHTING AND SIGNAGE TO BE FED WITH #10 CU. U.N.O.
 - ALL EXTERIOR ELECTRICAL EQUIPMENT TO BE NEMA-3R RATED.
 - CONTRACTOR TO COORDINATE EXACT SITE LIGHTING FIXTURE LOCATIONS WITH LANDSCAPE DRAWINGS.
 - ALL FIXTURES INSTALLED OUTDOORS SHALL BE RATED FOR DAMP/WET LOCATIONS AS REQUIRED. THE CONTRACTOR SHALL COORDINATE DAMP/WET LOCATION RATING PER NEC ARTICLE 410-4. ALL INSTALLATIONS SHALL CONFORM TO NEC ARTICLE 410, ALL SUB ARTICLES.
 - FIRE ALARM EQUIPMENT SHALL BE COORDINATED FOR EXACT LOCATION AND REQUIREMENTS WITH FIRE MARSHALL.
 - ALL PVC CONDUIT MUST HAVE A MINIMUM OF #12 CU. GROUND CONDUCTOR.
 - CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATION AND SCHEDULING WITH POWER AND TELEPHONE UTILITY COMPANIES INCLUDING PROVIDING (2) COMPLETE SETS OF DRAWINGS TO EACH COMPANY. ALL WORK SHALL BE INSTALLED PER EACH UTILITY COMPANIES' FINAL DRAWINGS.
 - ELECTRICAL CONTRACTOR SHALL COORDINATE EXACT LOCATIONS AND MOUNTING HEIGHTS OF ALL EXTERIOR LIGHT FIXTURES WITH ARCHITECTURAL DRAWINGS.
- KEYED NOTES**
- EXISTING PAD MOUNTED POWER COMPANY TRANSFORMER MAINTAIN 10'-0" FRONT CLEARANCE, 3'-0" SIDES AND REAR CLEARANCE.
 - EXISTING LIVE-THRU MENSUREDS/SWITCHERS TO REMAIN ON EXISTING CIRCUIT BREAKER.
 - EXISTING PANE LIGHTING TO REMAIN ON EXISTING CIRCUIT BREAKER. (TYPICAL)
 - EXISTING SERVICE ENTRANCE SECTION TO REMAIN. ELECTRICAL CONTRACTOR SHALL VERIFY THE FOLLOWING PRIOR TO ROUGH-IN/INSTALLATION:
 - SERVICE ENTRANCE SECTION SIZE
 - SERVICE ENTRANCE SECTION CONFIGURATION
 - SERVICE ENTRANCE SECTION RATING (VOLTAGE, PHASE, AMPERAGE)
 - GROUNDING

FIXTURE/ITEM IDENTIFIED WITH LETTER:
 'E' - INDICATES EXISTING TO REMAIN.
 'N' - INDICATES NEW TO MATCH EXISTING.
 'R' - INDICATES EXISTING TO BE RELOCATED.
 'X' - INDICATES EXISTING TO BE REMOVED.

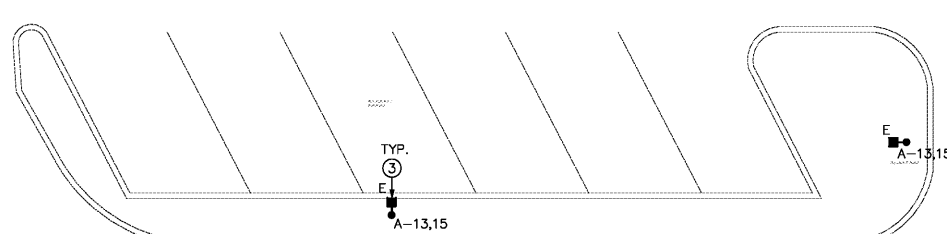

RUN RUN DESIGN

www.runrun.com

PROJECT NAME AND LOCATION :



STORE #785
 975 W. POPLAR AVENUE
 COLLIERVILLE, TN 38017

THIS DRAWING AND ITS CONTENTS ARE CONSIDERED INSTRUMENTS OF SERVICE AS SUCH THEY ARE COPYRIGHTED PROPERTY OF RUN RUN DESIGN, LLC. THE USE OF THESE DRAWINGS ARE LIMITED TO THIS SPECIFIC PROJECT AND ARE NOT TO BE OTHERWISE REPRODUCED IN ANY WAY OR USED FOR SUPPLEMENTAL LOCATIONS WITHOUT WRITTEN PERMISSION FROM RUN RUN DESIGN, LLC.

DRAWING REVISIONS:

no.	distribution	date
A	ISSUE DATE	12.21.17
B	SUBMITTAL DATE	--
no.	revision	date
1	--	--
2	--	--
3	--	--

SHEET NAME:
BUILDING SITE PLAN

Electrical Engineer
 Omid Ardebili P.E.
 8100 East Indian School Road Suite 203
 T 480.361.6269 C 480.626.1838
 Proj. Mgr: TME Proj. No.: 18111



project no: 17-085
 dwg no: **E0.1**