

TYPICAL CHANGE IN LEVEL



MINIMUM CLEAR WHEELCHAIR SPACE

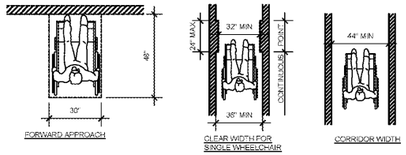



FRONT APPROACH

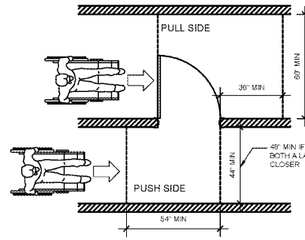

HINGE APPROACH

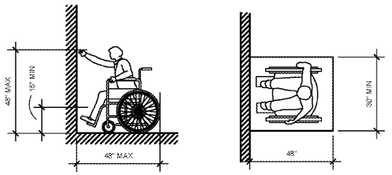



SHELVES

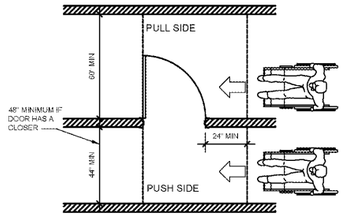

LATCH APPROACH



DOOR CONSTRUCTION





NOTE:
X SHALL BE LESS THAN OR EQUAL TO 25 INCHES.
Z SHALL BE GREATER THAN OR EQUAL TO X WHEN X IS LESS THAN 20 INCHES, THEN Y SHALL BE 48 INCHES MAXIMUM.
WHEN X IS 20 TO 25 INCHES, THEN Y SHALL BE 44 INCHES MAXIMUM.

FORWARD REACH

SIDE REACH



HIGH AND LOW SIDE REACH LIMITS



MAXIMUM SIDE REACH OVER OBSTRUCTION

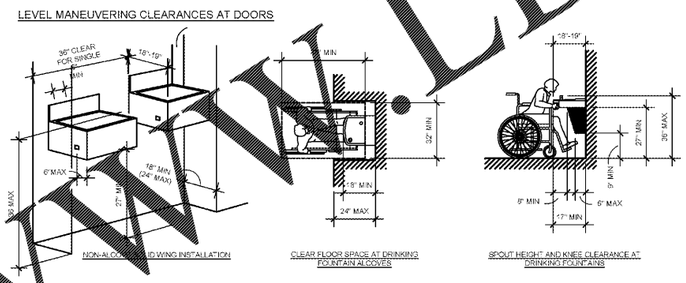

DRINKING FOUNTAIN CLEARANCES

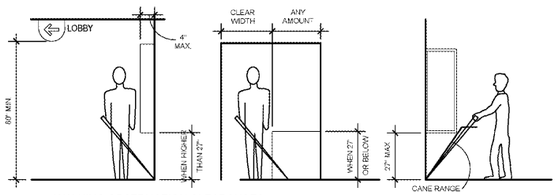

WALKING OBSTRUCTION CLEARANCES



ACCESSIBLE SEATING





SIGN TYPE "A"
(TYP. ROOM IDENTIFICATION SIGN)
SEE DOOR SCHED. FOR LOCATIONS

CONTRASTING SIGNAGE BACKGROUND AND TEXT/NUMERAL COLOR TO BE SELECTED BY OWNER/ARCH. FROM MANUFACTURER'S STANDARD COLOR RANGE.
1" HIGH ROOM NUMBERS, TYP.
BRAILLE ROOM NUMBER
5/8" ROOM IDENTIFICATION TEXT, TYP.
BRAILLE ROOM IDENTIFICATION TEXT
FABRICATE AND INSTALL SIGNAGE PER SPECIFICATIONS

SIGN TYPE "B"
(TYP. TOILET ROOM IDENTIFICATION SIGN AT EACH WOMEN'S ROOM)

CONTRASTING SIGNAGE BACKGROUND AND TEXT/IMAGE COLOR TO BE SELECTED BY OWNER/ARCH. FROM MANUFACTURER'S STANDARD COLOR RANGE.
4 1/2" TALL MALE/FEMALE PICTOGRAMS AND 3-1/2" TALL INTERNATIONAL SYMBOL FOR ACCESSIBILITY (WITH IN A 6" [MIN.] UNOBSTRUCTED FIELD)
5/8" SIGNAGE TEXT, TYP.
BRAILLE TEXT
FABRICATE AND INSTALL SIGNAGE PER SPECIFICATIONS



SIGN TYPE "C"
(TYP. TOILET ROOM IDENTIFICATION SIGN AT EACH MEN'S ROOM)



SIGN TYPE "D"
(TYP. TOILET ROOM DIRECTIONAL SIGN AT TOILET ROOM AISLE)

CONTRASTING SIGNAGE BACKGROUND AND TEXT/IMAGE COLOR TO BE SELECTED BY OWNER/ARCH. FROM MANUFACTURER'S STANDARD COLOR RANGE.
4 1/2" TALL MALE/FEMALE PICTOGRAMS AND 3-1/2" TALL INTERNATIONAL SYMBOL FOR ACCESSIBILITY (WITH IN A 6" [MIN.] UNOBSTRUCTED FIELD)
5/8" SIGNAGE TEXT, TYP.
BRAILLE TEXT
FABRICATE AND INSTALL SIGNAGE PER SPECIFICATIONS



SIGN TYPE "E"
(INTERNATIONAL SYMBOL OF ACCESSIBILITY IDENTIFICATION SIGN)

INTERNATIONAL SYMBOL OF ACCESSIBILITY SIGN. WHITE ON BLUE BACKGROUND TO BE MOUNTED TO THE LATCH OR RIGHT SIDE OF DOOR AT 60" AFF

MOUNT 6"x6" SIGN AT ALL BUILDING ENTRANCES.
MOUNT 4"x4" SIGN AT ALL ACCESSIBLE FEATURES INSIDE BUILDING (I.E. ACCESSIBLE REGISTERS AND COUNTERS)

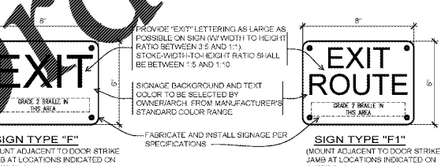

SIGN TYPE "F"
(MOUNT ADJACENT TO DOOR STRIKE JAMB AT LOCATIONS INDICATED ON SHEET **T1.2**)

SIGN TYPE "F1"
(MOUNT ADJACENT TO DOOR STRIKE JAMB AT LOCATIONS INDICATED ON SHEET **T1.2**)

SIGN TYPE "G"
(MOUNT ADJACENT TO HAND SINK AT LEFT HAND CORNER - CONFIRM TYPE WITH LUCKY'S PM.)



SIGN TYPE "B.1"
(TYP. GEOMETRIC SYMBOL TOILET ROOM IDENTIFICATION SIGN AT EACH WOMEN'S ROOM DOOR)
(SEE ACCESSIBILITY GUIDELINE FOR ADDITIONAL INFO.)

SIGN TYPE "C.1"
(TYP. GEOMETRIC SYMBOL TOILET ROOM IDENTIFICATION SIGN AT EACH MEN'S ROOM DOOR)
(SEE ACCESSIBILITY GUIDELINE NOTE FOR ADDITIONAL INFO.)

INTERIOR SIGNAGE SPECIFICATIONS:

ALL BARRIER FREE SIGNS ARE TO BE PROVIDE AND INSTALLED BY THE GENERAL CONTRACTOR

* UPPER CASE CHARACTERS, HELVETICA
* CHARACTERS RAISED 1/32"
* GRADE 2 BRAILLE
* CHARACTERS AT LEAST 5/8" IN HEIGHT" BUT NO HIGHER THAN 2"
* EQUIVALENT VERBAL DESCRIPTIONS PLACED BELOW EACH PICTOGRAM
* PICTOGRAM AREA A MINIMUM OF 6"
* COLOR CONTRAST" BETWEEN CHARACTERS AND BACKGROUND
* MOUNT ON WALL ADJACENT TO LATCH SIDE OF DOOR (UNLESS NOTED OTHERWISE)
* MOUNT 60" FROM FINISHED FLOOR TO CENTER OF SIGN

NOTICE:
The construction documentation contained on this sheet was not prepared by WD Partners, Inc. and is included within this set for Reference Only for the purposes pertaining to this project. WD Partners did not review the construction documentation on this sheet for errors, omissions, accuracy, or correctness and by including this sheet within this construction set, WD Partners does not represent that such information on this sheet is accurate, complete, and that information has not been omitted, or that it complies with all current applicable local codes, restrictions, and requirements.
The standards shown are the minimum requirements and may be more restrictive then local code requirements. It is the intent of the information included in the construction set, that all required elements be installed in full compliance with the Local and State barrier free code and ADAAG.

FLOOR AND LEVELS

A. GROUND AND FLOOR SURFACES ALONG ACCESSIBLE ROUTES AND IN ACCESSIBLE ROOMS AND SPACES INCLUDING FLOORS, WALKS, RAMPS, STAIRS AND CURB RAMPS ARE STABLE, FIRM AND SLIP RESISTANT".

B. CHANGES IN LEVEL DO NOT EXCEED [illegible] AT A 1:2 GRADIENT [illegible] IS ALLOWABLE).

HAZARDS

1. ABRUPT CHANGES IN LEVEL EXCEEDING [illegible] WALK OR SIDEWALK AND AN ADJACENT [illegible] OR DRIVEWAY, EXCEEDING [illegible] INCHES (4") IN VERTICAL HEIGHT, SUCH AS [illegible] OR CONTAINING [illegible] OR ADJACENT TO WALKS, SIDEWALKS OR OTHER [illegible] RAMP WILL BE REQUIRE WARNING CURBS A MINIMUM OF 6" IN HEIGHT".
2. [illegible] THE WALKWAY SURFACE.
3. [illegible] OBSTRUCTION" OVER [illegible] A PEDESTRIANS WAY SHALL BE A MINIMUM OF 80" ABOVE THE WALKWAY SURFACE (MEASURED FROM THE BOTTOM OF THE OBSTRUCTION).
4. IF VERTICAL CLEARANCE IN AN AREA ADJOINING AN ACCESSIBLE ROUTE IS REDUCED TO LESS THAN 80", A BARRIER TO WARN BLIND OR VISUALLY IMPAIRED PERSONS IS PROVIDED.
5. SIDEWALKS AND WALKS SHALL BE CLEAR OF HAZARDS.

PROTRUDING OBJECTS

1. OBJECTS PROJECTING FROM WALLS WHOSE LEADING EDGES ARE BETWEEN 27" AND 80" ABOVE THE FINISHED FLOOR DO NOT PROTRUDE MORE THAN 4" INTO WALKS, HALLS, CORRIDORS, PASSAGEWAYS OR AISLES. (OBJECTS WHOSE LEADING EDGES ARE AT OR BELOW 27" ABOVE THE FINISHED FLOOR MAY PROTRUDE ANY AMOUNT)
2. PROTRUDING OBJECTS MAY NOT REDUCE THE REQUIRED CLEAR WIDTH OF AN ACCESSIBLE ROUTE OR MANEUVERING SPACE.
3. FREE STANDING OBJECTS MOUNTED ON POSTS OR PYLONS OVERHANG 12" MAXIMUM FROM 27" TO 80" ABOVE THE FINISHED FLOOR.
4. WALKS, HALLS, CORRIDORS, PASSAGEWAYS, AISLES OR OTHER CIRCULATION SPACES HAVE A MINIMUM OF 80" CLEAR HEAD ROOM.
5. IF VERTICAL CLEARANCE OF AN AREA ADJOINING AN ACCESSIBLE ROUTE IS REDUCED TO LESS THAN 80", A BARRIER TO WARN THE BLIND OR VISUALLY-IMPAIRED PERSONS SHALL BE PROVIDED.

SITE REQUIREMENTS

SITE DEVELOPMENT & ACCESSIBLE ROUTE OF TRAVEL. ACCESSIBLE ROUTE OF TRAVEL IS DEFINED AS "A CONTINUOUS UNOBSTRUCTED PATH CONNECTING ALL ACCESSIBLE ELEMENTS AND SPACES IN AN ACCESSIBLE BUILDING OR FACILITY THAT CAN BE NEGOTIATED BY A PERSON WITH A SEVERE DISABILITY USING A WHEELCHAIR AND THAT IS ALSO SAFE FOR AND USABLE BY PERSONS WITH OTHER DISABILITIES".

1. AT LEAST ONE ACCESSIBLE ROUTE WITHIN THE BOUNDARY OF THE SITE SHALL BE PROVIDED FROM PUBLIC TRANSPORTATION STOPS, ACCESSIBLE PARKING AND ACCESSIBLE PASSENGER LOADING ZONES AND PUBLIC STREETS OR SIDEWALKS TO THE ACCESSIBLE BUILDING ENTRANCE THEY SERVE.
2. AT LEAST ONE ACCESSIBLE ROUTE SHALL CONNECT ACCESSIBLE BUILDINGS, FACILITIES, ELEMENTS AND SPACES THAT ARE ON THE SAME SITE.
3. AT LEAST ONE ACCESSIBLE ROUTE SHALL CONNECT ACCESSIBLE BUILDING OR FACILITY ENTRANCES WITH ALL ACCESSIBLE SPACES AND ELEMENTS.
4. UNLESS OTHERWISE INDICATED, THE MINIMUM CLEAR WIDTH OF AN ACCESSIBLE ROUTE SHALL NOT BE LESS THAN 36 INCHES
5. ALL ENTRANCES AND ALL EXTERIOR GROUND-LEVEL EXITS SHALL BE ACCESSIBLE.

CURB RAMPS

1. CURB RAMPS SHALL BE CONSTRUCTED AT EACH CORNER OF STREET INTERSECTIONS AND WHERE A PEDESTRIAN WAY CROSSES A CURB. BUILT UP CURB RAMPS SHALL BE LOCATED SO THAT THEY DO NOT PROJECT INTO VEHICULAR TRAFFIC LANES. THE PREFERRED AND RECOMMENDED LOCATION FOR CURB RAMPS IS IN THE CENTER OF THE CROSSWALK OF EACH STREET CORNER. WHERE IT IS NECESSARY TO LOCATE A CURB RAMP IN THE CENTER OF THE CURB RETURN AND THE STREET SURFACES ARE MARKED TO IDENTIFY PEDESTRIAN CROSSWALKS, THE LOWER END OF THE CURB RAMP SHALL TERMINATE WITHIN SUCH CROSSWALK AREAS.
2. CURB RAMPS SHALL BE A MINIMUM OF 4 FEET IN WIDTH AND SHALL LIE, GENERALLY, IN A SINGLE SLOPED PLANE, WITH A MINIMUM OF SURFACE WARPING AND CROSS SLOPE.
3. THE SLOPE OF CURB RAMPS SHALL NOT EXCEED ONE UNIT VERTICAL IN 12 UNITS HORIZONTAL (8.33% SLOPE). TRANSITIONS FROM RAMPS TO WALKS, GUTTERS OR STREETS SHALL BE FLUSH AND FREE OF ABRUPT CHANGE. MAXIMUM SLOPES OF ADJOINING GUTTERS, ROAD SURFACE IMMEDIATELY ADJACENT TO THE CURB RAMP, OR ACCESSIBLE ROUTE SHALL NOT EXCEED ONE UNIT VERTICAL IN 20 UNITS HORIZONTAL (5% SLOPE) WITHIN 4 FEET OF THE BOTTOM OF THE CURB RAMP. THE SLOPE OF THE FANNED OR FLARED SIDE OF CURB RAMPS SHALL NOT EXCEED ONE UNIT VERTICAL IN 10 UNITS HORIZONTAL (10% SLOPE).
4. A LEVEL LANDING 4 FEET DEEP SHALL BE PROVIDED AT THE UPPER END OF EACH CURB RAMP OVER IT'S FULL WIDTH TO PERMIT SAFE EGRESS FROM THE RAMP SURFACE, OR THE SLOPE OF THE FANNED OR FLARED SIDES OF THE CURB RAMP SHALL NOT EXCEED ONE UNIT VERTICAL IN 10 UNITS HORIZONTAL (10% SLOPE).
5. THE SURFACE OF EACH CURB RAMP AND IT'S FLARED SIDES SHALL COMPLY WITH SECTION 406, GROUND AND FLOOR SURFACES, AND SHALL BE OF CONTRASTING FINISH FROM THAT OF THE ADJACENT SIDEWALK.
8. ALL CURB RAMPS SHALL HAVE A GROOVED BORDER 12 INCHES WIDE AT THE LEVEL SURFACE OF THE SIDEWALK ALONG THE TOP AND EACH SIDE APPROXIMATELY 3/4 INCH ON CENTER. ALL CURB RAMPS CONSTRUCTED BETWEEN THE FACE OF THE CURB AND THE STREET SHALL HAVE A GROOVED BORDER AT THE LEVEL SURFACE OF THE SIDEWALK.

WALKS AND SIDEWALKS

1. WALKS AND SIDEWALKS SHALL HAVE A CONTINUOUS COMMON SURFACE, NOT INTERRUPTED BY STEPS OR ABRUPT CHANGES IN LEVEL EXCEEDING 1/2 INCH AND SHALL BE A MINIMUM OF 48 INCHES IN WIDTH. IF A WALK OR SIDEWALK HAS LESS THAN 60 INCH CLEAR WIDTH, THEN PASSING SPACES AT LEAST 60 INCHES BY 60 INCHES SHALL BE LOCATED AT REASONABLE INTERVALS NOT TO EXCEED 200 FEET".

Order Plans @ WWW.LDILine.com

WD
WD PARTNERS, INC.
7777 DISCOVERY BLVD
DUBLIN, OH 43016
614.7000 T
WDPARTNERS.COM

DISCLAIMER:
The construction documentation contained on this sheet was not prepared by WD Partners, Inc. and is included within this set
FOR REFERENCE ONLY

Lucky's Market

LUCKY'S MARKET
PROMENADE at NAPLES
6424 NAPLES BLVD.
NAPLES, FL 34109

FOR REFERENCE ONLY

REVISIONS

PERMIT ISSUE
MAY 7, 2018
BID ISSUE 06/07/18
STORE NUMBER
57
WD PROJECT NUMBER
LKYUF0011

G0.4

ACCESSIBILITY NOTES / DETAILS

File: [illegible] Date: 2/07/2018 1:10:51 PM (wdd) Printed: 5/7/2018 7:50:02 PM (mfyfe)