

REVISIONS

NO.	DATE	DESCRIPTION
1		
2		
3		
4		
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		
16		
17		
18		
19		
20		

PERMIT ISSUE
MAY 7, 2018
BID ISSUE 05/07/18
STORE NUMBER
57
WD PROJECT NUMBER
LKYU0011

A1.2 CONCRETE PLACEMENT PLAN


GENERAL NOTES

- A. CONCRETE SLAB TO BE PROVIDED BY GENERAL CONTRACTOR. REVIEW SCOPE OF WORK WITH LUCKY'S CONSTRUCTION MANAGER. CONTRACTOR SHALL FULLY COORDINATE WITH ALL TRADES TO ENSURE THAT ALL UNDER SLAB PIPING, DRAINS, REFRIGERATION PIPES, ELECTRICAL CONDUITS, ETC. HAVE BEEN INSTALLED PRIOR TO INSTALLATION OF CONCRETE SLAB.
- B. ALL DIMENSIONS ARE TAKEN FROM FACE OF EXISTING WALLS OR CENTERLINE OF EXISTING COLUMNS, UNLESS NOTED OTHERWISE.
- C. FIELD VERIFY ALL DIMENSIONS.
- D. REFER TO REFRIGERATION, PLUMBING AND ELECTRICAL DRAWING FOR UNDER SLAB WORK RELATED TO EQUIPMENT.
- E. REFER TO REFRIGERATION, PLUMBING AND ELECTRICAL DRAWING AND SPECIFICATIONS FOR UNDER SLAB PIPING AND CONDUIT LOCATIONS, DIMENSIONS AND SPECIFICATIONS.
- F. GENERAL CONTRACTOR AND CONCRETE TRADE CONTRACTOR TO ENSURE ALL CONCRETE PLACED IS TO BE ACCEPTABLE FOR NEW FLOOR FINISHES AS SPECIFIED. SEE FLOOR FINISH PLAN ON SHEET A1.5 FOR FLOOR FINISHES. COMPLY WITH FLOORING MANUFACTURER'S WRITTEN INSTRUCTIONS AND SPECIFICATIONS FOR SURFACE PREPARATION, MIXING INSTRUCTIONS, APPLICATION TECHNIQUES, ETC.
- G. CONDUIT AND PIPE PENETRATIONS THROUGH FLOOR SHOULD BE NEAT AND TIGHT.
- H. SEE FLOOR FINISH PLAN, SHEET A1.5 FOR FLOOR FINISHES.


KEYED NOTES

- ① APPROXIMATE EXTENT OF SLAB REMOVAL SHOWN FOR UNDER SLAB PIPING REQUIREMENTS. GENERAL CONTRACTOR SHALL FIELD VERIFY AND COORDINATE CONCRETE REPAIRS. SEE DEMOLITION PLAN, SHEET D1.0. SEE STRUCTURAL DETAILS FOR INSTALLATION JOINT BETWEEN NEW AND EXISTING CONCRETE SLABS AND COORDINATE WITH ALL INSTALLATION TRADES.
- ② REFRIGERATION PIPING SLEEVE SHOWN FOR REFERENCE ONLY. G.C. SHALL REFER TO REFRIGERATION DRAWINGS FOR SLEEVE SIZE, LOCATION AND INSTALLATION.
- ③ FLOOR DRAIN - TO BE INSTALLED WITH SLOPE OF 1/8" PER FOOT. MINIMUM SLOPE OF 1% AND MAXIMUM SLOPE OF 2%. SEE PLUMBING DRAWINGS FOR LOCATIONS AND SIZES.
- ④ TRENCH DRAIN - TO BE INSTALLED WITH FINISH FLOOR. SEE DETAIL THIS SHEET FOR INSTALLATION REQUIREMENTS IN CONCRETE SLAB. SEE PLUMBING DRAWINGS FOR LOCATIONS AND SPECIFICATIONS.
- ⑤ RECESSED CONCRETE IN RECESSED FREEZER DOOR TO BE CONSTRUCTED BY GENERAL CONTRACTOR. SEE DETAIL THIS SHEET.
- ⑥ SINK - SEE PLUMBING DRAWINGS.
- ⑦ RECESSED CONCRETE FLOOR TO DRAIN SLAB UNDER ICE MAKER. SEE DETAIL THIS SHEET.
- ⑧ FINISH BAKERY OVER SINK TO BE LEVEL - PROVIDE 6'-0" x 6'-0" LEVEL SLAB WITH NO FLOOR FINISH. SEALER ETC. UNLESS OTHERWISE NOTED.
- ⑨ EXISTING DOCK SLAB TO REMAIN.
- ⑩ WALL CUT SHOWN FOR REFERENCE. SEE FLOOR PLANS FOR ADDITIONAL INFORMATION.
- ⑪ FLOOR SINK TO BE INSTALLED WITH FINISH FLOOR - SEE PLUMBING DRAWINGS FOR EXACT QUANTITY, LOCATIONS, SPECIFICATIONS AND DETAIL.
- ⑫ APPROXIMATE LOCATION OF HUB DRAIN. SEE PLUMBING DRAWING FOR DIMENSIONED LOCATIONS AND SPECIFICATION.
- ⑬ EXISTING STRUCTURAL STEEL COLUMN.
- ⑭ EXISTING DOCK LEVELER TO REMAIN.
- ⑮ CONTRACTOR TO TAKE CARE NOT TO DAMAGE EXISTING CONCRETE FOOTING VERIFY SIZE AND DEPTH AND PLACE REINFORCEMENT AS SHOWN. SEE STRUCTURAL DRAWING FOR ADDITIONAL INFORMATION.
- ⑯ INSTALL 6" HIGH CONCRETE PAD FOR WATER HEATER TANKS.


NOTES:
 - FINISHED FLOOR @ 0'-0" FFE
 - SLAB CUTS DEFINED FOR USE WITH ZURN MODEL 2720 CAST IRON GRATES
 - PART # 2128-1
 - 15#6 FIBER BAY
 - PROVIDE GRATE
 - THE CONCRETE TRADESMAN SHALL DEFINE THE BEST MANNER FOR SLAB POLYISOLATION
 - ALL CONCRETE MATERIALS SHALL MEET THE REINFORCING SPECIFICATIONS AS DETERMINED BY THE STRUCTURAL ENGINEER OF RECORD.

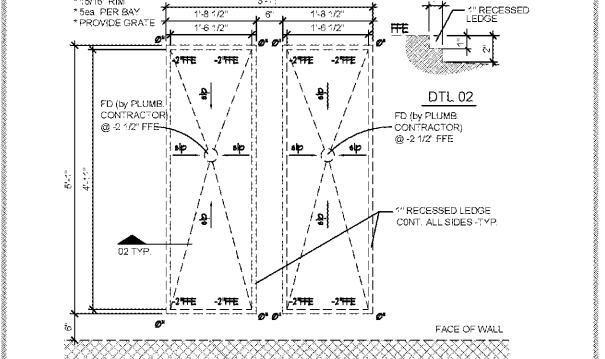


03 RECESSED SLAB AT ICE MACHINE
SCALE: 3/4" = 1'-0"

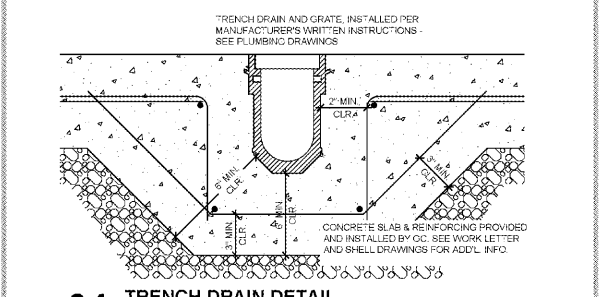

04 TRENCH DRAIN DETAIL
SCALE: 1" = 1'-0"

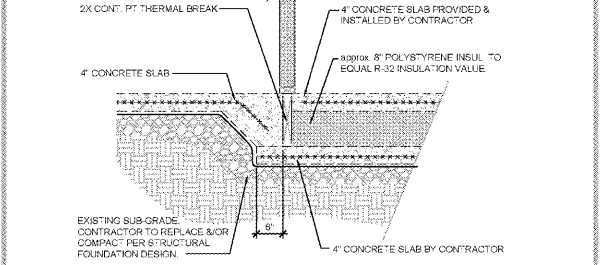

05 RECESSED FREEZER FLOOR
SCALE: 3/4" = 1'-0"

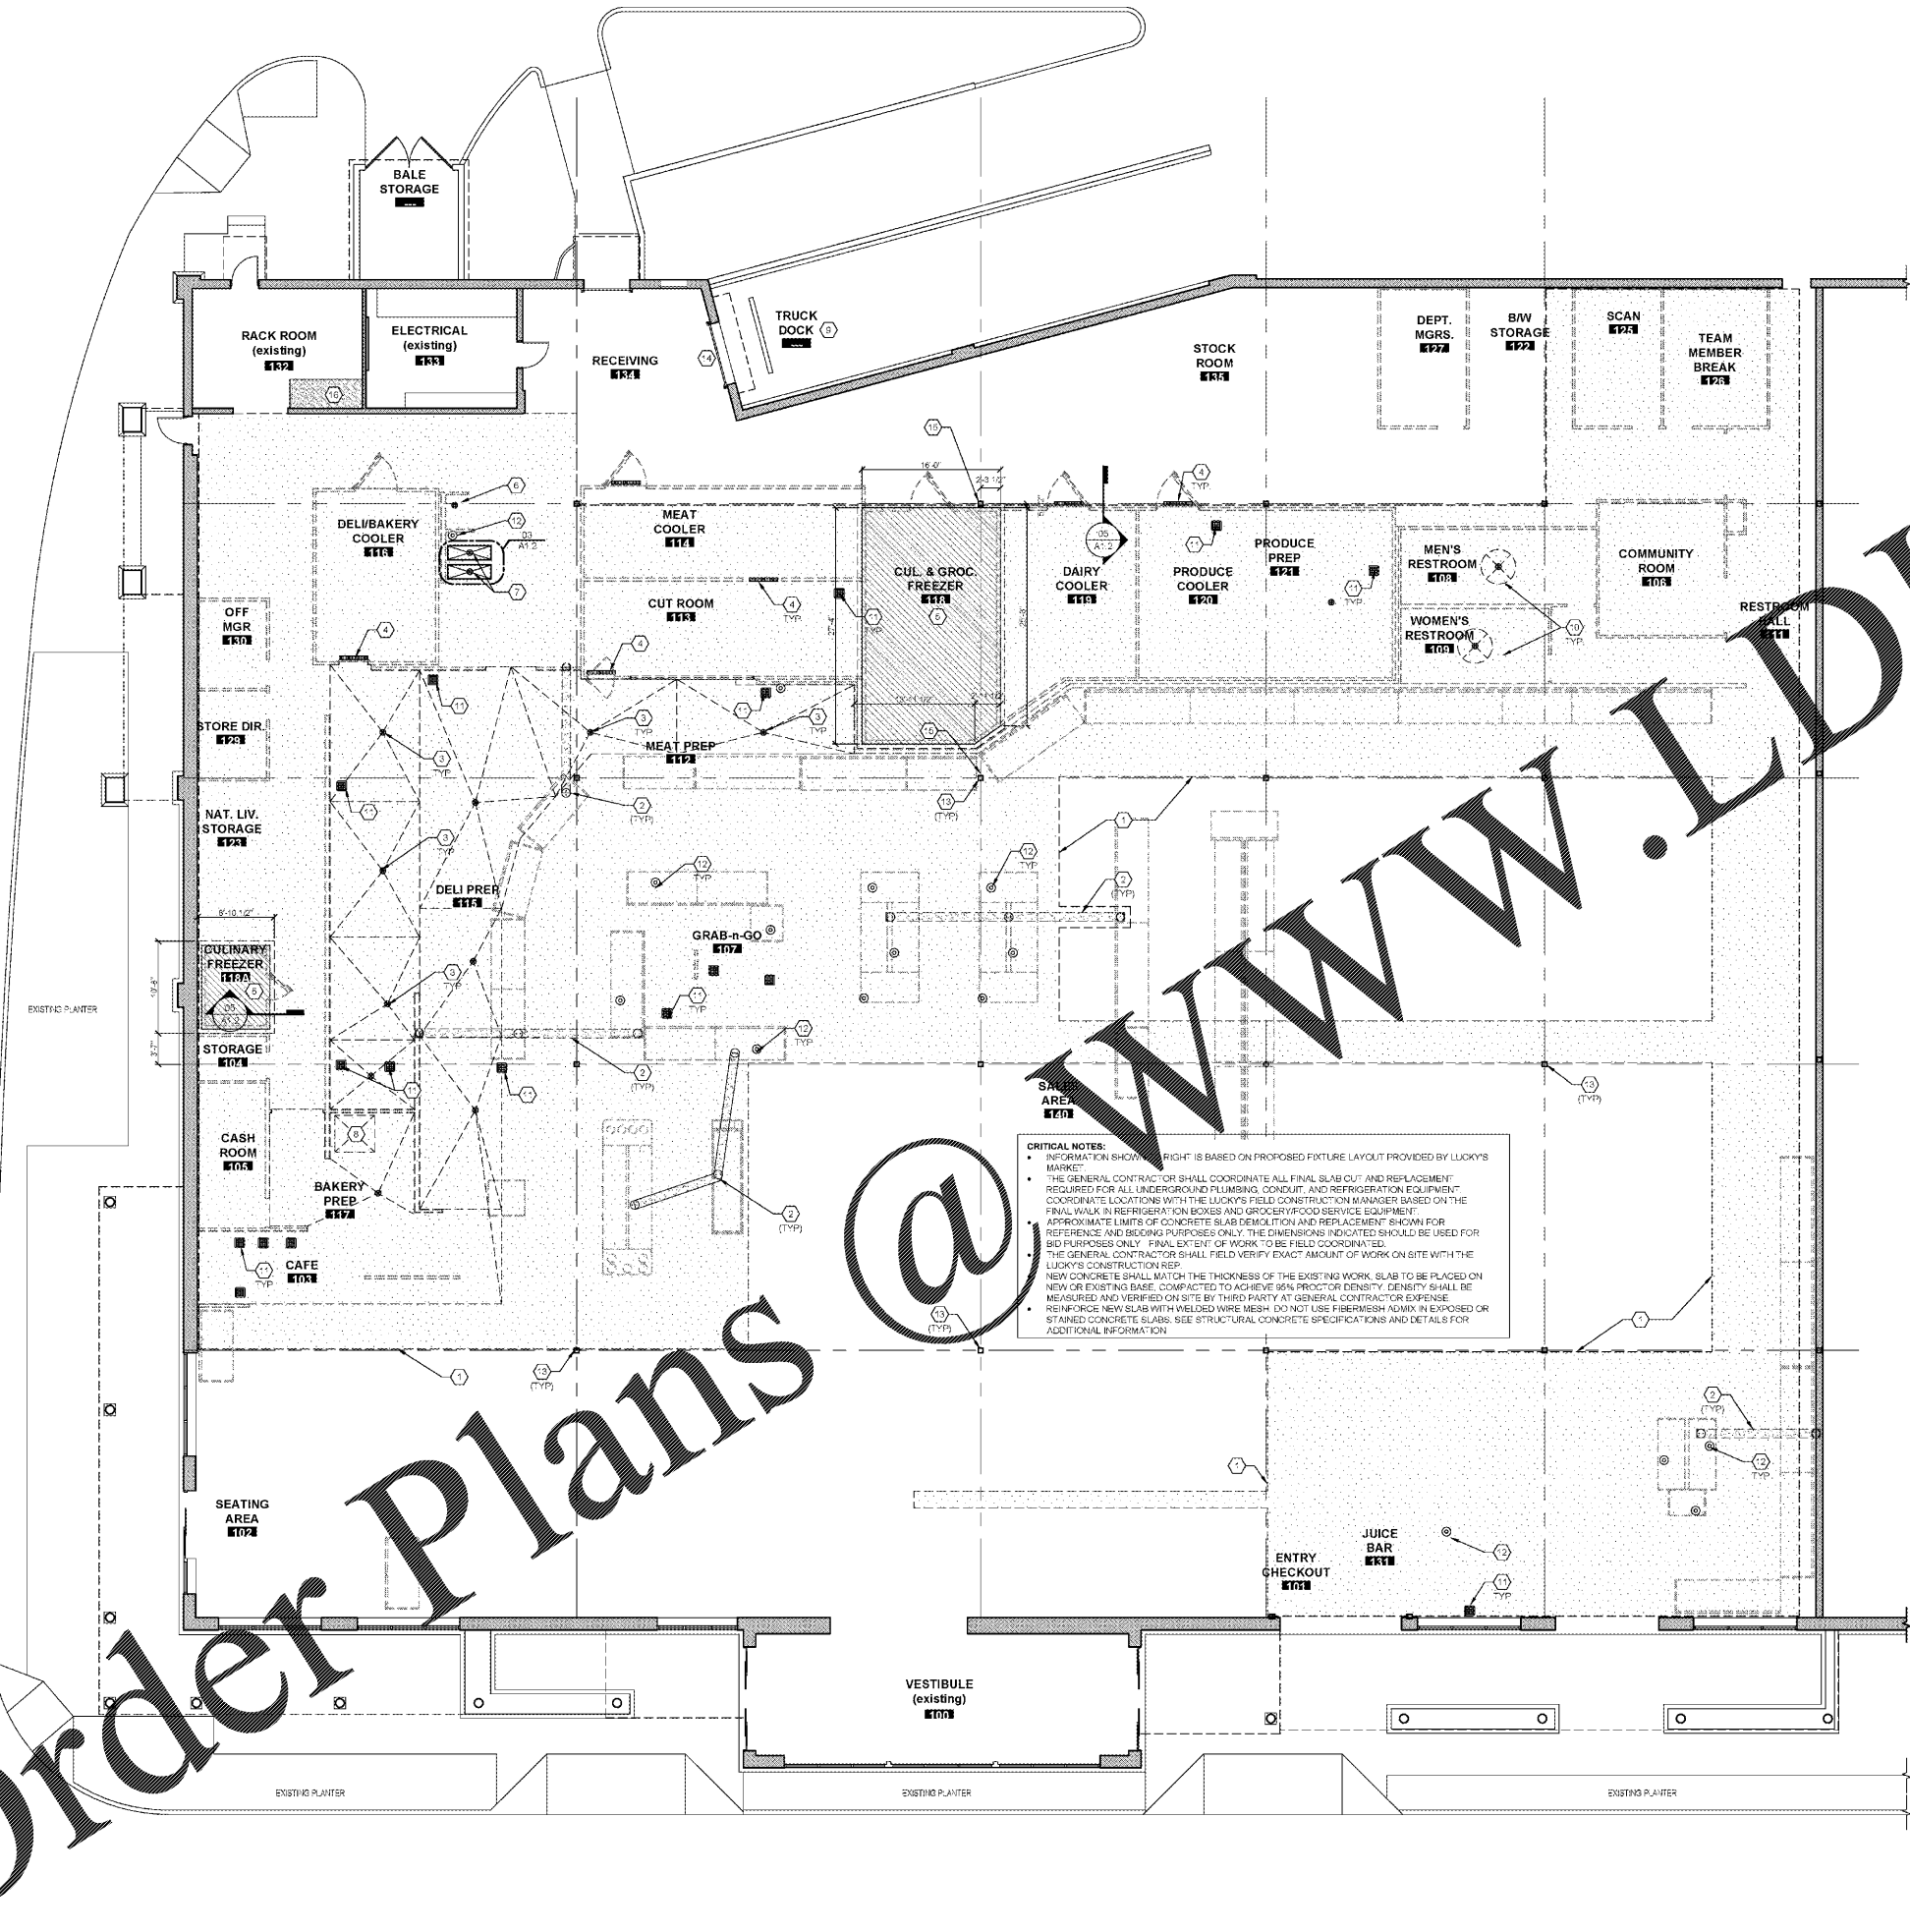

CRITICAL NOTES:
 • INFORMATION SHOWN TO THE RIGHT IS BASED ON PROPOSED FIXTURE LAYOUT PROVIDED BY LUCKY'S MARKET.
 • THE GENERAL CONTRACTOR SHALL COORDINATE ALL FINAL SLAB CUT AND REPLACEMENT REQUIRED FOR ALL UNDERGROUND PLUMBING, CONDUIT, AND REFRIGERATION EQUIPMENT. COORDINATE LOCATIONS WITH THE LUCKY'S FIELD CONSTRUCTION MANAGER BASED ON THE FINAL WALK IN REFRIGERATION BOXES AND GROCER/FOOD SERVICE EQUIPMENT.
 • APPROXIMATE LIMITS OF CONCRETE SLAB DEMOLITION AND REPLACEMENT SHOWN FOR REFERENCE AND BIDDING PURPOSES ONLY. THE DIMENSIONS INDICATED SHOULD BE USED FOR BID PURPOSES ONLY. FINAL EXTENT OF WORK TO BE FIELD COORDINATED.
 • THE GENERAL CONTRACTOR SHALL FIELD VERIFY EXACT AMOUNT OF WORK ON SITE WITH THE LUCKY'S CONSTRUCTION REP.
 • NEW CONCRETE SHALL MATCH THE THICKNESS OF THE EXISTING WORK. SLAB TO BE PLACED ON NEW OR EXISTING BASE, COMPACTED TO ACHIEVE 95% PROCTOR DENSITY. DENSITY SHALL BE MEASURED AND VERIFIED ON SITE BY THIRD PARTY AT GENERAL CONTRACTOR EXPENSE.
 • REINFORCE NEW SLAB WITH WELDED WIRE MESH. DO NOT USE FIBERESH ADMIN IN EXPOSED OR STAINED CONCRETE SLABS. SEE STRUCTURAL CONCRETE SPECIFICATIONS AND DETAILS FOR ADDITIONAL INFORMATION.

01 CONCRETE PLACEMENT PLAN
SCALE: 1/8" = 1'-0"

Order Plans @

